6-68-33

ANSI A112.21.2M-1983 21 September 1983 SUPERSEDING ANSI A112.21.2-1971 14 December 1982

ACCEPTANCE NOTICE

This non-government document was adopted on 21 September 1983 and is approved for use by the DoD. The indicated industry group has furnished the clearance required by existing regulations. Copies of the document are stocked by DoD Single Stock Point, Naval Publications and Forms Center, Philadelphia, PA 19120, for issue to DoD activities only. Contractors and industry groups must obtain copies from ANSI, 1430 Broadway, New York, NY 10018

Title of Document:

American National Standard

Roof Drains

Date of Specific Issue Adopted:

July 31, 1983

Releasing Industry Group:

American Society of Mechanical Engineers

NOTICE: When reaffirmation, amendment, revision, or cancellation of this standard is initially proposed, the industry group responsible for this standard shall inform the military coordinating activity of the proposed change and request participation.

Custodians:

Military Coordinating Activity:

Army - ME Navy - YD Navy - YD

Air Force - 99

Project No. 4510-0214

Review activity:

DLA - CS

User activity:

Army - CE

Navy - MC

FSC 4510

				D. A.O.E.O.
THIS	DOCUMENT	CONTAINS	1.	PAGES.

■ O &EO&OOO 5122P25 ■ E& MS.15.511A 3M2A

L-68.33

AMERICAN NATIONAL STANDARD

Roof Drains

ANSI A112.21.2M - 1983

(REVISION OF ANSI A112.21.2-1971)

PUBLISHED BY

THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS

United Engineering Center

345 East 47th Street

New York, N.Y. 10017

MSME All2.21.2M 83 ■ 2595512 0008039 2 ■

Date of Issuance: July 31, 1983

This code or standard was developed under procedures accredited as meeting the criteria for American National Standards. The Consensus Committee that approved the code or standard was balanced to assure that individuals from competent and concerned interests have had an opportunity to participate. The proposed code or standard was made available for public review and comment which provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.

ASME does not "approve," "rate," or endorse" any item, construction, proprietary device, or activity.

ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable Letters Patent, nor assume any such liability. Users of a code or standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Participation by federal agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this code or standard.

No part of this document may be reproduced in any form, in an electronic retrieval system or otherwise, without the prior written permission of the publisher.

Copyright © 1983 by
THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS
All Rights Reserved
Printed in U.S.A.



Copyright ASME International Provided by IHS under license with ASME No reproduction or networking permitted without license from IHS

Not for Resal

ASME All2.21.2M 83 ■ 2595512 0008040 9 ■

FOREWORD

(This Foreword is not part of American National Standard, Roof Drains, ANSI A112.21.2M-1983.)

Rainwater was prevented from accumulating on the roofs of the first buildings by pitching the roof to allow the water to flow off. The first means to collect and control rain runoff was to provide a gutter that ran the length of the low roof section. All of the water drained to the gutter, which in turn sloped to an outside downspout pipe. This was followed by the development of inside downspouts because of the unsightly appearance of the outside downspouts on many buildings.

The first inside downspout consisted of a sheet metal sump below the roof surface covered by a wire screen to keep out debris. Later, the screen was replaced by a flange and dome-basket arrangement.

The first development in a roof drain, as we know it today, was a cast metal downspout head consisting of an increaser that was screwed onto the downspout pipe with a cast iron dome bolted to this increaser. The problem of leakage around the downspout head between the head and the roofing material prompted the development of a clamp device to secure the roof flashing to the head, creating the first modern roof drain.

There followed a series of designs of roof drains incorporating the beehive or mushroom dome, non-puncturing flashing clamp device with integral gravel stop, promenade tops, deep sump drain bodies, expansion joints, and other variations in design to facilitate installation and to control the rainwater runoff.

USA Standards Committee A112 was organized July 27, 1955, for the standardization of plumbing materials and equipment. The first organizational meeting was held on July 22, 1958. At a meeting on May 1, 1964, Panel No. 21 was created to establish standards on roof drains and floor drains. Its scope was as follows: The recommendation of suitable existing standards in cooperation with interested sponsors or the development of adequate new standards as are needed for roof drains and floor drains as used or installed in plumbing systems.

Prior to the establishment of this Panel, the Plumbing and Drainage Institute started a standardization study on September 15, 1961. The PDI is an organization of manufacturers of drainage products. They realized the need for roof drain standards and therefore conducted the study.

The Institute's Executive Secretary acted as Chairman and the Engineers from the participating member companies were a part of the committee. During the period from September 15, 1961 to September 1963, the group formulated some basic drain standards and specifications. Though this information was never published, it is used as a basis for this Standard.

Engineer members of the Plumbing and Drainage Institute were appointed to the Task Force on Panel No. 21. The first meeting was held on February 2, 1966. A rough draft of this Standard was submitted on May 18, 1966 to the Task Force members. The Task Force met again on July 21, 1966 to review the second draft. Revisions were made and the proposed standard was submitted to members of Panel No. 21.

Following approval of the proposal by the Panel, the American National Standards Committee A112 and the sponsor, the American National Standards Institute approved it on July 27, 1971.

This Standard was revised and approved by Panel 21, the A112 Standards Committee and Secretariat. Subsequently this modified version was adopted by the American National Standards Institute on March 7, 1983.

AMERICAN NATIONAL STANDARDS COMMITTEE A112 Standardization of Plumbing Materials and Equipment

(The following is the roster of the Committee at the time of approval of this Standard.)

OFFICERS

J. C. Church, Chairman

C. E. Lynch, Secretary

COMMITTEE PERSONNEL

AIR CONDITIONING AND REFRIGERATION INSTITUTE

- L. P. Benua, EBCO Manufacturing Company, Columbus, Ohio
- R. J. Denny, Alternate, Air Conditioning and Refrigeration Institute, Arlington, Virginia

AMERICAN IRON AND STEEL INSTITUTE

- G. T. Rochford, Jr., American Iron and Steel Institute, Washington, D.C.
- B. J. Enright, Alternate, Field Representative, Raytown, Missouri

AMERICAN SOCIETY OF MECHANICAL ENGINEERS

R. V. Benazzi, Juros, Baum and Boiles, New York, New York

THE AMERICAN SOCIETY OF PLUMBING ENGINEERS

- D. F. Dickerson, Donald F. Dickerson Associates, Van Nuys, California
- A. J. Morales, Alternate, American Society of Plumbing Engineers, Sherman Oaks, California

AMERICAN SOCIETY OF SANITARY ENGINEERING

- J. C. Church, Mamaroneck, New York
- G. R. Jerus, Alternate, Meyer, Strong and Jones, New York, New York
- L. M. Reading, Alternate, ASSE Representative, Detroit, Michigan

ASSOCIATION OF ASBESTOS CEMENT PIPE PRODUCERS

T. R. Gillen, Asbestos Cement Pipe Producers Association, Arlington, Virginia

ASSOCIATION OF HOME APPLIANCE MANUFACTURERS

- R. Kerr, KitchenAid Division, Hobart Mfg., Troy, Ohio
- W. Blanck, Alternate, Association of Home Appliance Manufacturers, Chicago, Illinois

BUILDING OFFICIALS AND CODE ADMINISTRATORS INTERNATIONAL

- D. P. Jack, Hampton, Virginia
- J. A. Ballanco, Alternate, Building Officials and Code Administrators International, Homewood, Illinois

CAST IRON SOIL PIPE INSTITUTE

J. A. Woodward, Apple Valley, California

CONFERENCE OF STATE SANITARY ENGINEERS

C. C. Crumley, Michigan Department of Public Health, Lansing, Michigan

COPPER DEVELOPMENT ASSOCIATION, INC.

A. Cohen, Standards and Safety Engineering Copper Development Association, Inc., New York, New York

INTERNATIONAL ASSOCIATION OF PLUMBING AND MECHANICAL OFFICIALS

N. J. Latter, International Association of Plumbing and Mechanical Officials, Los Angeles, California

v

LEAD INDUSTRIES ASSOCIATION

E. D. Martin, Lead Industries Association, New York, New York

MANUFACTURERS STANDARDIZATION SOCIETY OF THE VALVE AND FITTINGS INDUSTRY C. S. Anning, Elcen Metal Products, S. Melrose Park, Illinois

NATIONAL ASSOCIATION OF HOME BUILDERS

- C. D. Goines, National Association of Home Builders, Washington, D.C.
- M. M. Mintz, Alternate, National Association of Home Builders, Washington, D.C.

NATIONAL ASSOCIATION OF PLUMBING-HEATING-COOLING CONTRACTORS

R. E. White, National Association of Plumbing-Heating-Cooling Contractors, South Bend, Indiana

NATIONAL CLAY PIPE INSTITUTE

R. M. Clementson, National Clay Pipe Institute, Washington, D.C.

NATIONAL ENVIRONMENTAL HEALTH ASSOCIATION

G. A. Prince, Denver, Colorado

NATIONAL SANITATION FOUNDATION

T. S. Gable, National Sanitation Foundation, Ann Arbor, Michigan

PLUMBING AND DRAINAGE INSTITUTE

A. O. Roche, Jr., Plumbing and Drainage Institute, Indianapolis, Indiana

PLUMBING MANUFACTURERS INSTITUTE

- C. Selover, Travelers Rest, South Carolina
- R. W. Church, Alternate, Plumbing Manufacturers Institute, Glen Ellyn, Illinois

SOCIETY OF THE PLASTICS INDUSTRY

S. Mruk, New Providence, New Jersey

STATE OF NEW YORK HOUSING AND BUILDING CODES BUREAU

A. Y. Kaplan, New York State Housing and Building Codes Bureau, New York, New York

U.S. DEPARTMENT OF AGRICULTURE

E. E. Jones, Jr., U.S. Department of Agriculture, Clemson, South Carolina

U.S. DEPARTMENT OF COMMERCE -- NATIONAL BUREAU OF STANDARDS

L. S. Galowin, National Bureau of Standards, Washington, D.C.

U.S. DEPARTMENT OF DEFENSE

M. E. Carr, U.S. Department of Defense, Washington, D.C.

U.S. DEPARTMENT OF THE NAVY

R. Cuendet, U. S. Naval Facilities Engineering Command, Alexandria, Virginia

INDIVIDUAL MEMBERS

- R. S. Wyly, Kensington, Maryland
- L. S. Nielson, Fresh Meadows, New York
- P. J. Higgins, P. J. Higgins and Associates, Mt. Airy, Maryland

ASME All2.21.2M 83 🖿 2595512 0008043 4 📟

PERSONNEL OF PANEL 21 - ROOF DRAINS, FLOOR DRAINS, AND OTHER DRAINS

- A. Q. Roche Jr., Chairman, Plumbing and Drainage Institute, Indianapolis, Indiana
- W. W. White, Secretary, White Plumbing and Heating Company, Detroit, Michigan
- J. C. Church, Mamaroneck, New York
- G. J. Flegel, Michigan City, Indiana
- M. W. Marshall, Tyler, Texas
- J. M. Soriano, Scotch Plains, New Jersey

CONTENTS

	reword	
1 1 2 1 3 1 4 9 5 1	Scope and Purpose Definitions Nomenclature Outlet Types and Connections Top Size — Dome or Grate Free Area Materials Finishes	1 1 4 4 4
	Accessories	
_	1 General Purpose Roof Drain	2 3 4 4 4
	Minimum Dimensions for Threaded Outlet Connections. Minimum Dimensions for Inside Caulk Outlet Connections. Minimum Dimensions for Hub Outlet Connections. General Purpose Roof Drain. Gutter or Cornice Roof Drain. Parapet Roof Drain.	5 5 6 6 6

AMERICAN NATIONAL STANDARD

ROOF DRAINS

1 SCOPE AND PURPOSE

1.1 Scope

- 1.1.1 Development of standards for roof drains including general purpose, gutter and cornice, parapet and promenade or deck types, which convey rainwater from the roof area of building structures.
 - 1.1.2 This Standard covers:
 - (a) Definitions
 - (b) Nomenclature
 - (c) Outlet Types and Connections
 - (d) Top Size Dome or Grate Free Area
 - (e) Materials and Finishes
 - (f) Accessories

1.2 Purpose

The purpose of this Standard is to supply plumbing code authorities and others with full knowledge of the minimum design and quality criteria for roof drains. It is not intended for use as a specification guide.

CAUTION: Illustrations included in this Standard are intended only to describe and portray typical roof drain types and are not intended to restrict design or to be used for specification purposes.

2 DEFINITIONS

2.1 General

A roof drain is a manufactured receptacle designed to receive and convey rainwater from roof areas to the drainage system. Roof drains are available in various designs, shapes, sump depths, and outlet locations. The area to be drained, location of the drain in the building structure, the local rainfall intensity and the drainage systems are factors in determining the type of drain to be used.

2.2 Types

- 2.2.1 General Purpose Roof Drain. A roof drain for installation in any roof area excluding the parapet of the roof structure.
- 2.2.2 Gutter or Cornice Roof Drain. A roof drain for installation in gutters, cornices, balconies and other overhanging construction to prevent overflow to areas below.
- 2.2.3 Parapet Roof Drain. A roof drain for installation in parapets for conveying rainwater from a roof area through the parapet.
- 2.2.4 Promenade or Deck Roof Drain. A roof drain for installation in roof decks subject to pedestrian or vehicular traffic.

2.3 Dome or Grate Free Area

Total area of drainage openings in the dome or grate.

2.4 Conductor

A pipe inside the building which conveys storm water from the roof to a storm or combined building drain.

2.5 Leader

An exterior drainage pipe for conveying storm water from roof or gutter drains.

3 NOMENCLATURE

Terms used for elements of typical roof drain types are depicted in Figs. 1 through 4.

1

Copyright ASME International Provided by IHS under license with ASME No reproduction or networking permitted without license from IHS

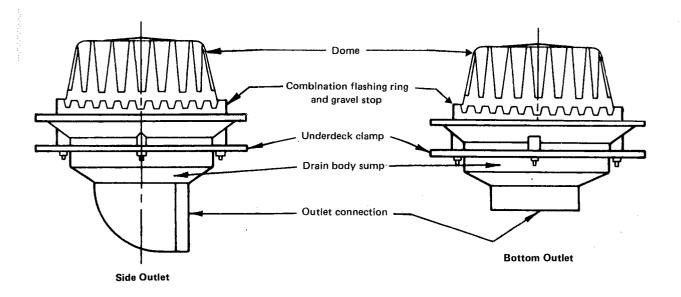


FIG.1 GENERAL PURPOSE ROOF DRAIN

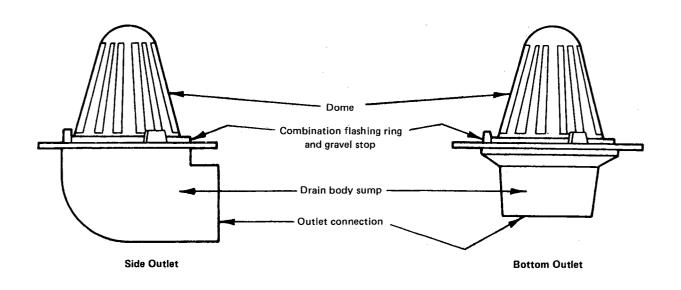


FIG. 2 GUTTER OR CORNICE ROOF DRAIN

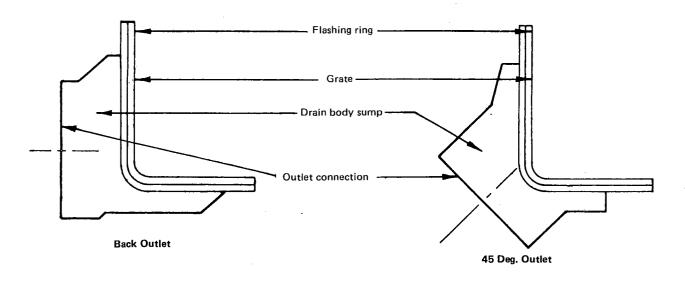


FIG. 3 PARAPET ROOF DRAIN

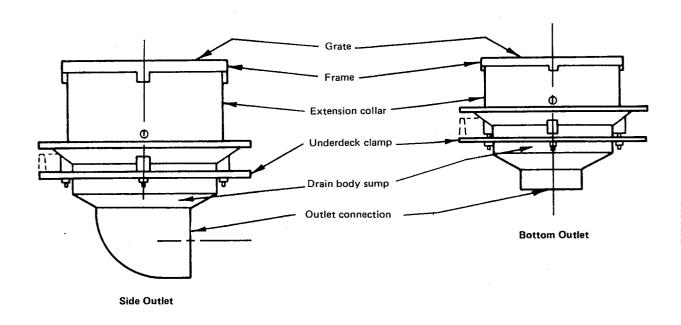


FIG. 4 PROMENADE OR DECK ROOF DRAIN




FIG. 5 BOTTOM OUTLET

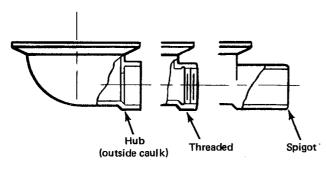


FIG. 6 SIDE OUTLET




FIG. 7 45 DEG. SIDE OUTLET

4 OUTLET TYPES AND CONNECTIONS

4.1 Outlet Types

- **4.1.1 Bottom Outlet.** Threaded, inside caulk or spigot with centerline of outlet vertical. See Fig. 5.
- **4.1.2 Side Outlet.** Threaded, hub (outside caulk), or spigot with centerline of outlet horizontal. See Fig. 6.
- **4.1.3 45 Deg. Side Outlet.** Threaded with centerline of outlet at a 45 deg. angle. See Fig. 7.

4.2 Outlet Connections

- 4.2.1 Threaded. All threaded outlet connections shall comply with ANSI B2.1-1968, Pipe Threads (Except Dryseal) and shall conform to the minimum dimensions shown in Table 1.
- 4.2.2 Inside Caulk. All inside caulk outlet connections shall conform to the minimum dimensions shown in Table 2.
- 4.2.3 Hub (Outside Caulk). All hub outlet connections shall conform to the minimum dimensions shown in Table 3.
- 4.2.4 Spigot. All spigot outlet connections shall conform to the spigot end dimensions shown in American National Standard for Cast Iron Soil Pipe and Fittings, ANSI A112.5.1-1973, and the Cast Iron Soil Pipe Institute Standard No. 301-1978, Cast Iron Soil Pipe and Fittings for Hubless Cast Iron Sanitary Systems.
- **4.2.5 Tolerances.** All dimensions given in Tables 1, 2, and 3 and the associated figures are subject to standard commercial tolerances of $\pm 1/16$ in. (± 1.6 mm).

5 TOP SIZE - DOME OR GRATE FREE AREA

The roof drains covered by this Standard shall comply with the minimum requirements in Tables 4 through 7.


6 MATERIALS

The items covered in this Standard are to be of the material specified, suitable for installation and service

AMERICAN NATIONAL STANDARD ROOF DRAINS

ANSI A112.21.2M-1983

TABLE 1 MINIMUM DIMENSIONS FOR THREADED OUTLET CONNECTIONS

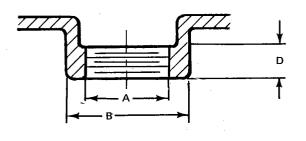

Nominal Pipe	A NPT	В		D	
Size, in.	in.	in.	mm	in.	mm
1 1/2	1 1/2	2 5/16	59	7/16	11
2	2	2 7/8	73	7/16	11
2 1/2	2 1/2	3 3/8	86	5/8	16
3	3	4 1/8	105	3/4	19
4	- 4	5 1/8	130	13/16	21
5	. 5	6 1/4	159	7/8	22
6	6	7 1/4	184	1	25

2 in. (51 mm) 7/32 in. (5.6 mm)

TABLE 2 MINIMUM DIMENSIONS FOR INSIDE CAULK OUTLET CONNECTIONS

Nominal	Α		В	
Pipe Size, in.	in.	mm	in.	mm
2 .	2 1/2	- 64	3	76
3	3 5/8	92	4 1/8	105
4	4 5/8	117	5 1/8	130
5	5 5/8	143	6 1/8	156
6	6 5/8	168	7 1/8	181




TABLE 3 MINIMUM DIMENSIONS FOR HUB OUTLET CONNECTIONS

Nominal		Δ.	В	
Pipe Size, in.	in.	mm	in.	mm
2	2	51	3	76
3	3	76	4 1/8	105
4 .	4	102	5 1/8	130
5	5	127	6 1/8	156
6	6	152	7 1/8	181

AMERICAN NATIONAL STANDARD ROOF DRAINS

ANSI A112,21,2M-1983

TABLE 4 GENERAL PURPOSE ROOF DRAIN

Outlet Nominal Size		Flange Diameter		Dome Free Area	
in.	mm	in.	mm	in. ²	cm ²
2	51	8	203	18	116
3	76	12	305	25	161
4	102	15	381	36	232
5	127	15	381	50	323
6	152	15	381	70	452

TABLE 6 PARAPET ROOF DRAIN

Outlet Nominal Size		т	Top Size		Grate Free Area	
in.	mm	in.	mm	in. ²	cm ²	
2	51	4½ × 4½ × 11	114 × 114 × 279	20	129	
3	76	4½ x 4½ x 11	114 x 114 x 279	20	129	
4	102	4½ x 4½ x 11	114 x 114 x 279	20	129	

TABLE 7 PROMENADE OR DECK ROOF DRAIN

TABLE 5 GUTTER OR CORNICE ROOF DRAIN

Outlet Nominal Size		Flange Diameter		Dome Free Area	
in.	mm	in.	mm	in. ²	cm ²
2	51	6	152	11	71
3	76	6	152	11	71

Outlet Nominal Size		inal		Grate Free Area	
in.	mm	in.	mm	in. ²	cm ²
2	51	8 x 8	203 x 203	9	58
3	76	11 x 11	279 x 279	21	135
4	102	13 x 13	330 x 330	32	206

in the place specified, and shall meet all applicable requirements and standards given herein. The castings for these drains shall be sound, free of blow holes, cold shuts and other imperfections, and shall be of uniform wall thickness and true to pattern. They shall also be clean and free of fins. It is not the intent of this Standard to limit acceptable materials to those included in this Section. It anticipates the use of other materials of comparable performance.

6.1 Cast Iron

Castings shall conform to ASTM Specification for Grey Iron Castings A 48-76, Class 25.

6.2 Leaded Red and Semi-Red Brass

Castings shall conform to the chemical and mechanical requirements of ASTM B 584-82 for Copper Alloy Nos. C83600, C83800 and C84400.

6.3 Leaded Nickel Bronze (Nickel Silver)

Castings shall conform to the chemical and mechanical requirements of ASTM B 584-82 for Copper Alloy Nos. C97300 and C97600.

6.4 Bolting Materials, Steel

The materials for studs, nuts, cap screws, and other steel fasteners shall at least equal the requirements of ASTM Specifications A 307-80, Carbon Steel Externally Threaded Fasteners, Grade A, and A 563-80, Carbon and Alloy Steel Nuts, Grade A. Threads shall be Classes 2A and 2B, and shall be plated.

7 FINISHES

In all cases where parts are to be coated or plated, they shall be pickled as required and cleaned to provide suitable surface for proper bonding of the finish.

7.1 Paint Coatings

Iron castings shall be cleaned and coated with a suitable paint, lacquer or synthetic coating of quality to provide protection against rusting of ferrous surfaces during normal handling and warehousing prior to installation.

AMERICAN NATIONAL STANDARD ROOF DRAINS

ANSI A112,21,2M-1983

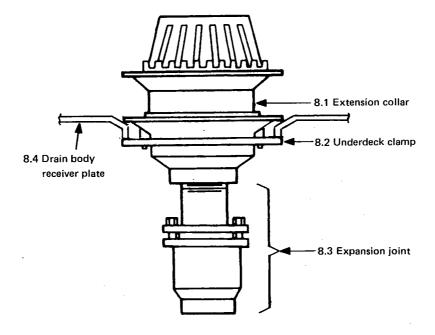


FIG. 8 ACCESSORIES FOR DRAINS

7.2 Cadmium Plate

After preplating cleaning, parts shall be given a Commercial Grade Cadmium Plate.

7.3 Chrome Plate Decorative

Parts shall be polished prior to plating and then given a Copper — Nickel Chromium Plate.

7.4 Bronze Chromate

Parts shall first be given a Commercial Grade Cadmium Plate and then a Commercial Grade Bronze Chromate treatment.

7.5 Zinc Plate

After preplating cleaning, parts shall be given a Commercial Grade Zinc Plate.

8 ACCESSORIES

The optional features listed are stated here to identify the variations available for different applications. See Fig. 8.

8.1 Extension Collar

An accessory particularly suitable for use with roof drains installed in a structural deck where an additional thickness of insulation is to be added in order to raise the top flange to the roof line.

8.2 Underdeck Clamp

An accessory to secure the roof drain to roof deck by compressing the underdeck clamp against the underside of the deck.

8.3 Expansion Joint

An accessory to compensate for the expansion or movement of the conductor or roof.

8.4 Drain Body Receiver Plate

A device which receives and uniformly supports the roof drain, distributing the weight of the drain over a large area of the roof.

7