



# Standard Test Method for Evaluating Bond of Individual Steel Wire, Indented or Plain, for Concrete Reinforcement<sup>1</sup>

This standard is issued under the fixed designation A1096/A1096M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope

1.1 This test method describes procedures for evaluating bond of individual steel wire, indented or plain, for concrete reinforcement. The bond determined by this test method is stated as the tensile force needed to pull the wire through the cured mortar in a cylindrical steel casing.

1.2 The result of the test is the maximum tensile force measured on the loaded end of the wire recorded at a free-end slip less than or equal to 0.10 in. [2.5 mm].

1.3 *Units*—The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.4 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

## 2. Referenced Documents

### 2.1 ASTM Standards:<sup>2</sup>

A421/A421M Specification for Stress-Relieved Steel Wire for Prestressed Concrete

A881/A881M Specification for Steel Wire, Indented, Low-Relaxation for Prestressed Concrete

C109/C109M Test Method for Compressive Strength of Hydraulic Cement Mortars (Using 2-in. or [50-mm] Cube Specimens)

C150/C150M Specification for Portland Cement

C192/C192M Practice for Making and Curing Concrete Test Specimens in the Laboratory

C511 Specification for Mixing Rooms, Moist Cabinets, Moist Rooms, and Water Storage Tanks Used in the Testing of Hydraulic Cements and Concretes

C778 Specification for Standard Sand

## 3. Terminology

### 3.1 Definitions:

3.1.1 *bond, n*—longitudinal components of adhesion, friction, and mechanical interlock between wire and mortar or concrete.

3.1.2 *bond breaker, n*—product wrapped around wire to prevent wire-to-mortar bond over a certain length.

3.1.2.1 *Discussion*—Duct tape is commonly used for this purpose.

3.1.3 *mortar, n*—mixture of cement, fine aggregate, and water.

3.1.4 *test specimen, n*—assembly consisting of one steel casing, one sample of wire, and mortar.

## 4. Summary of Test Method

4.1 Six samples of 0.2 – 0.3 in. [5 – 8 mm] diameter (see **Note 1**) steel wire are selected from a single continuous length for testing. Each wire sample is cast into a steel casing with a bonded length of 6 in. [150 mm].

4.2 A mortar mixture, including the fine aggregate source, is prescribed, but the cement source is not.

4.3 Testing of the six specimens begins shortly after the mortar-cube compressive strength reaches 4500 psi [31.0 MPa] and ends before the strength reaches 5000 psi [34.5 MPa]. A specified, force-controlled loading rate is applied at the bottom of the wire while the applied load and free-end slip at the opposite (top) end is continuously monitored and recorded. The maximum pullout force occurring at an end slip less than or equal to 0.10 in. [2.5 mm] is recorded as the “test result.” One complete test is comprised of the average of these six specimens.

**NOTE 1**—This test method was developed specifically to correlate pullout values with transfer lengths for 0.208 in. [5.28 mm] diameter steel wire conforming to Specification A881/A881M for prestressed concrete

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee A01 on Steel, Stainless Steel and Related Alloys and is the direct responsibility of Subcommittee A01.05 on Steel Reinforcement.

Current edition approved Dec. 1, 2015. Published January 2016. DOI: 10.1520/A1096\_A1096M-15.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.



railroad ties but may be modified or adapted to accommodate smaller or larger wire sizes and in prestressing or other non-prestressed concrete reinforcement applications.

## 5. Significance and Use

5.1 Steel wire for concrete reinforcement is used in various applications wherein the wire is expected to transfer passive or prestressing forces to the structural member via the bond of the exposed wire surfaces to the surrounding concrete.

5.2 Wire manufacturing processes, subsequent handling, and storage conditions can influence the wire bond.

5.3 Steel wire for concrete reinforcement is used in construction applications with a variety of concrete mixtures.

Developing test methods and threshold values for the performance of the wire in each of these unique mixtures is impractical.

## 6. Apparatus

6.1 A position transducer having a minimum precision of 0.001 in. [0.025 mm] is used.

6.2 A tensile testing machine is used with the following functionality:

6.2.1 Force-controlled loading rate;

6.2.2 *Gripping Device without Torsional Restraint*—This may be accomplished by providing a thrust bearing to allow rotation; other similar methods may be used (see **Note 2**).



FIG. 1 Photo of Pullout Test Frame and Specimen as the Test is Being Conducted



**6.2.3 Rigid Testing Frame**—An example of the frame used for conducting the test is shown in Fig. 1. Other similar test frame setups may be used.

NOTE 2—This test method was developed without torsional restraint. In the case of some particular wire geometries (for instance, helical-deformed wire), wire behavior during test method development indicated a tendency for the frame to rotate.

## 7. Wire Sampling

7.1 The wire shall conform to Specifications A421/A421M or A881/A881M.

7.2 Samples of wire approximately 20 in. [500 mm] long shall be taken from the same coil or reelless pack of wire. The wire shall be cut to have flat ends. A minimum of six wire samples are required.

## 8. Mortar Requirements

### 8.1 Materials:

8.1.1 **Sand**—The sand shall be silica sand from the Ottawa, Illinois region and shall be Graded Sand conforming to Specification C778.

8.1.2 **Cement**—The cement shall conform to Specification C150/C150M requirements for Type III cement.

8.1.3 **Water**—The water shall be potable.

8.1.4 **Admixtures**—Admixtures shall not be used.

8.1.5 **Aggregates**—No aggregates other than sand as specified in 8.1.1 shall be used.

8.2 **Mixing Procedure**—The mixing procedure shall conform to Practice C192/C192M except no coarse aggregates or admixtures are allowed.

8.3 **Strength**—Mortar strength shall be evaluated according to Test Method C109/C109M using 2 in. [50 mm] mortar cubes. Brass molds shall be used. Testing of the pullout specimens should begin as soon as practical after the 2 in. [50 mm] mortar cube compressive strength reaches 4500 psi [31.0 MPa]. This mortar strength is defined as the average compressive strength of at least two individual 2 in. [50 mm] mortar cubes. If the mortar strength exceeds 5000 psi [34.5 MPa] before the end of the test, then the test shall be considered invalid and shall be repeated.

NOTE 3—Practice C192/C192M is described as a standard practice to be used for concrete test specimens. As outlined in 8.1, only fine aggregates (that is, sand) are included in the mixture along with cement and water. Because coarse aggregates are not included, this mixture is defined as “mortar” and not “concrete.” Aside from this difference and a few other exceptions noted in Section 8, the practices documented in Practice C192/C192M are to be applied when making the mortar used in this test method.

### 8.4 Mixture Proportions:

8.4.1 The mixture proportions and batch weights listed in Table 1 shall be used (Note 4).

**TABLE 1 Recommended Batch Weight**

Material	Proportional Weight
C150/C150M Type III Cement	1.0
C778 Ottawa Sand (Oven-Dry)	2.0
Water	0.425

NOTE 4—In Table 1, a mortar with a water-to-cement ratio (w/c) of 0.425 and an oven-dry sand-to-cement (s/c) ratio of 2.0 is shown.

## 9. Preparation of Test Specimens

### 9.1 Materials:

9.1.1 **Wire Samples**—Requirements as defined in Section 7.

9.1.2 **Mortar**—Requirements as defined in Section 8.

9.1.3 **Bottom Bond Breaker**—A 1.0-in. [25-mm] wide  $\pm$  0.125-in. [3.0-mm] strip of woven cloth adhesive tape (duct tape) shall be used as a bottom bond breaker. The length of bond breaker should not be less than 5 in. [130 mm] before application. Wrap the bond breaker around the wire snugly.


9.1.4 **Top Bond Breaker**—Use a 2.0-in. [50-mm] wide  $\pm$  0.125-in. [3.0-mm] strip of woven adhesive cloth (duct tape) as a top bond breaker. The length of bond breaker should not be less than 3.0 in. [75 mm] before application. Wrap the bond breaker around the wire snugly. The top bond breaker extends below the top mortar surface approximately 1.0 in. [25 mm] to ensure the actual bond length desired in case of settlement. The distance between the top and bottom bond breaker (embedment length) is maintained at  $6.0 \pm 0.0625$  in. [ $150 \pm 1.6$  mm].

9.1.5 **Steel Casing**—Each individual wire sample shall be cast in a 4 in. [100 mm] outer diameter steel tube, approximately  $\frac{1}{8}$  in. [3 mm] wall thickness (11 gauge), and a total length of 8 in. [200 mm]. A 6.0 in.  $\times$  6.0 in.  $\times$   $\frac{3}{16}$  in. [150 mm  $\times$  150 mm  $\times$  5 mm] thick steel plate is tack welded to the bottom of the tube. The remaining contact surface between the tube and plate shall be caulked to prevent any leakage of mortar during filling and curing. A schematic of the wire pullout specimen is shown in Fig. 2. The bottom plate shall have a center-drilled hole using the smallest standard  $\frac{1}{32}$ -in. [0.8-mm] drill bit to allow the wire to freely pass through the hole.

9.2 **Specimen Assembly**—Each wire sample shall be cast into a steel casing in the vertical position. The wires shall be held centered (concentrically  $\pm \frac{1}{8}$  in. [ $\pm 3$  mm]) in the steel casing using an additional fixture and reinforcing bar tie wire. The fixture shall be able to prevent movement of the wire during the consolidation process. The additional fixture shall be removed after the mortar has cured and before testing. An example of a fixture used to secure the wire at the center of the steel casing is shown in Fig. 3.

9.3 **Consolidation**—The pullout specimens shall be filled in two approximately equal lifts and consolidated using internal vibration (approximately five seconds total) between each lift. The first lift shall be approximately 50 % and the second lift approximately 40 %. The remaining 10 % of mortar shall be added and smoothed using a hand trowel.

9.4 **Curing**—The pullout test specimens shall be cured so that the relative humidity of the exposed top surface is greater than or equal to 95 % for the duration of curing. The 2 in. [50 mm] mortar cubes shall be cured at a minimum of 95 % relative humidity. The specimens and cubes shall be cured in a temperature and humidity controlled room maintained at a temperature of  $73.5 \pm 3.5^\circ\text{F}$  [ $23 \pm 1.9^\circ\text{C}$ ] (see Note 5). The test specimens shall be cured in an environment free of vibrations.

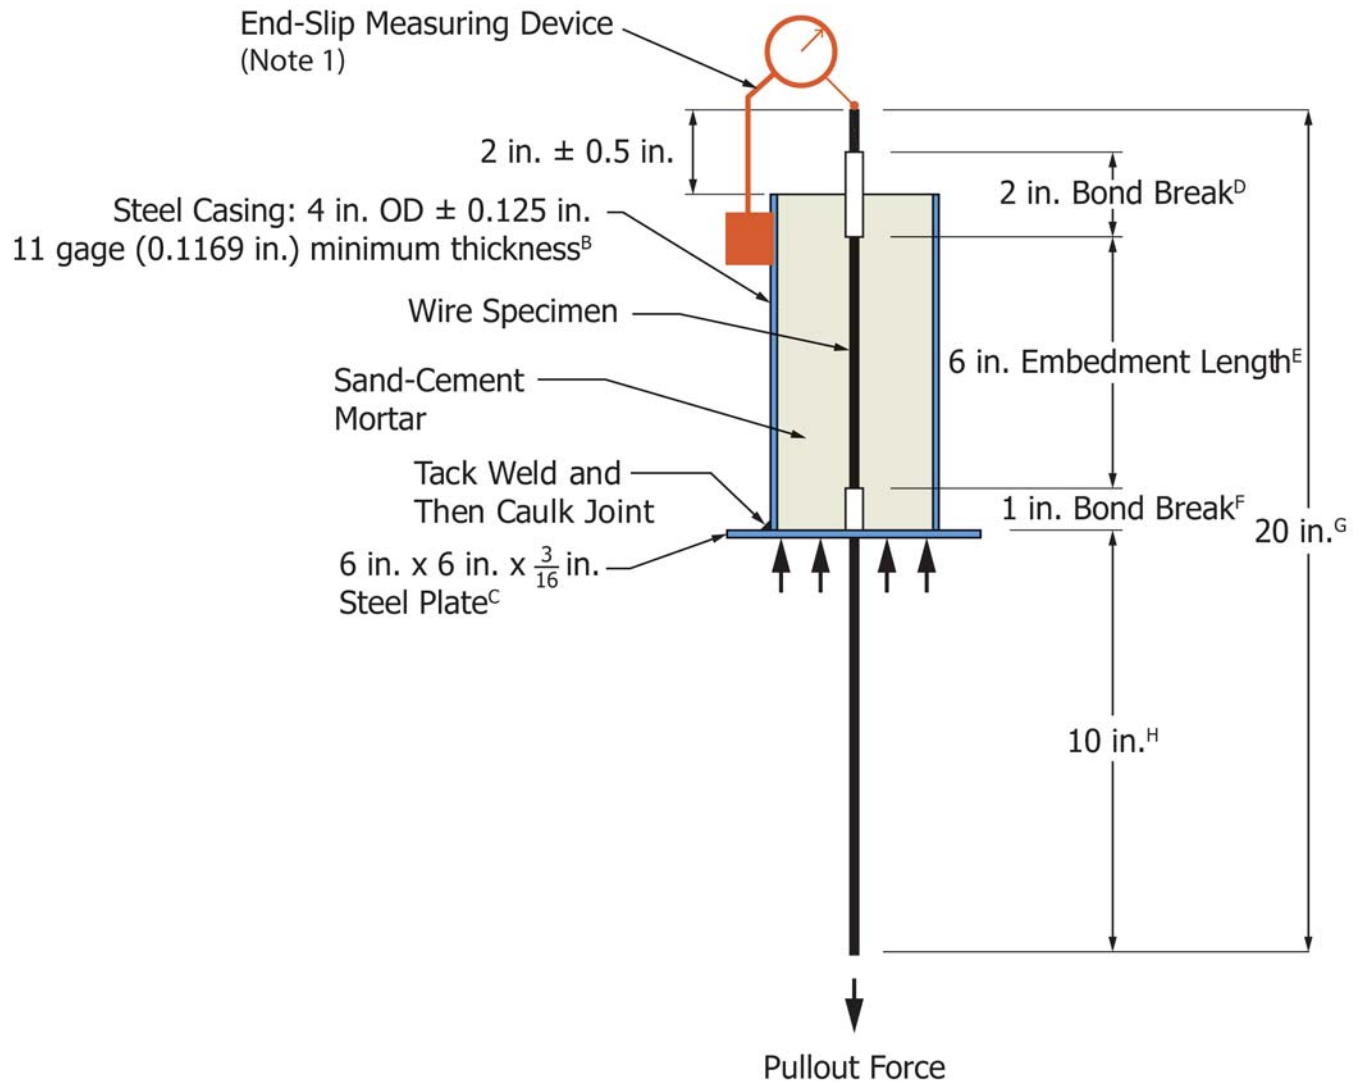

NOTE 1—The ‘End Slip Measurement’ apparatus shown here is an example of one type of measurement set-up. Other configurations and devices may be used.

- A SI equivalent: 51 mm  $\pm$  13 mm
- B SI equivalent: 102 mm  $\pm$  3 mm (OD)  $\times$  3 mm min (wall thickness)
- C SI equivalent: 152 mm  $\times$  152 mm  $\times$  4.8 mm
- D  $\pm$  0.25 in.  
SI equivalent: 51 mm  $\pm$  6.4 mm
- E  $\pm$  0.063 in.  
SI equivalent: 152.4 mm  $\pm$  1.6 mm
- F  $\pm$  0.036 in.  
SI equivalent: 25.4 mm  $\pm$  1.6 mm
- G + 10 in. / – 0 in.  
SI equivalent: 508 mm + 254 mm / – 0 mm
- H SI equivalent: 203 mm  $\pm$  3.2 mm

FIG. 2 Schematic of Wire Pullout Test Specimen

NOTE 5—These parameters may be met with the use of a moist room or closet, as in Specification C511, or through other suitable means.

## 10. Test Setup

10.1 *Test Frame*—The specimens shall be tested in a frame as described in Section 6. A photo of the test frame used is shown in Fig. 1. Other similar test frames may be used.

10.2 *Free-End Slip Measurement*—A position transducer, generally a linear variable differential transformer (LVDT), shall be installed to measure the free-end slip of the wire relative to the hardened mortar surface. The position transducer shall be centered on the wire. A picture of a typical test setup is shown in Fig. 4.





FIG. 3 Example of Fixture Used to Keep Wire Centered in Steel Casing During Mortar Placement and Consolidation

10.3 *Wire Gripping*—The wire shall be gripped by a chucking device. The free length between the bottom of the plate of the steel casing and the top of the chucking device shall be a minimum of 7.0 in. [180 mm]. The test shall be free from torsional restraint.

## 11. Procedure

11.1 *Test Start*—The test specimens shall be removed from the temperature and humidity controlled environment, and testing may begin once the compressive strength of the mortar reaches 4500 psi [31.0 MPa] as evaluated by the 2 in. [50 mm] mortar cubes. This mortar strength is defined as the average compressive strength of at least two individual 2 in. [50 mm] mortar cubes.

11.2 *Mortar Strength*—The compressive strength of the mortar shall be determined at the beginning of the test and the end of the test.

11.3 *Force Rate*—Load shall be applied to the wire by displacement of the chucking device. A force-controlled rate of  $2000 \pm 100$  lbf/min [ $8900 \pm 450$  N/min] shall be maintained after the chuck has been initially seated.

11.4 *Test Result*—The maximum pullout force occurring at an end slip less than or equal to 0.10 in. [2.5 mm] shall be recorded. This force shall be rounded to the nearest 10 lbf [50 N].

11.5 *Acceptance of Test Result*—If the mortar exhibits cracking visible to a person with normal or corrected vision in



FIG. 4 LVDT and Magnetic Base Setup

two or more of the six test specimens, the entire batch of six specimens shall be discarded and new specimens prepared. If the mortar exhibits cracking visible to a person with normal or corrected vision in one of the six test specimens, that shall be reported.

## 12. Report

12.1 The following items shall be reported:

- 12.1.1 Specification the wire was produced to.
- 12.1.2 Identification of the wire tested (that is, coil number).
- 12.1.3 Wire manufacturer.
- 12.1.4 Date of original wire manufacture.
- 12.1.5 Location of original wire manufacture.

12.1.6 Dates of test.

12.1.7 Wire diameter.

12.1.8 Indentation type.

12.1.9 Specified wire tensile strength.

12.1.10 Six individual test results.

12.1.11 Average test results.

12.1.12 Batch weights and origin of constituent materials.

12.1.13 *Date and Time of Batching*—Batching time is reported as the time the mixing of the mortar is completed, rounded to the nearest 5 minutes.

12.1.14 Mortar temperature at the time mixing of the mortar is completed.



12.1.15 *Individual Mortar Cube Compressive Strengths and Times Performed*—Time performed is reported as the time load is first applied to the specimen, rounded to the nearest 5 minutes.

12.1.16 Average compressive strengths of the mortar at the start and at the end of testing.

12.1.17 Any visible mortar cracking, if applicable.

12.1.18 *Date and Time at Start and End of Testing*—Start time is recorded as the time loading is applied to the first specimen. End of testing is recorded as the time the last specimen reaches a free end displacement of 0.10 in. [2.5 mm], rounded to the nearest 5 minutes.

### **13. Precision and Bias**

13.1 *Precision*—No statement is made on the precision of this test method since the test results indicate only whether

there is conformance to given criteria and no generally accepted method for determining precision of this test method is currently available. General guidelines provided herein for the specimens, instrumentation, and procedures make the results intractable to calculation of meaningful values by statistical analysis for precision at this time.

13.2 *Bias*—Since there is no accepted reference material suitable for determining the bias in this test method, no statement on bias is made.

### **14. Keywords**

14.1 bond; maximum tensile force; steel prestressing wire; steel wire for concrete reinforcement

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; <http://www.copyright.com/>*