



Standard Specification for Heat-Strengthened and Fully Tempered Flat Glass¹

This standard is issued under the fixed designation C1048; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the U.S. Department of Defense.

ε¹ NOTE—Section 9 was updated editorially in November 2012.

1. Scope

1.1 This specification covers the requirements for monolithic flat heat-strengthened and fully tempered coated and uncoated glass produced on a horizontal tempering system used in general building construction and other applications.

1.2 This specification does not address bent glass, or heat-strengthened or fully tempered glass manufactured on a vertical tempering system.

1.3 The dimensional values stated in SI units are to be regarded as the standard. The units given in parentheses are for information only.

1.4 The following safety hazards caveat pertains only to the test method portion, Section 10, of this specification: *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 *ASTM Standards:*^{2, 3}

C162 Terminology of Glass and Glass Products

C346 Test Method for 45-deg Specular Gloss of Ceramic Materials

C724 Test Method for Acid Resistance of Ceramic Decorations on Architectural-Type Glass

C978 Test Method for Photoelastic Determination of Residual Stress in a Transparent Glass Matrix Using a

Polarizing Microscope and Optical Retardation Compensation Procedures

C1036 Specification for Flat Glass

C1203 Test Method for Quantitative Determination of Alkali Resistance of a Ceramic-Glass Enamel

C1279 Test Method for Non-Destructive Photoelastic Measurement of Edge and Surface Stresses in Annealed, Heat-Strengthened, and Fully Tempered Flat Glass

C1376 Specification for Pyrolytic and Vacuum Deposition Coatings on Flat Glass

E1300 Practice for Determining Load Resistance of Glass in Buildings

2.2 *ANSI Standard:*

Z97.1 Safety Performance Specifications and Methods of Test for Safety Glazing Materials Used in Buildings⁴

2.3 *Other Documents:*

CPSC 16 CFR 1201 Safety Standard for Architectural Glazing Materials⁵

3. Terminology

3.1 *Definitions*—For definitions of terms used in this specification, refer to Terminology C162 and Specification C1036.

3.2 *Definitions of Terms Specific to This Standard:*

3.2.1 *bow, n*—the deviation in flatness of a lite of glass, expressed over the entire width or length dimension of the glass or over a smaller, local area (see 10.7 for measurement technique). Also known as *warp*.

3.2.2 *heat-treated glass, n*—a term used to reference both heat-strengthened and fully tempered glass.

3.2.3 *heat-treating, v*—the process of heating and cooling annealed glass in a tempering system to produce either heat-strengthened or fully tempered glass.

¹ This specification is under the jurisdiction of ASTM Committee C14 on Glass and Glass Products and is the direct responsibility of Subcommittee C14.08 on Flat Glass.

Current edition approved March 15, 2012. Published May 2012. Originally approved in 1985. Last previous edition approved in 2004 as C1048 – 04. DOI: 10.1520/C1048-12E01.

² Reference to these documents shall be the latest issue unless otherwise specified by the authority applying this specification.

³ For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

⁴ Available from American National Standards Institute, 25 W. 43rd St., 4th Floor, New York, NY 10036, and the Accredited Standards Committee Z97 website in electronic format at www.ansiz97.com.

⁵ Available from Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402.

3.2.4 *thermal stress, n*—edge stress caused by thermal gradients across the glass surface.

4. Classification

4.1 *Kinds*—Flat glass furnished under this specification shall be of the following kinds, as specified (see Section 6):

4.1.1 *Kind HS*—Heat-strengthened glass shall be flat glass, either transparent or patterned, in accordance with the applicable requirements of Specification C1036 as further processed to conform with the requirements hereinafter specified for heat-strengthened glass.

4.1.2 *Kind FT*—Fully tempered glass shall be flat glass, either transparent or patterned in accordance with the applicable requirements of Specification C1036 as further processed to conform with the requirements hereinafter specified for fully tempered glass.

4.2 *Conditions*—Glass furnished under this specification shall be of the following conditions, as specified (see Section 6):

4.2.1 *Condition A*—Uncoated surfaces.

4.2.2 *Condition B*—Fully or partially ceramic coated glass. (See 8.3.)

4.2.3 *Condition C*—Other coated glass. (See 8.4.)

4.3 *Types, Classes, Forms, Qualities, and Finishes*—these are described in Specification C1036.

5. Intended Use

5.1 *Kind HS*—Heat-strengthened glass is used as architectural glazing when additional resistance to wind pressure or thermal stress, or both, is desired, but the strength or safety break pattern of fully tempered glass is not required. When broken, heat-strengthened glass fragments are more similar in size and shape to annealed glass fragments than to fully tempered glass particles, and thus tend to stay in the opening longer than fully tempered glass particles.

NOTE 1—**Caution:** Monolithic heat-strengthened glass is not suitable for safety glazing as defined by ANSI Z97.1 or CPSC 16 CFR 1201.

5.2 *Kind FT*—Fully tempered glass is used in architectural glazing applications when significant additional strength is needed to resist wind pressure or thermal stress, or both. When broken, fully tempered glass fractures (dices) into relatively small particles. Fully tempered glass with sufficient surface compression to meet the requirements of safety glazing standard CPSC 16 CFR 1201 or ANSI Z97.1, or both, is considered a safety glass because it fractures into relatively small pieces thereby greatly reducing the likelihood of serious cutting or piercing injuries in comparison to ordinary annealed glass. For some applications, such as doors used for passage, tub and shower enclosures and fixed glass in close proximity to a walking surface, fully tempered safety glass is required by building codes and ordinances. Fully tempered safety glass is often used for other applications where its strength or safety characteristics, or both, are desirable such as table tops, counter tops, show case enclosures, refrigeration and food service equipment, furniture, and similar applications.

6. Ordering Information

6.1 Purchasers should select the preferred options permitted in this specification and include the following information in procurement documents:

6.1.1 Number, date, and title of this specification.

6.1.2 Kind, condition, type, class, style, form, quality, finish, and pattern of glass as applicable (see Section 4).

6.1.3 Fabrication requirements (see 7.1).

6.1.4 Requirements for fittings and hardware (see 7.2).

6.1.5 Custom design or texture required (see 7.7).

6.1.6 Glass thickness (see 9.1).

6.1.7 Pattern-cut glass must be within the tolerances specified (see 9.3).

6.1.8 When surface or edge compression test is required for heat-strengthened or fully tempered glass (see 8.1.1).

6.1.9 When break safe characteristics are required for fully tempered glass (see 8.1.2).

6.1.10 Color or tint of glass (see 8.2).

6.1.11 When either permanent or temporary identification marking is required (see Section 11).

6.1.12 Surface treatment or coatings for Condition B and Condition C glass (see 8.3 and 8.4).

6.1.13 When addition of fallout resistance capability is required for Condition A, Condition B, or Condition C glasses used as spandrels. (Normally achieved by adhering a reinforcing material to the glass surface.) (See 10.3.)

7. Fabrication

7.1 *Fabrication*—All fabrication, such as cutting to overall dimensions, edgework, drilled holes, notching, grinding, sandblasting, and etching, shall be performed before heat-strengthening or tempering and shall be as specified (see Section 6 and 7.8). After the glass has been heat-strengthened or tempered, it shall not be modified except as recommended by the fabricator; for example, some Condition C coatings. No modification shall be made that will affect its structural characteristics or integrity as specified in this standard.

7.2 *Fittings and Hardware*—Requirements for fittings and hardware shall be as specified (see Section 6) or as shown on plans or drawings. Fittings and hardware specified shall be compatible with glass fabrication limitations.

7.3 *Distortion:*

7.3.1 Heat-strengthened and fully tempered glass is made by heating annealed glass in a tempering system to a temperature at which the glass becomes slightly plastic. Immediately after heating, the glass surfaces are rapidly cooled by quenching with air. The original flatness of the glass is slightly modified by the process, causing reflected images to be distorted. When viewing images through the glass, the distortion, in most glazing applications, is less than that of reflected images.

7.3.2 Heat-strengthened and fully tempered glass that has been produced in a horizontal tempering system may contain surface distortion (for example, picture framing, heat distortion or roller wave distortion). Distortion may be detected when viewing images reflected from the glass surface.

7.3.3 Pressures exerted around the periphery of glass by the glazing system can also alter glass flatness, thereby distorting reflected images. This is true regardless of whether the glass is annealed, heat-strengthened, or fully tempered.

7.3.4 Sealed insulating glass units also exhibit distortion regardless of glass type. Air or other gas, sealed in the gap between the lites of glass, expands or contracts with temperature and barometric changes, creating a pressure differential between the sealed gap and the atmosphere. The glass reacts to the pressure differential by being deflected inward or outward.

7.3.5 Regardless of glass flatness, the degree of reflected distortion perceived is largely due to the characteristics or symmetry of the object being reflected. Linear objects (such as building curtain walls and telephone poles) and moving objects (such as cars) may appear distorted. Irregular and free-form objects such as trees and clouds may appear to have less perceived distortion.

7.3.6 Specified bow limits may not adequately define, or control, the distortion that may become apparent after glazing. The factors, noted above, may have a larger influence on the perceived reflected distortion than that which is caused by bow from the heat-treating process. Consultation with suppliers and the viewing of full-size mock-ups, under typical job conditions and surroundings, is highly recommended for evaluation of reflective distortion.

7.4 *Strain Pattern*—A strain pattern, also known as iridescence, is inherent in all heat-strengthened and fully tempered glass. This strain pattern may become visible under certain lighting and other conditions. It is a characteristic of heat-treated glass and should not be mistaken as discoloration, non-uniform tint or color, or a defect in the glass. The strain pattern does not affect any physical properties or performance values of the glass.

7.5 *Surface Particles*—The production of heat-strengthened and fully tempered glass involves the transport of very hot glass on conveyor rollers. As a result of this soft glass-to-roller contact, some glass surface changes will occur. Minute particles (fines), typically invisible to the naked eye, may adhere to one or both glass surfaces. These surface particles may occur from a variety of sources including, but not limited to, the glass cutting and edging process, typical manufacturing plant airborne debris or dust, refractory particles from the furnace roof, and external airborne dirt and grit carried into the plant by the large volumes of quench air used in the process. Particles on the furnace rollers may be picked up by the hot bottom surface of the glass as it travels over the particles. Surface particles invisible to the naked eye are inherent in the heat-treating process and are not a cause for rejection.

7.6 *Resistance to Wind Load*—The support system and the amount of glass deflection for a given set of wind-load conditions shall be considered for design purposes. Consult the manufacturer to determine the appropriate thickness of heat-strengthened or fully tempered glass needed to satisfy the design wind load and probability of breakage design factor for the required glass in accordance with Practice E1300.

7.7 *Special Surfaces, Types I or II*—Custom designs or textures shall be as specified (see 6.1.5) or as shown on plans or drawings.

7.8 *Fabrication Guidelines*—Heat-strengthened and fully tempered flat glass cannot be cut after the heat-treating process. Fabrication altering the glass surface, thickness, or edges shall be performed before heat-treating to avoid a reduction of glass strength.

7.8.1 Heat-strengthened and fully tempered glass can be furnished with holes, notches, cutouts, and bevels. Fabrication involving other methods of modification should be discussed with the fabricator/manufacturer.

7.8.2 *Placement of Holes:*

7.8.2.1 The minimum distance from any edge of the glass to the nearest point on the rim of a hole shall be 6 mm (¼ in.) or 2 times the thickness of the glass, whichever is greater (see Fig. 1).

7.8.2.2 The minimum distance between the rims of adjoining holes shall be 10 mm (⅜ in.) or 2 times the thickness of glass, whichever is greater (see Fig. 1).

7.8.2.3 Holes near corners shall be located so that the nearest edge of the hole is a minimum of 6.5 times the thickness of the glass from the tip of the corner when the corner is 90° or more (see Fig. 2).

7.8.3 *Minimum Dimension of Holes*—Circular holes shall have a minimum diameter of 6 mm (¼ in.) or the thickness of the glass, whichever is greater. In other than circular holes, any corners shall have fillets, the radius of which shall be equal to or greater than the thickness of the glass (see Fig. 3).

7.8.4 *Dimensional Tolerances of Holes:*

7.8.4.1 Tolerance of hole diameter shall be ± 1.6 mm (⅛ in.).


7.8.4.2 Tolerance for dimensions of hole center from specified edges shall be ± 1.6 mm (⅛ in.).

7.8.4.3 Tolerance for dimension between hole centers shall be ± 1.6 mm (⅛ in.).

7.8.5 Chips and flakes at hole edges shall not exceed 1.6 mm (⅛ in.).

7.8.6 *Notches and Cutouts:*

7.8.6.1 Notches and cutouts shall have fillets, the radius of which shall be equal to or greater than the thickness of the glass (see Fig. 4).

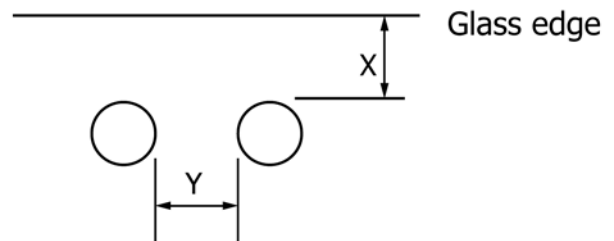

X = 6 mm (¼ in.) or 2t, whichever is greater

Y = 10 mm (⅜ in.) or 2t, whichever is greater


Where:

X = Minimum distance between glass edge and rim of nearest hole

Y = Minimum distance between rims of adjoining holes


t = Glass thickness

FIG. 1 Placement of Holes

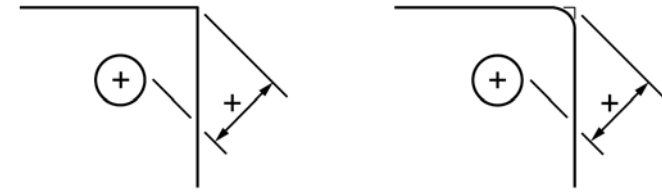


$X = 6.5t$
Where:
 X = Minimum distance between glass corner and rim of nearest hole
 t = Glass thickness

FIG. 2 Location of Holes Near Corners

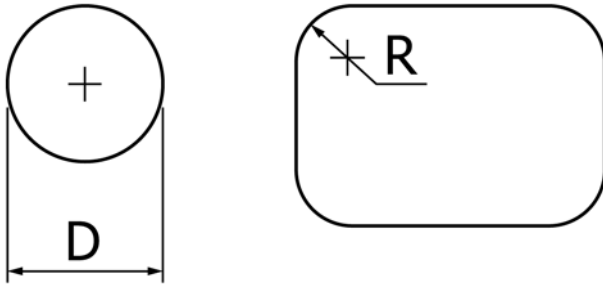

$D = 6 \text{ mm } (1/4 \text{ in.}) \text{ or } 1t, \text{ whichever is greater}$
 $R \geq t$
Where:
 D = Minimum diameter of a hole
 R = Radius
 t = Glass thickness

FIG. 3 Minimum Dimension of Holes

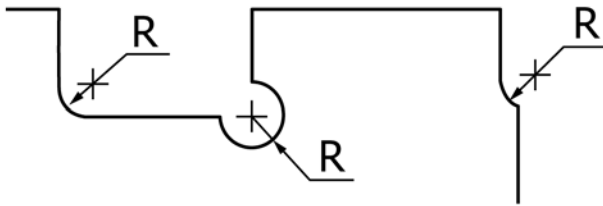

$R \geq t$
 t = thickness of glass
 R = radius
See paragraph 7.8.6.

FIG. 4 Notch and Cutout Fillets

7.8.6.2 Dimensional tolerance of notches and cutouts shall be:
 $\pm 1.6 \text{ mm } (1/16 \text{ in.})$ for glass thickness less than $12 \text{ mm } (1/2 \text{ in.})$.
 $\pm 3 \text{ mm } (1/8 \text{ in.})$ for glass thickness of $12 \text{ mm } (1/2 \text{ in.})$ and greater.

7.8.6.3 Inner surfaces of notches and cutouts shall be smooth, seamed, ground, or polished.

7.8.7 Consult manufacturer regarding heat-treatment of glass with irregular patterns, surface treatments, unusual edge work or any fabrication that falls outside these guidelines.

8. Other Requirements

8.1 Strength Requirements:

8.1.1 *Surface and Edge Compression Requirements* (see 10.8):

8.1.1.1 *Kind HS, Heat-Strengthened Glass*—Kind HS glass with thicknesses of $6 \text{ mm } (1/4 \text{ in.})$ and less shall have a surface compression between 24 to 52 MPa (3500 and 7500 psi).

Surface compression testing, when required (see 6.1.8), shall be done in accordance with 10.8.

NOTE 2—Heat-strengthening of glass thicker than $6 \text{ mm } (1/4 \text{ in.})$ can be difficult. Consult manufacturer.

8.1.1.2 *Kind FT, Fully Tempered Glass*—Fully tempered glass shall have either a minimum surface compression of 69 MPa (10 000 psi) or an edge compression of not less than 67 MPa (9700 psi) or meet ANSI Z97.1 or CPSC 16 CFR 1201 in accordance with 10.9. Surface compression or edge compression testing, when required (see 6.1.8), shall be done in accordance with 10.8.

8.1.2 *Break Test Requirement for Fully Tempered Glass*—When specified (see Section 6), the break requirements of fully tempered glass shall be tested and interpreted in accordance with 10.9.

8.2 *Color or Tint*—The color or tint for each kind, type, class, style, finish, or pattern shall be as specified in 6.1.10 and as follows:

8.2.1 *Tint*—Heat-absorbing glass and light-reducing glass are available in a variety of tints. These types of glass vary in tint between different manufacturers and from melt to melt so some variation in tint may occur.

8.2.2 *Color or Tint Samples*—The request and particular purpose of any color or tint sample shall be stated in the invitation for bid. Glass samples are often supplied as annealed glass. Heat-treating may alter the color of certain glass products. Color variation may exist between annealed and heat-treated versions of the same glass product.

8.3 *Condition B*—Fully or partially ceramic coated glass, shall be heat-strengthened or fully tempered glass having a ceramic coating of a specified color which has been fused onto and made an integral part of the surface of the glass as a result of the heat-strengthening or tempering process (see 6.1.12).

8.3.1 *Appearance*—When viewed in accordance with 10.10, scattered pinholes, screen marks, and small opaque particles in the ceramic coating are permissible.

8.4 *Condition C*—Other coated glass shall be heat-strengthened or fully tempered glass with a pyrolytic or vacuum deposition coating typically applied to affect characteristics such as solar heat gain, energy performance, comfort level, condensation and the aesthetics of the building (see Specification C1376).

9. Dimension Requirements

9.1 *Thickness*—Substrates for heat-strengthened and fully tempered glass shall be in accordance with the thickness requirements of Specification C1036 and as specified therein (see Section 6). Available sizes and thicknesses of heat-strengthened and fully tempered glass are subject to the processing limitations of each tempering system. All thicknesses are not available in all conditions, types, and classes. Consult manufacturers or fabricators.

9.2 *Tolerance, Length, and Width for Rectangular Shapes for Conditions A, B, and C Glass*—See requirements in Table 1.

TABLE 1 Length and Width Tolerances

Nominal Thickness Designation mm (in.)	Plus or minus mm, (in.)
3 (1/8)	1.6 (1/16)
4 (5/32)	1.6 (1/16)
5 (3/16)	1.6 (1/16)
6 (1/4)	1.6 (1/16)
8 (5/16)	2.0 (5/64)
10 (3/8)	2.4 (3/32)
12 (1/2)	3.2 (1/8)
16 (5/8)	4.0 (5/32)
19 (3/4)	4.8 (3/16)

TABLE 2 Overall Bow, Maximum

Nominal Thickness Designation mm (in.)	Edge Dimension, cm (in.)											
	0–50 (0–20)	>50–90 (>20–35)	>90–120 (>35–47)	>120–150 (>47–59)	>150–180 (>59–71)	>180–210 (>71–83)	>210–240 (>83–94)	>240–270 (>94–106)	>270–300 (>106–118)	>300–330 (>118–130)	>330–370 (>130–146)	>370–400 (>146–158)
	Maximum Bow, mm (in.)											
3 (1/8)	3.0 (0.12)	4.0 (0.16)	5.0 (0.20)	7.0 (0.28)	9.0 (0.35)	12.0 (0.47)	14.0 (0.55)	17.0 (0.67)	19.0 (0.75)
3 (1/8) Alternate Method ⁴	2.0 (0.08)	2.0 (0.08)	2.0 (0.08)	3.0 (0.12)	5.0 (0.20)	6.0 (0.24)	7.0 (0.28)	8.0 (0.31)	10.0 (0.39)
4 (5/32)	3.0 (0.12)	4.0 (0.16)	5.0 (0.20)	7.0 (0.28)	9.0 (0.35)	12.0 (0.47)	14.0 (0.55)	17.0 (0.67)	19.0 (0.75)
5 (3/16)	3.0 (0.12)	4.0 (0.16)	5.0 (0.20)	7.0 (0.28)	9.0 (0.35)	12.0 (0.47)	14.0 (0.55)	17.0 (0.67)	19.0 (0.75)
6 (1/4)	2.0 (0.08)	3.0 (0.12)	4.0 (0.16)	5.0 (0.20)	7.0 (0.28)	9.0 (0.35)	12.0 (0.47)	14.0 (0.55)	17.0 (0.67)	19.0 (0.75)	21.0 (0.83)	24.0 (0.94)
8 (5/16)	2.0 (0.08)	2.0 (0.08)	3.0 (0.12)	4.0 (0.16)	5.0 (0.20)	6.0 (0.24)	8.0 (0.31)	10.0 (0.39)	13.0 (0.51)	15.0 (0.59)	18.0 (0.71)	20.0 (0.79)
10 (3/8)	2.0 (0.08)	2.0 (0.08)	2.0 (0.08)	4.0 (0.16)	5.0 (0.20)	6.0 (0.24)	7.0 (0.28)	9.0 (0.35)	12.0 (0.47)	14.0 (0.55)	17.0 (0.67)	19.0 (0.75)
12–22 (1/2 – 7/8)	1.0 (0.04)	2.0 (0.08)	2.0 (0.08)	2.0 (0.08)	4.0 (0.16)	5.0 (0.20)	5.0 (0.20)	7.0 (0.28)	10.0 (0.39)	12.0 (0.47)	14.0 (0.55)	17.0 (0.67)

⁴ Values apply to 3 mm (1/8 in.) thickness only when the alternative checking procedure in 10.7.2 is used.

9.3 *Pattern-Cut*—Unless otherwise specified (see Section 6), dimensional tolerances for pattern-cut glass shall be specified (see 6.1.7). Consult the manufacturer or fabricator for tolerances.

9.4 *Flatness*—Because of the nature of the processes used in manufacturing heat-strengthened and fully tempered glass, these products are not as flat as annealed glass. The deviation from flatness depends on thickness, width, length, and other factors (see 7.3). Usually greater thicknesses yield flatter products (see 10.7).

9.4.1 *Localized Bow*—Localized bow for rectangular glass shall not exceed 1.6 mm (1/16 in.) over any 300 mm (12 in.) span.

9.4.2 *Overall Bow*—Overall bow shall not exceed the values shown in Table 2 when measured in accordance with 10.7.2.

10. Test Methods

10.1 *Expansion Fit Test for Ceramic Coating—Condition B, Fully or Partially Ceramic Coated Glass:*

10.1.1 *Test Specimens*—Prepare and test in accordance with Test Method C978.

10.1.2 *Test Results:*

10.1.2.1 The expansion match between the glass and ceramic coatings influences significantly the strength character-

istics of glass. Proper match is essential to ensure that significant reduction in strength does not result due to the ceramic coating.

10.1.2.2 When coated, cured, and well-annealed glass strips are tested in accordance with Test Method C978, the stress measured in the glass at the ceramic-glass interface shall be a maximum of 1.52 MPa (220 psi) tension or compression.

10.2 Durability Tests of Ceramic Coating:

10.2.1 Test Specimens:

10.2.1.1 Specimens for durability tests shall have a representative thickness of ceramic coating of the same type and color as provided in specimens in 10.1.1. Specimens shall be fired in a normal manner with a production lot.

10.2.1.2 Specimens for tests in 10.2.2 and 10.2.4 may be of any convenient size.

10.2.2 *Test for Porosity*—Use either Test Method A or B.

10.2.2.1 Test Method A—Gloss Test:

(1) *Procedure*—With a glossmeter⁶ conforming to Test Method C346, check the gloss value. The glossmeter shall be calibrated such that the gloss value reading with polished black

⁶ A glossmeter manufactured by Photovolt Corp., Hunter Associates Laboratory, Gardner Instrument Co., or others using a 45° angle of illumination has been found suitable for this purpose.

glass of refractive index 1.540 has a value of 55.9 (see Test Method **C346** for detailed discussion). Note: Glossmeter calibration values may vary based on the sample provided by the instrument supplier.

(2) *Test Results*—Penetration of water through porous ceramic can cause separation of the ceramic coating from the base glass in freezing weather; ceramic with adequate gloss has been found to prohibit water entry, thus preventing such failure. Lack of adequate gloss may also cause discoloration. When tested, the gloss value shall be a minimum of 35 at the time of manufacture. The 35 gloss minimum may not apply to translucent and light color ceramic frits such as etch, sandblasted, and whites.

10.2.2.2 Test Method B—India Ink Test:

(1) *Procedure*—The specimen should be at ambient temperature. Lightly scrape an approximate 25 by 75 mm (1 by 3 in.) area of the ceramic coating with ten passes of a single-edge razor blade oriented toward the ten and four o'clock position at an angle of 45° to the surface of the specimen. Draw a line with India ink along the 75 mm (3 in.) dimension. After the ink has been on the specimen for 15 min, apply a fine abrasive paste over the line and scrub with an assay brush until the paste is removed from the line area. View the scrubbed area under a diffused light source with the unaided eye to determine if any residue remains in the ceramic coating.

(2) *Test Results*—Residual deposits of ink indicate a porosity of the ceramic coating that will allow water moisture penetration that may result in a discoloration of the ceramic coating or a separation of the coating and the glass substrate in freezing weather, or both.

10.2.3 *Alkali Resistance Test*—Specimens for evaluation of resistance to alkali shall be prepared and tested in accordance with Test Method **C1203**. The measured weight loss shall not exceed 0.0028 g/cm² (0.000153 oz/in.²).

10.2.4 *Acid-Resistance Test*—Specimens for evaluation of resistance to acid shall be tested in accordance with Test Method **C724**. The acid resistance of the test specimen shall be five or better to be considered acceptable, and no visible stain shall be observed when the undecorated side of the sample is viewed over an opaque background.

10.3 *Fallout Resistance Test for an Assembly of Glass and Adhered Reinforcing Material*—Applies to Condition A, Condition B, or Condition C glasses when used in spandrel glazing applications. (NOTE—Fallout resistance capability is optional and is intended to provide temporary retention of broken lites of glass in spandrel glazing applications.) (See **6.1.13**).

10.3.1 *Frequency of Tests*—Unless otherwise specified, the test for fallout resistance shall be performed with specimens taken from the initial production lot and thereafter only when changes are made in the assembly.

10.3.2 *Specimen Size*—Size of specimens shall be 863 by 1930 mm (34 by 76 in.) with a tolerance of ±1.6 mm (1/16 in.) on each dimension.

10.3.3 *Test Procedure*—Test for 100 cycles and repeat with no time delay between cycles. Perform each cycle in sequence as follows:

10.3.3.1 Hold for 1 h at –29°C (–20°F) and ambient humidity.

10.3.3.2 During the next 3 h, increase temperature from –29 to 82°C (–20°F to 180°F) with relative humidity at 95 to 100 % when above 5°C (41°F).

10.3.3.3 Then hold for 1 h at 82°C (180°F), 95 to 100 % relative humidity.

10.3.3.4 During the next 3 h, decrease temperature from 82 to –29°C (180 to –20°F) and ambient humidity.

10.3.4 *Sample Stabilization*—After completion of the test procedure of **10.3.3.4**, the sample shall be allowed to rest for at least four h at temperatures between 20 and 30°C (68 and 86°F).

10.3.5 *Test Apparatus*—Each specimen shall be mounted in a test frame as specified in ANSI Z97.1 or CPSC 16 CFR 1201 as modified to conduct pressure test of **10.3.7**.

10.3.6 *Fracturing Glass*—While the specimen is in the test frame, break the specimen using a spring-loaded prick punch at the midpoint of either vertical edge and 25 mm (1 in.) inboard of the edge. Cracks and fissures that may develop are permissible.

10.3.7 *Wind Load*—Subject each specimen after breakage to ten cycles of positive and negative pressure at 200 Pa (4 psf) to simulate the action of wind load against a building. Each positive and negative pressure shall be of 5-min duration.

10.3.8 *Interpretation of Tests*—Although cracks and fissures that may have developed are permissible, no opening shall occur through which a 76.2-mm (3-in.) diameter sphere may be freely passed, nor shall there be single or multiple areas with a cumulative total area of more than 58 cm² (9 in.²) in which an attached film or other reinforcing material is detached from the glass.

10.4 *Blemish Detection for Point Blemishes (Knots, Dirt, Stone, Crush, Gaseous Inclusions and Other Similar Blemishes):*

10.4.1 *Condition A, B (Partially-Coated Only), and C*—See Specification **C1036** test methods and evaluation criteria.

10.4.2 *Condition B (Fully-Coated)*—Glass shall be viewed by light reflected from the viewed surface. Place the glass sample against an opaque backup material in a vertical position. View the sample from a distance of approximately 1 m (39 in.) for initial blemish detection. Refer to Specification **C1036**, Table 3 for evaluation criteria.

10.5 *Blemish Detection for Linear Blemishes (Scratches, Rubs, Digs, and Other Similar Blemishes):*

10.5.1 *Condition A, B (Partially-Coated Only) and C*—See Specification **C1036** test methods and evaluation criteria.

10.5.2 *Condition B (Fully-Coated)*—Glass shall be viewed by light reflected from the viewed surface. Place the glass sample against an opaque backup material in a vertical position. View the sample from a distance of approximately 1 m (39 in.) for initial blemish detection. Refer to Specification **C1036**, Table 3, for evaluation criteria.

10.6 *Ream, Strings, Lines, and Distortion:*

10.6.1 *Condition A, B (Partially-Coated Only)*—See Specification **C1036** tables regarding allowable blemishes.

10.6.2 *Condition B (Fully-Coated)*—Not Applicable.

10.7 *Localized and Overall Bow:*

10.7.1 *Localized Bow*—Place sample glass in a freestanding vertical position, resting on blocks at the quarter points. With the glass in this position, place a 300 mm (12 in.) long straightedge anywhere on the concave surface.

10.7.2 *Overall Bow*—Place sample glass in a freestanding vertical position, resting on blocks at the quarter points. With the glass in this position, place a straightedge across the concave surface, parallel to and within 25.4 mm (1 in.) of one edge, and spanning from one edge to the opposite other edge, and measure the maximum deviation with a taper, or feeler gage, dial indicator or fine scale ruler. When the above procedure is impractical for larger sizes of 3 mm ($\frac{1}{8}$ in.) thickness, place the glass on a flat surface, concave side down, and use a taper, feeler gage, dial indicator, or fine scale ruler, reading in 0.02 mm (0.001 in.) increments, to determine overall bow. Overall bow values shown on the second line of Table 2 apply to 3 mm ($\frac{1}{8}$ in.) when the alternative (horizontal) procedure is used.

10.8 *Surface and Edge Compression, Heat-Strengthened and Fully Tempered Glass*—Examine specimens by the polariscopic or light refraction methods for surface or edge compression. When the range of the apparatus permits examination for edge compression only, obtain the averaged value for all midpoints of every edge. Accomplish this examination for Condition B glass by removing the ceramic coating with hydrofluoric acid or abrasive cloth. Index oil and a glass-slide cover plate may be necessary to eliminate the diffusing effect of the abraded surface and expose compression color bands.

10.8.1 *Surface Compression, Heat—Strengthened and Fully Tempered Glass* (see 8.1)—Surface compression to be measured by light refraction methods such as GASP, DSR, or similar methods per Test Method C1279. Two surface compression measurements shall be made in each of five locations, oriented in two directions at 90° to each other, for a total of ten readings on each specimen to be tested. Average the ten readings to determine the stress level of the test sample. The five locations to be examined are shown in Fig. 5.

10.9 *Break Test, Fully Tempered Glass*—Test and interpret in accordance with ANSI Z97.1 or CPSC 16 CFR 1201 as applicable (see 8.1.2).

10.10 *Coating Criteria, Condition B, Ceramic Coated*—Glass shall be viewed by light reflected from the viewed surface. Place the glass sample against an opaque backup

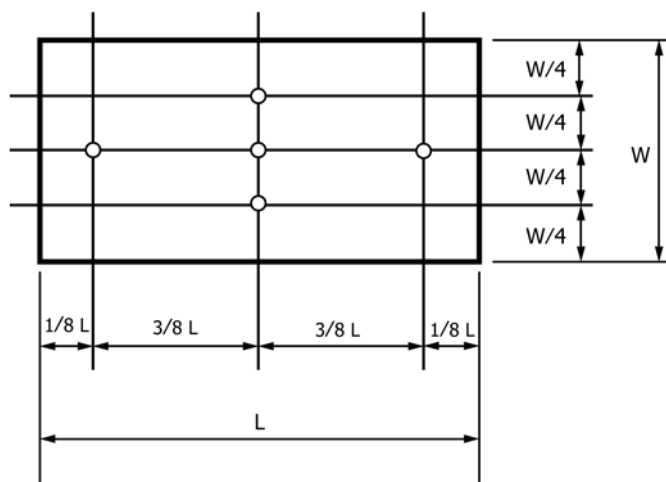


FIG. 5 Five Locations Examined

material and in a vertical position. View the sample from a distance of approximately 3 m (10 ft). Determine acceptability in accordance with 8.3.1.

10.11 *Coating Criteria Condition C*—See Specification C1036.

11. Product Marking

11.1 The identification marking, when required, shall include the manufacturer's name or trademark, and the designation of heat-strengthened or fully tempered, or an abbreviation such as HS or Tempered. The identification marking shall be either permanent or temporary, as specified.

11.1.1 *Permanent Identification Marking*—Permanent identification marking may be accomplished by a variety of methods including, but not limited to, sandblasting, etching, fired-on ceramic decal or silk-screened imprint, or laser marking. The marking shall be located at one or more corners of the glass. Requirements for permanent identification markings on fully tempered glass may vary with application.

11.1.2 *Temporary Identification Marking*—Temporary identification marking shall consist of a label that is attached to the glass and can be removed after installation of the glass.

12. Keywords

12.1 edge compression; flat glass; heat-strengthened glass; heat-treated glass; surface compression; tempered glass

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; http://www.copyright.com/