



# Standard Test Method for Hydrostatic Pressure Resistance of a Liquid-Applied Waterproofing Membrane<sup>1</sup>

This standard is issued under the fixed designation C1306/C1306M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

<sup>ε1</sup> NOTE—Units information was editorially corrected in November 2016.

## 1. Scope

1.1 This test method describes a laboratory procedure for determining the resistance of a waterproofing membrane to hydrostatic pressure.

1.2 The committee with jurisdiction over this standard is not aware of any comparable standards published by other organizations.

1.3 There are no ISO standards similar or equivalent to this ASTM standard.

1.4 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

## 2. Referenced Documents

2.1 *ASTM Standards:*<sup>2</sup>

**C717 Terminology of Building Seals and Sealants**

**C1375 Guide for Substrates Used in Testing Building Seals and Sealants**

## 3. Terminology

3.1 *Definitions*—Refer to Terminology **C717** for definitions of technical terms used in this test method.

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee **D08** on Roofing and Waterproofing and is the direct responsibility of Subcommittee **D08.22** on Waterproofing and Dampproofing Systems.

Current edition approved Nov. 1, 2016. Published November 2016. Originally approved in 1995. Last previous edition approved in 2008 as C1306 – 08. DOI: 10.1520/C1306\_C1306M-08R16E01.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

## 4. Summary of Test Method

4.1 This test method is conducted in two stages. In the first stage, the test membrane is subjected to hydrostatic pressure that is increased steadily over an 8 h period until the specimen fails or the maximum pressure is achieved. In the second part of the test, three more specimens are subjected to hydrostatic pressure that is increased slowly from 50 % of the failure value to failure in 2.5 psi increments every two to three days.

## 5. Significance and Use

5.1 This test method is used as a screening tool to determine the hydrostatic pressure to which a liquid-applied waterproofing membrane may be subjected without failing when stretched over a crack in the substrate. This test method discriminates between a membrane that is very resistant to hydrostatic pressure and one that is not. Because of the variability inherent in this test method, it is not recommended that this test method be used to set a numerical standard for hydrostatic pressure resistance. No prediction of durability at lower hydrostatic pressures can be made when using the results of this test method.

## 6. Comparison to Other Standards

6.1 The committee with jurisdiction over this standard is not aware of any comparable standards published by other organizations.

## 7. Apparatus and Materials

7.1 *Test Apparatus*, made of Schedule 80 PVC pipe pieces and constructed as shown in **Fig. 1**.


7.2 *Masking Tape*.

7.3 *TFE-Fluorocarbon or Polyethylene Spacers*, three, 51 by 19 by 3 mm [2 by 0.75 by 0.125 in.].

7.4 *Circulating Hot-Air Oven*.

7.5 *Source of Regulated Compressed Air*, capable of at least 45 psig.

7.6 *Epoxy Cement*, with gap filling capability, or non-sag construction mastic.

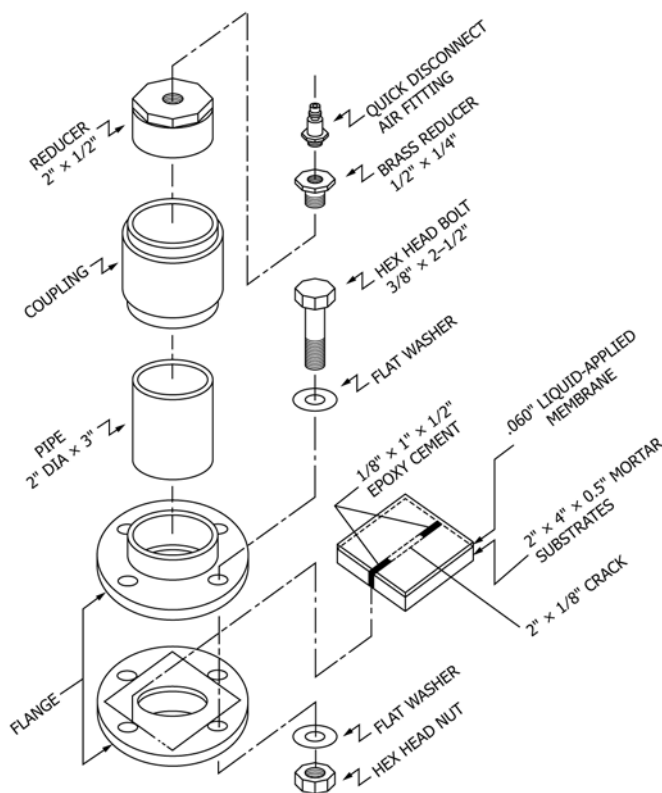

NOTE 1—All parts made of schedule 80 PVC.

FIG. 1 Testing Apparatus

7.7 *Sealing Gaskets*, eight, 102 mm [4 in.] outside diameter by 57 mm [2.25 in.] inside diameter by 6 mm [0.25 in.] thick made of very soft rubber.<sup>3</sup>

7.8 *Vernier Calipers*.

## 8. Preparation of Substrates

8.1 Prepare mortar substrates as described in Guide C1375.

8.2 Cut the blocks into matching pairs each measuring approximately 100 by 50 by 12 mm [4 by 2 by 0.5 in.].

8.3 Other substrates may be used, and shall be prepared to provide a clean, level test surface. Other preparation requirements shall be as agreed upon between the supplier and the specifier.

## 9. Conditioning/Mixing

9.1 Store all materials to be tested at standard conditions of  $23 \pm 2^\circ\text{C}$  [ $73.4 \pm 3.6^\circ\text{F}$ ] and  $50 \pm 5\%$  relative humidity for at least 24 h before any test specimens are prepared.

9.2 Follow the manufacturer's instructions for mixing and preparing membrane materials for testing.

9.3 When a primer is required by the membrane manufacturer, use the primer as instructed by the membrane manufacturer.

## 10. Procedure

### 10.1 Application of the Membrane to the Test Substrate:

10.1.1 Prepare four specimens. One will be used for the rapid screening test and the others will be used for the longterm test.

10.1.2 Measure the thickness of each block to the nearest 0.025 mm [0.001 in.], using vernier calipers. Record this value.

10.1.3 For self-leveling membrane materials, lay the bound blocks on a sand bed and level them. Apply 50 mm [1 in.] wide masking tape around the perimeter of the joined test substrates so that approximately half of the width of the tape protrudes above the test surface on all four sides to form a dam. Add sufficient material to yield a dry film thickness of  $1.5 \pm 0.1$  mm [ $0.060 \pm 0.005$  in.]. Check the coating thickness with a wet film gage. The film thickness may be built up in several coats if specified by the manufacturer.

10.1.4 For non-sag materials, stretch a rubber band around the perimeter of the substrate to keep the joint closed. Apply a film of membrane at a dry film thickness of  $1.5 \pm 0.1$  mm [ $0.060 \pm 0.005$  in.]. Ensure that the material is a uniform thickness by using a draw-down bar or similar device.

10.1.5 Allow the membrane to cure one week at room temperature and 50 % relative humidity followed by one week in an oven at  $70^\circ\text{C}$  [ $158^\circ\text{F}$ ]. Remove the test specimens from the oven and allow them to cool to room temperature for at least 1 h. Lay the specimens with membrane surface down on release paper.

10.1.6 Using vernier calipers, carefully measure the thickness of the substrate-membrane composite on either side of the joint. Measure to the nearest 0.025 mm [0.001 in.]. Avoid stretching or tearing the membrane while measuring the thickness. Record these measurements.

10.1.7 Remove all masking tape. Insert a TFE-fluorocarbon or polyethylene spacer into the center of the joint of one of the membrane-mortar composites, leaving a cavity 3 by 25 mm [ $0.125$  by  $1$  in.] at either end of the joint. Make sure the spacer is touching the membrane but does not cut it. Fill the cavities on either side of the spacer with premixed epoxy cement or construction adhesive.

10.1.8 The specimen may have to be clamped to keep it flat. Clamp it with "C" clamps or a heavy piece of angle iron. Place the angle iron with one side resting on either side of the joint to form an inverted "V" with the point above the joint.

10.1.9 Allow the cement to cure for one day. Remove the clamps and spacer.

### 10.2 Conduct Rapid Test:

10.2.1 Install one membrane-mortar composite in the test apparatus by placing one sealing gasket on top of the membrane and one sealing gasket under the test specimen. Place the test specimen with membrane side up in the test apparatus and draw down on the bolts to a snug fit.

NOTE 1—Be careful not to use excessive torque which will cause the test specimen to fracture. See Fig. 1.

<sup>3</sup> The sole sources of supply of the materials (ADCO SP 505 and Ashland Plioseal T408 rubber sealing tapes) known to the committee at this time is ADCO Products, 100 Tri State International, Suite 135, Lincolnshire, IL 60069 and Ashland Inc., 50 E. RiverCenter Blvd., P.O. Box 391, Covington, KY 41012-0391. If you are aware of alternative suppliers, please provide this information to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee,<sup>1</sup> which you may attend.

10.2.2 Fill the test apparatus with approximately 100 mL of tap water. Place the tester inside a container to catch water when failure of the membrane occurs.

10.2.3 Connect the apparatus to a regulated air supply and apply 0.034 MPa [5 psig] of air pressure. Increase the air pressure by approximately 0.017 MPa [2.5 psig] every 15 min until membrane fails or pressure exceeds 0.310 MPa [45 psig]. Water leaking from the bottom of the test apparatus indicates failure.

NOTE 2—Verify that the membrane has actually failed (and that the tester has not developed a leak) by adjusting the air pressure to 0.034 MPa [5 psig] or less, inverting the apparatus, and visually examining the membrane at the joint.

### 10.3 Conduct the Long-Term Test:

10.3.1 Repeat the procedures in 10.2.1 and 10.2.2.

10.3.2 Connect the apparatus to a regulated air supply and apply air pressure at 80 % of failure value determined in 10.2. Increase the air pressure by approximately 0.017 MPa [2.5 psig] every two days (or three days over a weekend). Continue the test until the membrane fails or the pressure exceeds 0.310 MPa [45 psig]. Water leaking from the bottom of the test apparatus indicates failure.

NOTE 3—Verify that the membrane has actually failed (and that the tester has not developed a leak) by adjusting the air pressure to 0.034 MPa [5 psig] or less, inverting the apparatus, and visually examining the membrane at the joint.

10.3.3 Repeat this test with the two remaining membrane-mortar composites.

## 11. Calculation

11.1 Calculate the measured dry film thickness as:

$$DFT = BM - B \quad (1)$$

where:

*DFT* = measured dry film thickness,

*BM* = thickness of membrane-mortar composite, and  
*B* = thickness of block.

## 12. Report

12.1 Report the following information:

12.1.1 The measured dry film thickness of the membrane as calculated in 11.1,

12.1.2 The air pressure in megapascals at which the membrane failed or the test was stopped in the rapid test (see Section 2),

12.1.3 The air pressure in megapascals, at which each of the three membranes failed, or the test was stopped, in the long-term test. Also record the average of these three results, and

12.1.4 The duration of each test in hours or days. Also report the average of the three results for the long-term test.

12.1.5 By mutual agreement, test may be conducted with alternate thickness spacer. Report width of spacer used.

## 13. Precision and Bias

13.1 *Repeatability*—The repeatability (within a given laboratory) interval for three materials tested by three laboratories is 14.931 psi. In future use of this test method, the difference between two test results obtained in the same laboratory on the same material will be expected to exceed 14.931 psi only about 5 % of the time.

13.2 *Reproducibility*—The reproducibility (between given laboratories) interval for three materials tested by three laboratories is 21.082 psi. In future use of this test method, the difference between two test results obtained in different laboratories on the same material will be expected to exceed 21.082 psi only about 5 % of the time.

## 14. Keywords

14.1 hydrostatic; membrane; waterproofing

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; http://www.copyright.com/*