



Designation: C1373/C1373M – 11 (Reapproved 2017)

Standard Practice for Determination of Thermal Resistance of Attic Insulation Systems Under Simulated Winter Conditions¹

This standard is issued under the fixed designation C1373/C1373M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This practice presents a laboratory procedure to determine the thermal resistance of attic insulation systems under simulated steady-state winter conditions. The practice applies only to attic insulation systems that face an open attic air space.

1.2 The thermal resistance of the insulation is inferred from calculations based on measurements on a ceiling system consisting of components consistent with the system being studied. For example, such a system might consist of a gypsum board or plywood ceiling, wood ceiling joists, and attic insulation with its top exposed to an open air space. The temperature applied to the gypsum board or plywood shall be in the range of 18 to 24°C [64 to 75°F]. The air temperature above the insulation shall correspond to winter conditions and ranges from –46°C to 10°C [–51 to 50°F]. The gypsum board or plywood ceiling shall be sealed to prevent direct airflow between the warm and cold sides of the system.

1.3 This practice applies to a wide variety of loose-fill or blanket thermal insulation products including fibrous glass, rock/slag wool, or cellulosic fiber materials; granular types including vermiculite and perlite; pelletized products; and any other insulation material that is installed pneumatically or poured in place. The practice considers the effects on heat transfer of structures, specifically the ceiling joists, substrate, for example, gypsum board, air films, and possible facings, films, or other materials that are used in conjunction with the insulation.

1.4 This practice measures the thermal resistance of the attic/ceiling system in which the insulation material has been preconditioned according to the material Specifications C549, C665, C739, and C764.

1.5 The specimen preparation techniques outlined in this standard do not cover the characterization of loose-fill materials intended for enclosed applications.

¹ This practice is under the jurisdiction of ASTM Committee C16 on Thermal Insulation and is the direct responsibility of Subcommittee C16.30 on Thermal Measurement.

Current edition approved May 1, 2017. Published May 2017. Originally approved in 1998. Last previous edition approved in 2011 as C1373/C1373M – 11. DOI: 10.1520/C1373_C1373M-11R17.

1.6 This practice is to be used to characterize material behavior under controlled steady-state laboratory conditions intended to simulate actual temperature conditions of use. The practice does not simulate forced air flow conditions.

1.7 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.7.1 All values shall be reported in both SI and inch-pound units unless specified otherwise by the client.

1.8 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

1.9 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

2.1 *ASTM Standards:*²

C167 Test Methods for Thickness and Density of Blanket or Batt Thermal Insulations

C168 Terminology Relating to Thermal Insulation

C177 Test Method for Steady-State Heat Flux Measurements and Thermal Transmission Properties by Means of the Guarded-Hot-Plate Apparatus

C518 Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus

C520 Test Methods for Density of Granular Loose Fill Insulations

C549 Specification for Perlite Loose Fill Insulation

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

- C665 Specification for Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing
- C687 Practice for Determination of Thermal Resistance of Loose-Fill Building Insulation
- C739 Specification for Cellulosic Fiber Loose-Fill Thermal Insulation
- C764 Specification for Mineral Fiber Loose-Fill Thermal Insulation
- C1045 Practice for Calculating Thermal Transmission Properties Under Steady-State Conditions
- C1058 Practice for Selecting Temperatures for Evaluating and Reporting Thermal Properties of Thermal Insulation
- C1114 Test Method for Steady-State Thermal Transmission Properties by Means of the Thin-Heater Apparatus
- C1363 Test Method for Thermal Performance of Building Materials and Envelope Assemblies by Means of a Hot Box Apparatus

3. Terminology

3.1 *Definitions*— Unless otherwise stated, the definitions listed in Terminology C168 are applicable herein.


4. Significance and Use

4.1 The thermal resistance of a ceiling system is used to characterize its steady-state thermal performance.

4.2 The thermal resistance of insulation is related to the density and thickness of the insulation. Test data on thermal resistance are obtained at a thickness and density representative of the end use applications. In addition, the thermal resistance of the insulation system will be different from that of the thermal insulation alone because of the system construction and materials.

4.3 This practice is needed because the in-service thermal resistance of some permeable attic insulations under winter conditions is different, lower or higher R , than that measured at or close to simulated room temperature conditions utilizing small-scale tests in which the insulation is sandwiched between two isothermal impermeable plates that have a temperature difference (ΔT) of 20 to 30°C [36 to 54°F]. When such insulation is installed in an attic, on top of a ceiling composed of normal building materials such as gypsum board or plywood, with an open top surface exposed to the attic air space, the thermal resistance under winter conditions with heat flow up and large temperature differences is significantly less because of additional heat transfer by natural convection. Fig. 1 illustrates the difference between results from small scale tests and tests under the conditions of this practice. See Ref (1-12) for discussions of this phenomenon.³

4.4 In normal use, the thickness of insulation products ranges from 75 mm [3 in.] to 500 mm [20 in.]. Installed densities will depend upon the product type, the installed thickness, the installation equipment used, the installation technique, and the geometry of the insulated space.

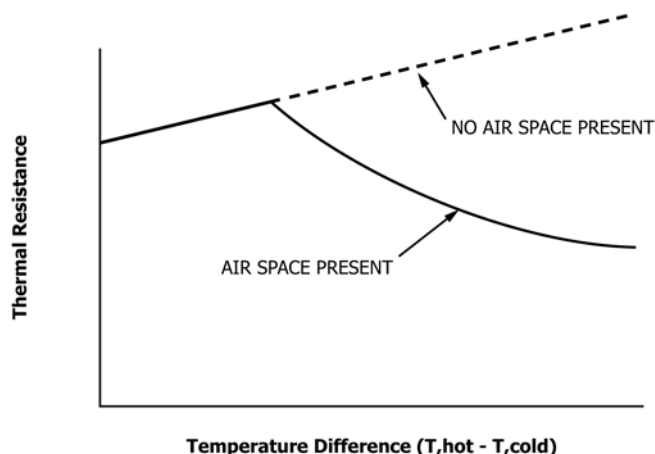

NOTE 1—A constant hot-side temperature (T_{hot}) is used for both tests and the temperature difference increases as the cold side temperature (T_{cold}) is decreased. See 5.1.6 for requirements on size of air space.

FIG. 1 Schematic of Thermal Resistance for a Permeable Attic Insulation Under Simulated Winter Conditions (Heat Flow Up)

4.5 The onset of natural convection under winter conditions is a function of specimen thickness for some materials. For purposes of this practice, the tests shall be carried out at thicknesses at which the product is used.

4.6 Since this practice simulates winter conditions, the heat flow direction shall be vertically upwards.

4.7 Specimens shall be prepared in a manner consistent with the intended installation procedure. Products for pneumatic installation shall be pneumatically-applied (blown), and products for pour-in-place installation shall be poured into place. See 5.2.

5. Equipment

5.1 Thermal test apparatus used for this practice shall meet the following requirements:

5.1.1 *Conformance to Standards*—The apparatus shall conform to all requirements of the ASTM thermal test method used, except as required by 5.1.2 – 5.1.6.

5.1.2 *Size*—The apparatus shall be capable of testing specimens at the thickness intended for product use. Length and width of the metering area shall be at least twice the spacing of the wood joists or four times the specimen thickness, whichever is greater (see Fig. 2).

5.1.3 *Temperature*—The apparatus shall be capable of testing with the hot side surface maintained between 18 and 24°C [64 and 75°F], and with the cold side air temperature maintained near the winter condition for the particular climate being simulated, which ranges from –46 to 10°C [–51 to 50°F]. In the absence of specified temperatures, the ambient temperatures listed in Table 2 of C1058 on Temperatures for Thermal Transmittance Evaluations is one source of test temperatures.

NOTE 1—Only those with a hot ambient of 24°C [75°F] are applicable.

5.1.4 *Humidity*—The absolute humidity on both sides of the test apparatus shall be maintained low enough to prevent condensation within the specimen. See 6.9.6 of Test Method C1363 for humidity requirements for the hot box methods, 6.6

³ The boldface numbers in parentheses refer to the list of references at the end of this standard.

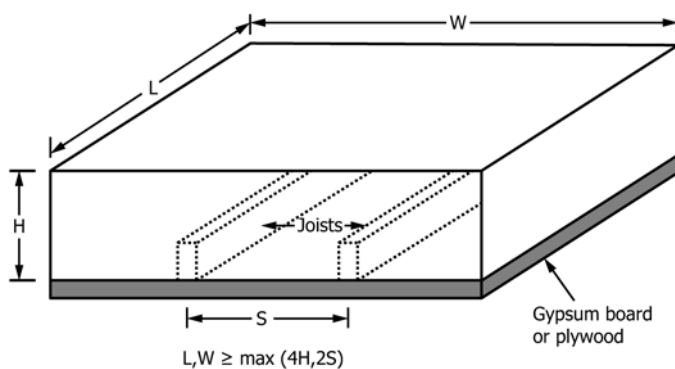


FIG. 2 Requirements on Dimensions of Test Specimen Metering Area

of Test Method C177 for the guarded hot plate method, and 7.10 of Test Method C518 for the heat flow meter apparatus.

5.1.5 *Orientation and Direction of Heat Flow*—The thermal test specimen shall be oriented horizontally with heat flow up.

5.1.6 *Thermal Test Specimen and Holder*—The test assembly shall be sized to match the test apparatus and shall be made of construction materials representative of the intended application. The substrate on which the insulation rests shall be representative of the intended application, typically gypsum board. The substrate shall be sealed to prevent direct airflow between the warm and cold sides of the system. Wood joists also shall be included. The test assembly shall be constructed such that the top of the insulation is open to an air space having a minimum thickness of 150 mm [6 in.]. Test Methods C1363 is preferred because of its ability to accommodate a large air space. Other apparatuses that simulate in-service conditions must meet the requirements of this practice, (for example, modifications of Test Methods C177, C518, or C1114 with Practice C1045). In all cases, the size requirements given in 5.1.2 shall be met. Fig. 3 shows a schematic of an attic test module that has been used for these types of tests. Other configurations without the roof structure are acceptable as long as the minimum 150 mm [6 in.] air space is maintained.

5.2 Specimen Preparation Equipment:

5.2.1 *Blowing Apparatus*—A blowing apparatus is required when pneumatically-applied specimens are to be tested. Choose the combination of hopper, blower, hose size and length that is representative of common use for the application of the material to be tested. The following machine specifications have been developed for use with mineral fiber and cellulosic materials.

5.2.1.1 A commercial blowing machine with a design capacity for delivering the subject material at a rate recommended by the insulation manufacturer shall be used. The machine must utilize 46 m [150 ft] of flexible, internally corrugated blowing hose with an appropriate sized diameter as specified by the machine manufacturer. At least 30 m [100 ft] of the hose must be elevated between 3 and 6 m [10 and 20 ft] above the blowing machine to simulate typical installation configuration. The hose must have no more than eight 90° bends and no bends less than 1.2 m [4 ft] radius. It is good practice to clean the hose periodically by mechanically agitat-

ing it with the blower operating. This practice dislodges any pieces of old insulation that might be caught in the hose.

6. Sampling

6.1 A sample of material shall be selected from a lot according to sampling plans given in the material specifications, regulations, or other appropriate documents when applicable. In the absence of such directions, material from at least two randomly chosen packages shall be combined in equal portions (mass) so as to combine materials as uniformly as practicable.

6.2 The insulation material is preconditioned to a moisture content in equilibrium with the laboratory conditions prior to the specimen installation. Preconditioning of materials not only ensures controlled installation conditions but reduces the time required to condition the prepared specimen prior to thermal testing. For conditioning requirements, see the applicable materials Specifications C520, C549, C665, C739, and C764.

7. Specimen Preparation

7.1 General Instructions:

7.1.1 All specimens shall be prepared to a thickness and unit area mass that are given for the label *R*-value specification of interest for the material under test.

7.1.2 Specimens shall be prepared in a manner consistent with the intended installation procedure. All materials shall be installed carefully using the manufacturer's recommended installation practice. Batts shall be cut, as required, to fit the available specimen holder. Products for pneumatic installation shall be pneumatically-applied (blown), and products for pour-in-place installation shall be poured into the specimen holder. See 7.2.2 for the density of pneumatically-installed insulation. Other materials must be installed at the density suggested by the manufacturer.

7.1.3 The specimen holder shall represent typical attic frame construction, wherever possible. This requires, as a minimum, horizontal members representing the bottom chord of a truss system or rafter framing and an air-tight gypsum board or plywood bottom. The specimen holder shall be clean and free of insulation residue prior to installation of the sample insulation.

NOTE 2—For commonly available loose-fill insulation, state and federal energy codes, ASTM material specifications and the Federal Trade Commission have identified those materials that shall apply a correction for settling when determining thermal performance. It is beyond the scope of this practice to outline the procedures for this determination.

NOTE 3—Many factors can influence the characteristics of the loose-fill insulation. These include blowing rate, machine adjustments, the size and length of the hose, and the angle and dimensions of the hose outlet in relation to the specimen holder. Trained operators are required to duplicate field-installed conditioning.

NOTE 4—For these tests, the specimen shall be blown close to the labeled density. Some operators may wish to establish a target mass of insulation required to fill the test frame to the desired thickness and density as a control during the specimen preparation process. By weighing the initial material and that remaining after blowing is complete, the operator can estimate the material in the test frame. Other operators may wish to eliminate these extra steps. The reported test density, however, is obtained from the metering area density measurement conducted after the thermal test.

7.2 Specimen Preparation—Pneumatic-Application:

LARGE SCALE CLIMATE SIMULATOR

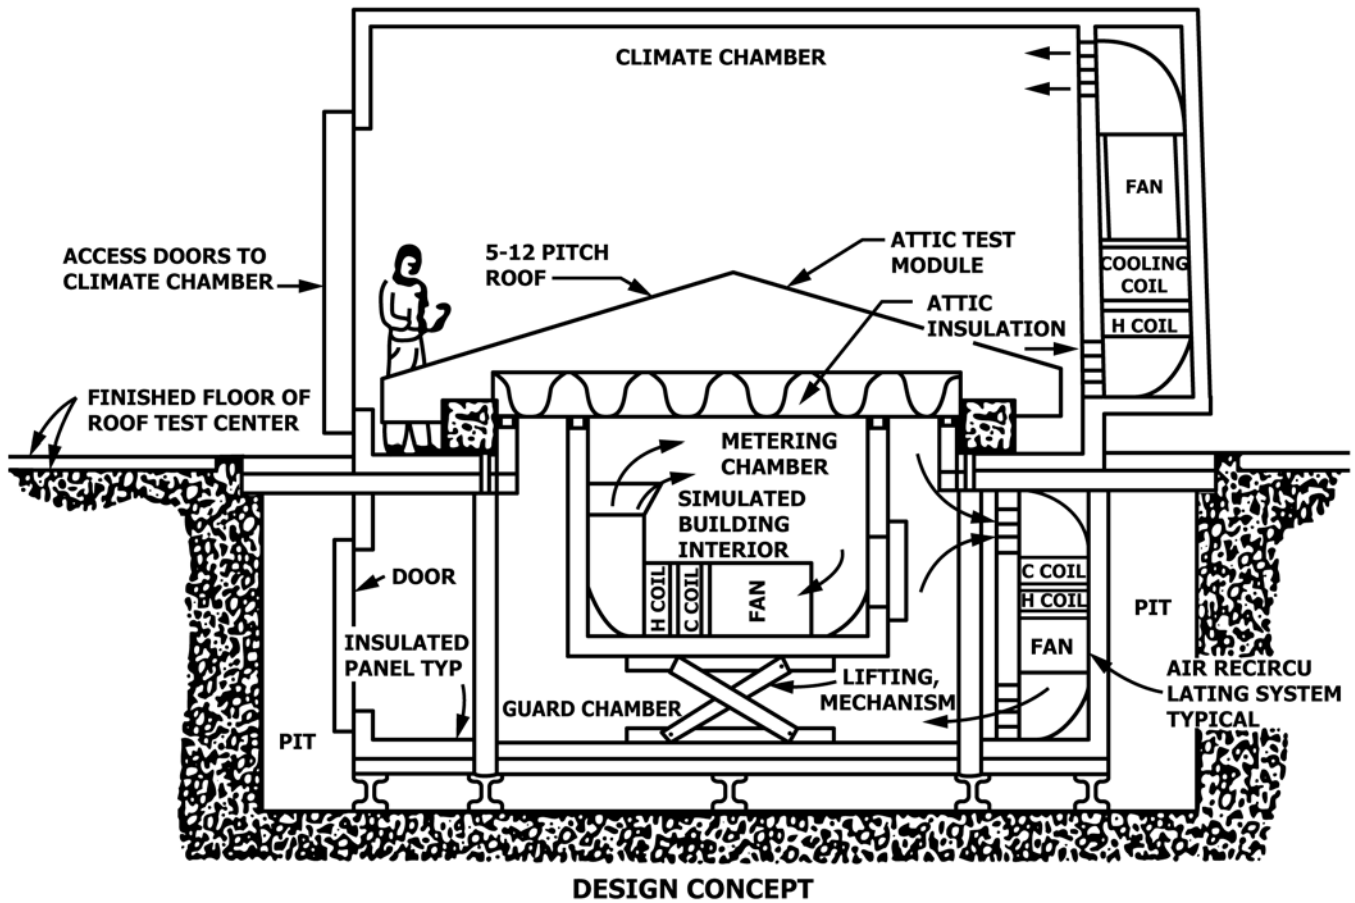


FIG. 3 Schematic of Attic Test Module and Large Scale Climate Simulator Used for Tests on Attic Insulation Under Simulated Winter Conditions

7.2.1 The procedure described in this section is intended for all products, which normally are installed pneumatically. For materials exhibiting post installation settling, a supplemental instruction set is provided in 7.3 to correct the test specimen blown density to accommodate for in-situ settling after installation.

7.2.2 *Installed Density*—The thermal resistances of loose-fill insulations are specified using densities selected by manufacturers to represent the product settled densities. Generally, it is necessary to know the product thermal resistance at a representative density. Some bag labels utilize multiple densities to reflect the fact that greater thickness installations usually result in higher installed densities. The use of multiple densities is detected from the bag label by calculating the label density for several different R -value levels. Label densities for a given R -value are calculated from the bag label by dividing the minimum mass/unit area by the minimum thickness. If the calculated densities are significantly different, the multiple density label has been used. When applicable specifications or codes do not specify the density to be used for comparison purposes, the recommended practice is to use the R -30 label density ($R(SI) = 5.3 \text{ m}^2 \cdot \text{K/W}$). If the density is not available

from the bag label, a density for test purposes is established by the procedures outlined in Test Method C520 or Specification C739.

7.2.3 Calculate the target mass of insulation required to fill the sample frame to the target thickness and density from the equation:

$$m = \rho [(L_{\text{ins}} \times A) - V_{\text{joist}}] \quad (1)$$

where:

- m = target mass of insulation, kg [lb],
- ρ = target density, kg/m^3 [lb/ft^3],
- L_{ins} = target insulation thickness, m [ft],
- A = area within sample frame, m^2 [ft^2], and
- V_{joist} = volume of joists within frame area, m^3 [ft^3].

7.2.4 Assemble the blowing machine, hose and hose length combination as appropriate for the material being prepared.

7.2.5 Set the blowing machine adjustments and select the feed rates in accordance with the insulation manufacturer's recommendations. If the insulation manufacturer does not provide this information, consult the machine manufacturer for recommended settings.

7.2.6 Place the required amount of insulation material (7.2.3) into the blowing machine hopper. If the hopper is too small to hold the entire amount required, fill the hopper to capacity with the premixed insulation (see 6.1). Additional material is added as required during the blowing process until the total amount of needed insulation is blown.

7.2.7 Turn on the blowing machine with the hose outlet directed away from the center of the specimen metering area and toward the far end of the specimen holder. The hose outlet orientation is varied, side to side, as needed to cover uniformly the entire area of the specimen holder, but shall remain approximately horizontal.

NOTE 5—Since the insulation material has been premeasured, some means of limiting the loose-fill trajectory to within the sample frame is required. A screen tent arrangement has been found effective in performing this operation.

7.2.8 Blow insulation into the specimen holder from the far end to approximately the middle line of the holder. Then move the hose to the opposite end of the specimen holder and blow the remainder of the holder with insulation. The direction from which the insulation is blown is alternated several times during the blowing period in order to provide as nearly uniform coverage of the specimen holder as possible while obtaining the desired thickness and mass.

NOTE 6—A new specimen shall be prepared if the intent is to test at label thickness and density, but the specimen exceeds the upper mass without reaching the target thickness or exceeds the upper thickness limit without meeting the target mass.

NOTE 7—Care should be observed when handling or moving the filled specimen holder so as not to disturb the test specimen any more than is absolutely necessary. Any vibration or impact can change the pack structure of the blown specimen and change its thermal properties.

7.2.9 Use a rake or piece of stiff wire to level the top surface of the specimen taking care not to disturb the subsurface material.

7.3 *Pneumatic Application—Settled Density Correction:*

7.3.1 The procedure listed below is required for those materials where the specimen preparation shall be modified to accommodate a correction for settling after installation. See Note 2 following 7.1.3.

7.3.2 Prepare the insulation specimen as directed in 7.2.

7.3.3 Using the mass of the insulation material in the specimen holder, determine the required test thickness that provides the final product settled density.

7.3.4 Uniformly compress the insulation material using a large flat board or paddle to establish the targeted test thickness determined in 7.3.3.

7.4 *Pouring Application*—For products intended to be poured in place:

7.4.1 Calculate the mass of insulation required to fill the frame to the label thickness and density.

7.4.2 Pour an amount of insulation calculated in 7.4.1 into the sample holder following pouring instructions given in appropriate specifications or Test Method C520.

7.4.3 Use a rake or piece of stiff wire to level the top surface of the specimen taking care not to disturb the subsurface material.

7.5 *Installation of Other Insulations*—Install the insulation following the manufacturer's instructions as required to fill the specimen frame to the required unit area mass and thickness.

8. Test Procedure

8.1 If the specimen holder is not already built into the apparatus, transfer the specimen and holder in its horizontal position to the thermal test apparatus, being careful not to disturb the specimen.

8.2 Conduct the test(s) in accordance with all requirements of the appropriate thermal test method, with the following exceptions (see also Section 5):

8.2.1 Certain methods require contact of both surfaces of the test specimen with isothermal plates; for this practice, a layer of still or slowly moving air (0.25 m/s [50 ft/min] or less) is required over the top surface of the insulation so that the top surface of the insulation is not in contact with an isothermal plate. Provision, however, shall be made to measure the temperature of the top surface of the insulation. For useful techniques, see Ref (12). The insulation shall not be compressed, unless compression is a usual part of the installation procedure in the application of the product, in which case the usual procedure for compression shall be followed.

8.2.2 The average atmospheric pressure during the test shall be measured. The atmospheric pressure is necessary since theory predicts that the temperature difference at which natural convection commences is inversely proportional to the square of the atmospheric pressure (through the dependence of the density of air on pressure). See Ref (4) for a discussion of the factors that affect the onset of natural convection.

8.2.3 For some materials, the thermal resistance will vary significantly with changes in the temperature difference applied across the specimen. Because of this, tests shall be conducted at three or more different temperature differences. These may be specified by the client, or they may be at even increments of temperature difference, or they may be selected from the conditions listed in Table 2 of C1058. A plot of *R*-value versus temperature difference shall be prepared to assist interested parties in determining the need for additional data.

8.3 Prior to the start and after completion of the thermal testing series, measure the thickness of the insulation in the metered area to the nearest millimetre using a pin gage (see Test Methods C167 for a description of pin gages. A smaller diameter pin and careful insertion is required to avoid compressing the insulation.) Prior to the test, the thickness shall be measured in at least five locations to allow estimation of the average thickness and density prior to testing. At the completion of testing and prior to removal of the insulation, the thickness shall be measured as required to get a true average thickness for the tested material. The number of individual measurements is at least one measurement for each 0.37 m² [4 ft²] of insulation area or a total of five, whichever is greater. The measurements shall be made at locations of the full thickness of the insulation, for example, they shall not be made at joist locations. Any gaps, unusual settling or other observations of the insulation conditions shall be observed and recorded. The times and dates of the thickness determinations also shall be recorded.

8.4 Cut, remove, and weigh to the nearest 0.5 %, the insulation within the metering area for the density determination. Measurements of mass must be made as soon as possible after removal and also after the material has been conditioned to a moisture content in equilibrium with the laboratory conditions. If the metering area is smaller than the entire test area, a thin walled die cutter, deep enough to accommodate various material thicknesses, or other suitable means shall be used to isolate the material in the metering area. Some means of alignment shall be available so that the perimeter of the die cutter lines up with the perimeter of the metering area. The die cutter shall be designed to fit over joists and other obstructions that might be present (see Practice C687 for details for pneumatically applied or poured insulations.)

9. Calculations

9.1 *Density*—Calculate the test density from the metering area, the mass of the insulation (from 8.4), and the test thickness (from 8.3) according to the following formula:

$$\rho_{\text{meter}} = \frac{m_{\text{meter}}}{[(L_{\text{ins}} \times A_{\text{meter}}) - V_{\text{joist}}]} \quad (2)$$

where:

- ρ_{meter} = test density of insulation, kg/m³ [lb/ft³],
- m_{meter} = mass of insulation within metering area, kg [lb],
- L_{ins} = average insulation thickness within metering area, m [ft],
- A_{meter} = metering area, m² [ft²], and
- V_{joist} = volume of joists within metering area, m³ [ft³].

9.2 Thermal Resistance:

9.2.1 Calculate the surface-to-surface thermal resistance of the test system, for example, the combination of insulation, gypsum board, and wood joists, following the procedures recommended for the test method being used. See 5.1.6 for preferred and allowable test methods.

9.2.2 Using an average of series-parallel and parallel-path calculations, calculate the thermal resistance of the insulation material, as specified in Annex A1. This calculation is necessary since the system characteristics of each apparatus will vary considerably. See Annex A1 for calculation example.

10. Report

10.1 Report the following information and that required by the test method, including references to applicable specifications and test methods:

10.1.1 The name, address, and other identification of the test laboratory and the date of the report.

10.1.2 The name and other identification of the material or product tested and the date of the test.

10.1.3 The source of the material or product, the date obtained, and the method of sampling.

10.1.4 The method and details of the specimen preparation. For example, the following would be included for loose-fill insulation: blowing machine, machine settings used, blow time, and any preconditioning.

10.1.5 The method and conditions of specimen conditioning.

10.1.6 The ASTM thermal test method used for the test results reported.

10.1.7 The details of the thermal apparatus and specimen holder, including the metering area and the number and placement of thermocouples. Other details of the specimen holder include the type, grade, dimensions, and density of the materials of which it is constructed, and the method of sealing to prevent direct air flow through it. If a roof structure is included, it must be described similarly, and its slope must be given.

10.1.8 The temperatures measured at the bottom of the ceiling and the corresponding temperatures at the top of the insulation system and the measured heat flow.

10.1.9 The test thickness and the density of the specimen.

10.1.10 The thermal resistance of the ceiling/insulation system, the calculated thermal resistance of the insulation, and the method used for calculating the resistance of the insulation.

10.1.11 An estimate of the precision and bias of the test results. Refer to the appropriate test method.

10.1.12 The average atmospheric pressure during the test.

10.1.13 Any other pertinent observations or remarks.

NOTE 8—Unless otherwise specified, all values of dimensions, conditions, and properties given in 10.1.7 through 10.1.12 shall be reported in both SI and inch-pound units.

11. Precision and Bias

11.1 The precision and bias of the test results obtained using this practice include the effects of: adherence to the test procedures, performance characteristics of the test apparatus, variability of the material or product, and sampling and specimen preparation. The influence of the material or product variability and the test imprecision are interactive. The characteristics of the specimen affect the test accuracy while characteristics of the test apparatus, for example, the test area size, will affect the apparent variability of the material or product. Larger areas are expected to provide better accuracy when specimens are thick and variable in character.

11.2 As a minimum requirement for this practice, estimates shall be made of the precision and bias of the test apparatus used. Guidance on estimates of these values is given in Test Methods C177, C518, C1114 and C1363.

11.3 Estimates of the precision and bias of the results, as representative of the materials or product, must be based on sufficient experiments to determine the variability and the effect of sampling and specimen preparation upon it.

11.4 The precision of this practice is not known because interlaboratory data are not available.

12. Keywords

12.1 attic insulation; convection; thermal resistance; winter conditions

ANNEX

(Mandatory Information)

A1. CALCULATIONS

A1.1 This annex gives an example of the calculation of the thermal resistance of the insulation as required by 9.2.2. As an example of the parallel-path and series-parallel calculations to determine the thermal resistance of the insulation material, assume that the ceiling consists of 12.7 mm [0.5 in.] gypsum board, wood joists 38.1 mm by 88.9 mm [1.5 in. by 3.5 in.] and spaced 609.6 mm [24 in.] apart, and loose-fill insulation at a thickness of 323.8 mm [12.75 in.]. Also, assume that at some particular temperature difference, the measured surface-to-surface R -value of the assembly is $R(SI)$ -3.52 $\text{m}^2 \cdot \text{K/W}$ (R -20 $\text{h} \cdot \text{ft}^2 \cdot ^\circ\text{F/Btu}$).

A1.2 From the ASHRAE Handbook—Fundamentals (13), the estimated R -value of the gypsum board is $R(SI)$ -0.079 $\text{m}^2 \cdot \text{K/W}$ (R -0.45 $\text{h} \cdot \text{ft}^2 \cdot ^\circ\text{F/Btu}$), that of the wood joists is $R(SI)$ -0.771 $\text{m}^2 \cdot \text{K/W}$ (R -4.38 $\text{h} \cdot \text{ft}^2 \cdot ^\circ\text{F/Btu}$), and that of the film resistance at either the bottom of the gypsum board or the top of the insulation is $R(SI)$ -0.107 $\text{m}^2 \cdot \text{K/W}$ (R -0.61 $\text{h} \cdot \text{ft}^2 \cdot ^\circ\text{F/Btu}$).

NOTE A1.1—Actual tested R -values for these components shall be used if they are available; otherwise, the values shall be obtained from the ASHRAE Handbook—Fundamentals (13).

A1.3 For the parallel-path calculation, the air-to-air R -value of the assembly, the surface-to-surface R -value of the assembly, and the R -value of the insulation are related by:

$$\frac{A_{\text{total}}}{R_{\text{air-air}}} = \frac{A_{\text{total}}}{R_{\text{surface-surface}} + R_{\text{films}}} = \frac{A_{\text{insulation path}}}{R_{\text{insulation path}}} + \frac{A_{\text{joist path}}}{R_{\text{joist path}}} \quad (\text{A1.1})$$

where:

- $A_{\text{insulation path}}$ = the area perpendicular to the heat flow occupied by the space between the joists,
- $A_{\text{joist path}}$ = the area perpendicular to the heat flow occupied by the joists,
- A_{total} = is the sum of $A_{\text{insulation path}}$ and $A_{\text{joist path}}$,
- $R_{\text{air-air}}$ = the air-to-air R -value of the assembly,
- $R_{\text{surface-surface}}$ = the surface-to-surface R -value of the assembly
- R_{films} = the sum of the film resistances on both sides of the assembly, and
- $R_{\text{insulation path}}$ and $R_{\text{joist path}}$ = quantities given in Eqs A1.2, A1.3 and A1.4:

$$R_{\text{insulation path}} = R_{\text{insulation}} + R_{\text{gypsum board}} + R_{\text{films}} \quad (\text{A1.2})$$

$$R_{\text{joist path}} = R_{\text{insulation, joist}} + R_{\text{joist}} + R_{\text{gypsum board}} + R_{\text{films}} \quad (\text{A1.3})$$

$$R_{\text{insulation, joist}} = R_{\text{insulation}} \cdot \frac{\text{thickness of insulation at joists}}{\text{total thickness of insulation}} \quad (\text{A1.4})$$

where:

- $R_{\text{insulation}}$ = total R -value of the insulation,
- $R_{\text{gypsum board}}$ = R -value of the gypsum board or other substrate,
- R_{joist} = R -value of the ceiling joists, and
- $R_{\text{insulation, joist}}$ = R -value of the part of the insulation that covers the joists.

Using these relationships for the above example, the surface-to-surface R -value and the insulation R -value are related by:

$$\frac{609.6}{3.52 + 2 \times 0.107} = \frac{571.5}{R_{\text{insulation}} + 0.079 + 2 \times 0.107} + \frac{38.1}{R_{\text{insulation}} \times \frac{323.85 - 88.9}{323.85} + 0.771 + 0.079 + 2 \times 0.107} \quad (\text{A1.5})$$

Eq A1.5 solved (either by rearranging into a quadratic form or by a trial and error or iterative procedure) to give:

$$R(SI)_{\text{insulation, parallel}} = 3.45 \text{ m}^2 \cdot \text{K/W} (19.62 \text{ h} \cdot \text{ft}^2 \cdot ^\circ\text{F/Btu}) \quad (\text{A1.6})$$

A1.4 Using the series-parallel method, the surface-to-surface R -value of the assembly and the R -value of the insulation are related by:

$$R_{\text{surface-surface}} = R_{\text{gypsum board}} + R_{\text{insulation, joist}} + \frac{A_{\text{total}}}{\frac{A_{\text{insulation path}}}{R_{\text{insulation}} - R_{\text{insulation, joist}}} + \frac{A_{\text{joist path}}}{R_{\text{joist}}}} \quad (\text{A1.7})$$

For the example under consideration, Eq A1.7 becomes:

$$3.52 = 0.079 + R_{\text{insulation}} \times \frac{323.85 - 88.9}{323.85} + \frac{609.6}{\frac{571.5}{R_{\text{insulation}} \times \frac{88.9}{323.85}} + \frac{38.1}{0.771}} \quad (\text{A1.8})$$

Eq A1.8 solved by trial and error to give:

$$R(SI)_{\text{insulation, series-parallel}} = 3.46 \text{ m}^2 \cdot \text{K/W} (19.63 \text{ h} \cdot \text{ft}^2 \cdot ^\circ\text{F/Btu}) \quad (\text{A1.9})$$

A1.5 The R -value of the insulation is found by averaging the results of Eq A1.6 and Eq A1.9 to give a value of $R(SI)$ of 3.46 $\text{m}^2 \cdot \text{K/W}$ (19.6 $\text{h} \cdot \text{ft}^2 \cdot ^\circ\text{F/Btu}$).

REFERENCES

- (1) Besant, R. W., and Miller, E., “Thermal Resistance of Loose-fill Fiberglass Insulations in Spaces Heated from Below,” *Thermal Performance of the Exterior Envelopes of Buildings II*, American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE), Atlanta, GA, 1983, pp. 720–733.
- (2) Delmas, A., and Wilkes, K. E., “Numerical Analysis of Heat Transfer by Conduction and Natural Convection in Loose-fill Fiberglass Insulation-effects of Convection on Thermal Performance,” ORNL/CON-338, Oak Ridge National Laboratory, Oak Ridge, TN, 1992.
- (3) Langlais, C., Arquis, E., and McCaa, D. J., “A Theoretical and Experimental Study of Convective Effects in Loose-Fill Thermal Insulation,” *Symposium on Insulation Materials, Testing and Applications, ASTM STP 1030*, 1990, pp. 290–318.
- (4) Nield, D. A., and Bejan, A., *Convection in Porous Media*, New York: Springer-Verlag.
- (5) Rose, W. B., and McCaa, D. J., “The Effect of Natural Convective Air Flows in Residential Attics on Ceiling Insulating Materials,” *Symposium on Insulation Materials: Testing and Applications, Second Volume, ASTM STP 1116*, 1991, pp. 263–274.
- (6) Silberstein, A., Langlais, C., and Arquis, E., “Natural Convection in Light Fibrous Insulating Materials with Permeable Interfaces: Onset Criteria and its Effect on the Thermal Performances of the Product,” *Journal of Thermal Insulation*, 14 (July 1990,) pp. 22–42.
- (7) Wilkes, K. E., and Rucker, J. L., “Thermal Performance of Residential Attic Insulation,” *Energy and Buildings*, 1983, 5:263–277.
- (8) Wilkes, K. E., Wendt, R. L., Delmas, A., and Childs, P. W., “Attic Testing at the Roof Research Center—Initial Results,” *Proceedings of the Third International Symposium on Roofing Technology*, National Roofing Contractors Association, 1991, pp. 391–400.
- (9) Wilkes, K. E., Wendt, R. L., Delmas, A., and Childs, P. W., “Thermal Performance of One Loose-Fill Fiberglass Attic Insulation,” *Symposium on Insulation Materials: Testing and Applications, Second Volume, ASTM STP 1116*, 1991, pp. 275–291.
- (10) Wilkes, K. E., and Childs, P. W., “Thermal Performance of Fiberglass and Cellulose Attic Insulations,” *Proceedings, Thermal Performance of the Exterior Envelopes of Buildings V, ASHRAE*, 1992, pp. 357–367.
- (11) Rose, W. B., and McCaa, D. J., “A Review of Field Thermal Performance of Loose-Fill Insulation in Residential Attics and Cathedral Ceilings,” *Thermal Conductivity 22*, T. W. Tong, ed., Technomic Publishing Co., Lancaster, PA, 1993, pp. 203–214.
- (12) Graves, R. S., Wilkes, K. E., McElroy, D. L., “Thermal Resistance of Attic Loose-Fill Insulations Decreases Under Simulated Winter Conditions,” *Thermal Conductivity 22*, T. W. Tong, ed., Technomic Publishing Co., Lancaster, PA, 1993, pp. 215–226.
- (13) ASHRAE Handbook—Fundamentals, Chapter 20, “Thermal Insulation and Vapor Retarders—Fundamentals,” American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Atlanta, GA, 1993.

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; <http://www.copyright.com/>