



Designation: C1523 – 17

## Standard Test Method for Determining Modulus, Tear and Adhesion Properties of Precured Elastomeric Joint Sealants<sup>1</sup>

This standard is issued under the fixed designation C1523; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

### 1. Scope

1.1 This test method describes a laboratory procedure for measuring modulus, tear, joint movement ability and adhesion properties of applied, Precured Elastomeric Joint Sealants, hereinafter referred to as “applied seal” and if not applied, hereinafter referred to as “seal,” on portland cement mortar as a standard substrate and or other substrates. It tests these properties after dry, wet, frozen, heat aged or artificially weather-aged conditionings, or both.

1.2 The values stated in SI units are to be regarded as the standard. The values given in parentheses are provided for information only.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

1.4 The committee with jurisdiction over this standard is not aware of any similar standard published by another committee or organization.

1.5 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

### 2. Referenced Documents

#### 2.1 ASTM Standards:<sup>2</sup>

**C717** Terminology of Building Seals and Sealants

**C1375** Guide for Substrates Used in Testing Building Seals and Sealants

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee C24 on Building Seals and Sealants and is the direct responsibility of Subcommittee C24.30 on Adhesion.

Current edition approved June 1, 2017. Published June 2017. Originally approved in 2002. Last previous approved in 2010 as C1523–10. DOI: 10.1520/C1523-17.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

**C1442** Practice for Conducting Tests on Sealants Using Artificial Weathering Apparatus

**D1566** Terminology Relating to Rubber

**G113** Terminology Relating to Natural and Artificial Weathering Tests of Nonmetallic Materials

**G151** Practice for Exposing Nonmetallic Materials in Accelerated Test Devices that Use Laboratory Light Sources

**G154** Practice for Operating Fluorescent Ultraviolet (UV) Lamp Apparatus for Exposure of Nonmetallic Materials

**G155** Practice for Operating Xenon Arc Light Apparatus for Exposure of Non-Metallic Materials

### 3. Terminology

3.1 *Definitions*—Refer to Terminology **C717** for definitions of the following terms used in this test method: adhesive failure, cohesive failure, primer, modulus, and standard conditions and to Terminology **D1566** for tear and to Terminology **G113** for definitions related to artificial weathering.

### 4. Summary of Test Method

4.1 Model joints are prepared, the seal is adhered to the substrate utilizing an adhesive sealant specified by the manufacturer, hereinafter referred to as adhesive, then exposed to a variety of conditionings such as heat, cold, artificial weathering or water immersion. A specific set of specimens can go through each conditioning or separate specimens can be used for each conditioning. After exposure the test specimens are subjected to an elongation (strain) and held at this elongation for as long as is desired. The elongation (joint expansion) is performed with a tensometer to obtain tensile-forces during the pull. One aspect of the test has the applied seal cut in the middle of the joint and then elongated and the degree of tear propagation noted. After the initial strain the samples can be subjected to cycles of repeated strain. The samples can also be tested to destruction. The movement test and tear test can be done on separate sets of test specimens or done sequentially with the same test specimen.

### 5. Significance and Use

5.1 Seals are manufactured in flat extruded shapes and are primarily used to span joint openings. The seal is adhered to construction substrates utilizing a liquid applied adhesive, to

seal building openings such as panel joints, metal flashing joints or other joints in place of conventional liquid applied sealants. In actual use, failure of an applied seal in an active joint is usually manifested by cohesive failure of the seal; adhesive failure between the adhesive and the substrate; adhesive failure between the adhesive and the seal; cohesive failure of the substrate or tear propagation parallel to the joint length.

5.2 This test method can be used for testing the adhesion of the adhesive to the substrate and to the seal, tensile load at various strains and tear resistance at various strains after the specimens are exposed to wet, cold, hot and artificial weathering conditionings. All or some of these properties are experienced on actual job sites.

## 6. Apparatus and Materials

6.1 *Tensile Testing Machine*, capable of producing a tensile load on the specimen at a rate of  $50 \pm 5$  mm ( $2.0 \pm 0.20$  in.)/min., and with a recording chart to show load strain values (tensile modulus).

6.1.1 *Fixed Member*—A fixed or essentially stationary member carrying one grip.

6.1.2 *Movable Member*—A movable member carrying one grip.

6.1.3 *Grips*—The grips should be suitable to firmly grasp the test fixture that holds the test specimen.

6.1.4 *Grip Fixture*—A fixture capable of being held by the grips and furnishing a tensile force to the sealant specimen.

6.2 *Spatulas*, for use in applying the adhesive.

6.3 *Caulking Gun*, for extruding adhesive from cartridges.

6.4 *Primer*, if applicable.

6.5 *Adhesive*.

6.6 *Seal*.

6.7 *Spacer*—Pieces of rigid material that help to maintain a joint opening of 12 mm (0.5 in.) while preparing the test specimen.

6.8 *Substrates*—2 substrate samples are required for each test specimen. The substrate sample size shall be determined by the size of the test machine grips, yet they must be of a size to allow the application of a  $50 \pm 5$  mm ( $2 \pm 0.2$  in.) long seal.

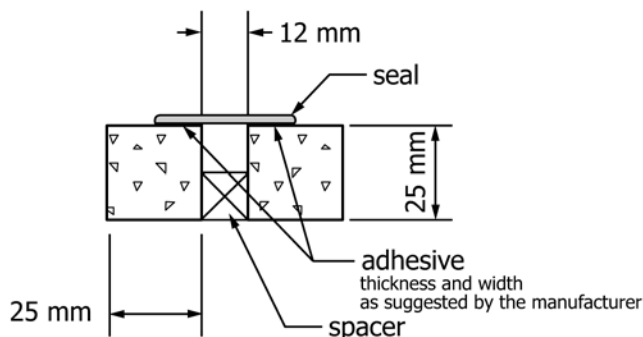


FIG. 1 Standard Substrate Test Specimen Assemblies




FIG. 2 Beveled Bridge Joint Configuration

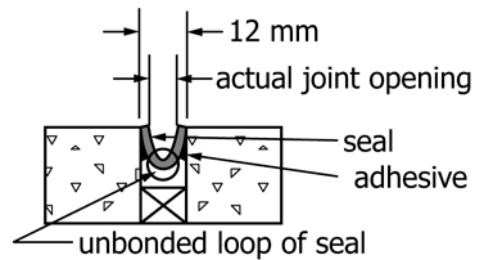


FIG. 3 U-joint Configuration


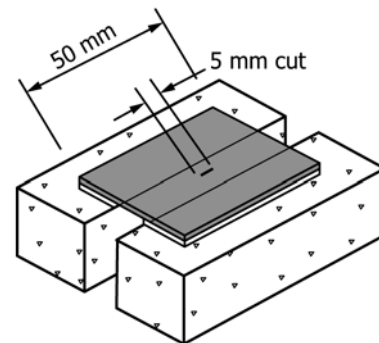




FIG. 4 Test Specimen Showing 5 mm Cut in the Middle of the Seal for Tear Propagation Testing

6.9 *Freezer*,  $-18 \pm 2^\circ\text{C}$  ( $0 \pm 3.6^\circ\text{F}$ ).

6.10 *Oven*,  $70 \pm 2^\circ\text{C}$  ( $158 \pm 3.6^\circ\text{F}$ ).


6.11 *Apparatus*, in accordance with Practice G151 and G154, or G155 and C1442.

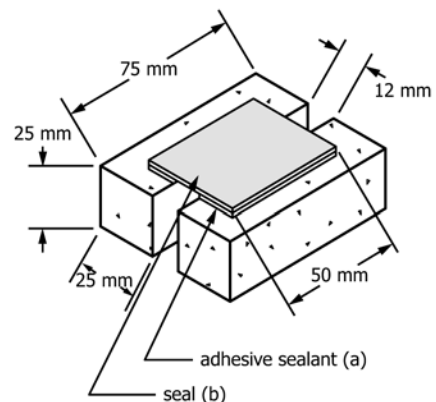

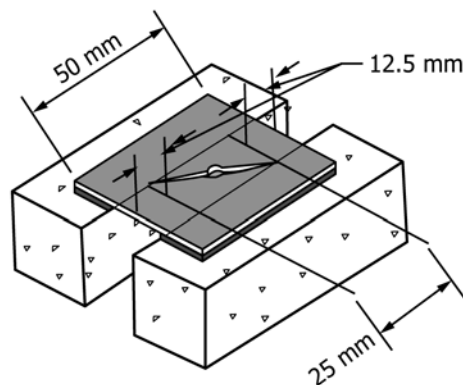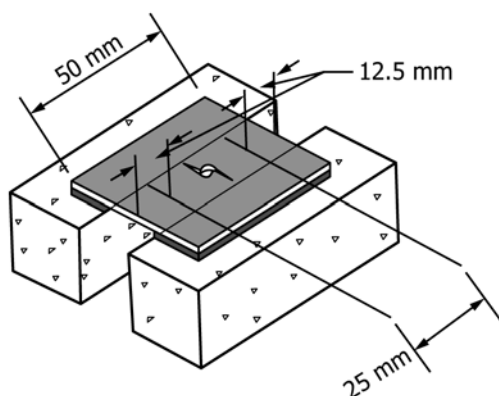

Tear propagates perpendicular to the length of the joint as shown above, left; or at any angle leading to the joint wall as shown above, right. In each case tear stops at the joint wall with an intact unbroken joint length on both sides of at least 12.5 mm.

FIG. 5 Partial Tear

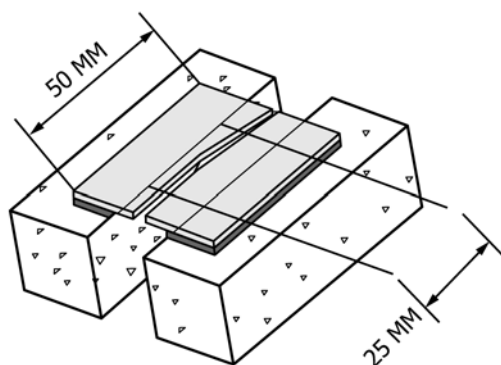

Tear propagates parallel to the joint wall and opens one side or both sides.

FIG. 6 Tear

6.12 *Stencil Knife*, or similar instrument (5 mm cutting width).

## 7. Test Specimen

7.1 The standard joint configuration used in this test method shall be the bridge joint application as shown in Fig. 1.

NOTE 1—Other joint configurations such as beveled bridge joint application and/or U-joint application in place or in addition to the standard joint configuration may be specified for the test with the seal sample. While the beveled bridge joint application (Fig. 2) is similar in function and the calculation of test values to the standard joint configuration, different considerations have to be taken into account with the U-joint application (Fig. 3): (1) The actual joint opening of 12 mm (0.5 in.) will be reduced by the thickness of the seal and the adhesive, and (2) The size of the unbonded loop of the seal determines to a great extent the flexibility and expandability of the seal (Fig. 3).

7.2 Two substrate samples are required for each test specimen assembly as shown in Fig. 1.

7.2.1 *Initial Joint Opening (Width)*—Standard opening (width) for this test is 12 mm (0.5 in.).

NOTE 2—Joint openings other than the standard width may be specified for the test with the seal sample.

7.2.2 *Length of Applied Seal*—Standard length for this test is 50 mm (2 in.).

7.3 The standard substrate used in this test method shall be portland cement mortar.

NOTE 3—Other substrates such as EIFS, brick, wood, aluminum, plastic, metal or other in place or in addition to the standard substrate may be specified for the test with the seal sample. Any substrate other than the standard substrate has to be sized to fit the testing equipment.

7.3.1 *Mortar Block*—Prepare mortar blocks according to Section 7 of Guide C1375.

7.4 *Preparation of Test Specimen*—Condition substrates, adhesive, (and primer if needed) and seal for at least 24 h at standard conditions. Prime the substrate surface if required. Apply the adhesive at a specified thickness and width according to the manufacturers suggestion on the surface of the substrate, next to the joint opening and apply the seal into the wet adhesive according to the manufacturers suggestion while maintaining a joint opening of 12 mm (0.5 in.) as shown in Fig. 1.

NOTE 4—Care must be taken to bring the adhesive neatly to the edge of the test block and extra adhesive should be cleaned of the bridging section of the seal.

NOTE 5—Three test specimen assemblies per condition should be prepared for each substrate and each desired test(s) (Modulus/Adhesion or Tear, or both). It may be beneficial to prepare three extra specimen assemblies in the event one or more samples are unusable.

## 8. Conditioning

8.1 Condition (cure or set up time for adhesive) specimens for 21 days (or for a shorter time if indicated by the manufacturer) at standard conditions.

8.2 Following completion of the cure or set up of the adhesive as outlined in 8.1, test specimen samples after the following separate conditionings:

8.2.1 *Dry/Room Temperature*—Test samples at  $23 \pm 2^\circ\text{C}$  ( $73.4 \pm 3.6^\circ\text{F}$ ).

8.2.2 *Water Immersion*—Completely immerse test specimens in distilled or deionized water for 24 h or any multiple of 24 h at  $23 \pm 2^\circ\text{C}$  ( $73.4 \pm 3.6^\circ\text{F}$ ). Remove specimens one at a time. Start testing each specimen immediately (within one hour) after removal from water.

8.2.3 *Frozen*—Condition specimens in a  $-18 \pm 2^\circ\text{C}$  ( $0 \pm 3.6^\circ\text{F}$ ) freezer for 24 h or any multiple of 24 h. Remove specimens one at a time. Start testing each specimen immediately (start test within 3 min) after removal from the freezer.

NOTE 6—Temperatures lower than noted in 8.2.3 may be specified for the test with the Seal sample.

8.2.4 *Heat*—Condition specimens in a  $70 \pm 2^{\circ}\text{C}$  ( $158 \pm 3.6^{\circ}\text{F}$ ) oven for 24 h or any multiple of 24 h. Remove specimens one at a time. Start testing each specimen immediately (start test within 3 min) after removal from the oven.

NOTE 7—Temperatures higher than noted in 8.2.4 may be specified for the test with the Seal sample.

8.2.5 *Artificial Weathering*—Use apparatus that conforms to the requirements defined in Practice C1442 unless otherwise agreed on or specified. Because of differences in test conditions, test results may differ with the type of device used. Consult Practices G154 and G155 for differences in the spectral power distributions of the exposure sources and Practice C1442 for the differences in test parameters in the two types of apparatus specified. The test cycles have been used by historical convention and may not adequately simulate the effects of outdoor exposure of sealants. Other cycles can be used by mutual agreement of all concerned parties.

8.2.5.1 *Fluorescent UV/Condensation Apparatus*—Operate the device in accordance with the procedure in C1442, Section 7.3.

8.2.5.2 *Xenon Arc Light Apparatus*—Operate the device in accordance with the procedure in C1442, Section 7.2.

8.2.5.3 Position the specimens with the sealant facing the light source at the specified distance from the source. Specimens should be confined to an exposure area in which the irradiance is at least 90 % of the irradiance at the center of the exposure area. Unless it is known that irradiance uniformity meets this requirement, use one of the procedures described in Practice G151, Section 5.1.4 to ensure equal radiant exposure on all specimens or to compensate for differences within the exposure chamber. In devices with rotating specimen racks, fill the empty spaces with blank metal panels in order to properly maintain the test conditions within the exposure chamber.

NOTE 8—Refer to Practice G151 for full cautionary guidance regarding laboratory weathering of nonmetallic materials.

8.2.5.4 The minimum exposure is 2500 h and additional exposure is in 500 h increments in the fluorescent UV/condensation apparatus and in the xenon arc apparatus operated at an irradiance level of  $0.51 \text{ W}/(\text{m}^2 \cdot \text{nm})$  at 340 nm. For xenon arc apparatus operated at another irradiance level, see Annex A1.2 in C1442 for determination of minimum exposure time and additional exposure increments to obtain the same radiant exposure as at an irradiance of  $0.51 \text{ W}/(\text{m}^2 \cdot \text{nm})$  at 340 nm. The exposure duration shall be sufficient to produce a statistically significant change of the property evaluated in a material known to give poor performance when used in the application of interest. After exposure, remove specimens one at a time and start testing each specimen immediately (within one hour).

NOTE 9—Note in test report artificial weathering apparatus used, the irradiance level and actual time (in hours) the specimens were weathered.

## 9. Testing Procedure

9.1 *For Movement, Cohesion and Adhesion (Bond-Line Force) Testing*—Measure and record the actual initial joint opening and length of applied seal prior to loading of test

specimen into equipment. Secure specimen in the grips of the tensile testing machine and extend at a rate of  $50 \pm 5 \text{ mm}$  ( $2 \pm 0.2 \text{ in.}$ )/min to a preset elongation of X %, of the initial joint opening. Where X is 12.5 % or a multiple of 12.5 % and hold for 1 h and or additional 1 h segments. Record the initial tensile load and the tensile load after the holding time at the maximum set elongation. After extension, relax the sample, inspect the tested specimen and measure/record the largest depth of loss of adhesion or cohesion of adhesive or seal, or both, if either occurs.

NOTE 10—When inspecting for loss of adhesion or cohesion of adhesive or seal, or both, this is most easily done by folding back the test assembly to expose the bond line. Failures should be measured to the nearest half millimeter.

9.2 After the inspection of the test specimen secure the same assembly in the grips of the tensile testing machine and extend at a rate of  $50 \pm 5 \text{ mm}$  ( $2 \pm 0.2 \text{ in.}$ )/min until the seal breaks (seal ruptures or 100 % cohesive or adhesive failure of adhesive). Record elongation and load (at peak load).

9.3 Other coincidence points may be recorded as desired.

9.4 *For Tear Propagation Testing*—Follow the same procedure as described in 9.1. Before starting test, make a 5 mm cut in the middle of the seal parallel to the joint wall with a stencil knife or similar instrument (see Fig. 4). Record kind of tear if any (optional document with camera or a sketch and include in report): NT: No Tear; PT: Partial Tear (Fig. 5); T: Tear (Fig. 6).

9.5 Record any type of failure other than those listed.

## 10. Report

10.1 The report shall include the following information for each sample tested:

- 10.1.1 Seal identification.
- 10.1.2 Adhesive identification.
- 10.1.3 Primer identification.
- 10.1.4 Substrate identification.
- 10.1.5 Joint configuration.
- 10.1.6 In case of a U-joint configuration: length of loop.

NOTE 11—The length of the loop can be measured easily with a piece of paper, by aligning the paper on top of the loop, marking the unbonded length and measuring.

- 10.1.7 Actual initial joint opening.
- 10.1.8 Applied bond depth.
- 10.1.9 Applied adhesive thickness.
- 10.1.10 Actual seal length.
- 10.1.11 Actual conditioning.
  - 10.1.11.1 Type, manufacturer and model of artificial weathering apparatus used.
  - 10.1.11.2 Irradiance level and actual time (in hours) in weathering device.

NOTE 12—Refer to Practice G151 for information required in the report section.

- 10.1.12 Actual conditioning time.
- 10.1.13 Surface preparation.
- 10.1.14 *Tensile Adhesion Testing Data*:
  - 10.1.14.1 Tested strain.



10.1.14.2 *Modulus*—Tensile load over length of joint in N/mm (lb/in.) at each segmented elongation point (12.5 %, 25 %, 37.5 %,.....).

10.1.14.3 Percentage loss if any in bond depth at substrate/adhesive interface.

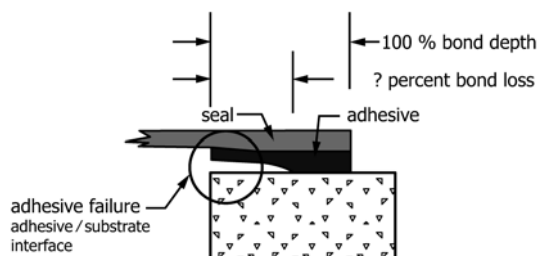


FIG. 7 Percentage Loss, If Any, in Bond Depth at Substrate/Adhesive Interface

10.1.14.4 Percentage loss if any in bond depth at seal/adhesive interface.

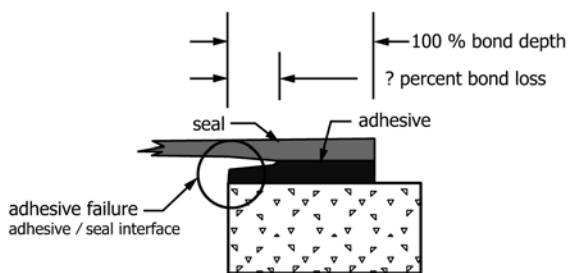


FIG. 8 Percentage Loss, If Any, in Bond Depth at Seal/Adhesive Interface

10.1.14.5 Percentage loss if any in cohesion of adhesive.

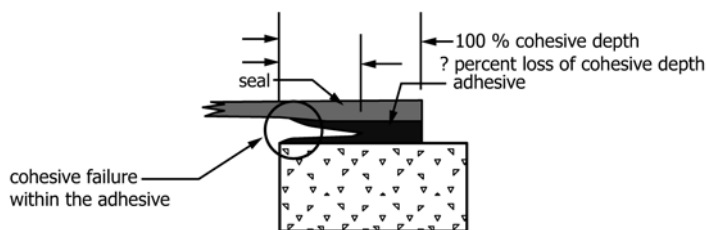


FIG. 9 Percentage Lose, if Any, in Cohesion of Adhesive

10.1.14.6 Kind of tear propagation as described in 9.4.

10.1.14.7 Strain at peak load.

10.1.14.8 Peak tensile load over length of joint in N/mm (lbs/in.).

10.1.15 Describe any substrate failure if any.

10.1.16 Variation, if any, from the test procedure.

## 11. Precision and Bias

11.1 The number of laboratories and materials in this study DOES NOT meet the minimum requirements for determining precision prescribed in Practice E691.

	This Study	ASTM E691 Minimum
Laboratories	3	6
Materials	2	4
Determinations	4	2

11.2 All laboratories used the same precured sealant (same lot no.), the same adhesive sealant (same lot no.) and the same substrate. The actual test specimens were assembled by each laboratory in reference to 7.1. All specimens were conditioned in reference to 8.1 for 7 days as required by the manufacturer and then tested for movement class 200 % elongation as described in the Standard Specification For Precured Elastomeric Silicone Joint Sealants (5.1.1). The actual results are given in Table 1.

11.3 In one test series the three labs tested two sets of three specimens for movement and modulus according to 9.1 and 9.2.

11.4 In another test series the three labs tested two sets of three specimens for tear propagation according to 9.4.

11.5 Laboratory no. 3 tested one set of three specimens of a different product (Note 13) for movement and modulus according to 9.1 and 9.2. This product failed the movement class 200 %E.

11.6 Laboratory no. 3 tested one set of three specimens of a different product (Note 13) for tear propagation according to 9.4. This product failed the movement class 200 %E.

NOTE 13—Different product: precured part made from a commercially available acetoxy cure silicone sealant.

11.7 *Precision Data for:*

11.7.1 *Initial Tensile Load/Length of Specimen at 200 % Elongation (lbs/in.) Precision*, characterized by repeatability, Sr, r, and reproducibility, SR, R has been determined for the materials to be:

Materials	Average	Sr	SR	r	R
A	7.557	0.893	1.072	2.499	3.002
B	product failed 200 % elongation test, no data available				

TABLE 1 Precision and Bias Data from 3 Laboratories (Actual Test Results)

Tensile load over length of joint at 200 %E after 1 h	lbs/in.	5.62	4.63	5.09	5.63	5.00	5.15	fail
Loss of tensile load after 1 h holding time	%	37.63	33.81	29.98	29.60	21.98	28.00	n/a
Loss of adhesion (measured at deepest adhesion loss from the orig. bond-line (at 200 %E))	in.	none	none	none	none	none	none	n/a
Loss of cohesion (measured at deepest cohesion loss from the orig. bond-line (at 200 %E))	in.	none	none	none	none	none	none	n/a
Ultimate elongation (strain at peak load)	%	617.33	665.67	792.33	733.33	638.33	638.67	186.67
Peak tensile load over length of joint	lbs/in.	15.37	14.65	16.11	17.71	17.32	17.60	6.84
Describe kind of tear if any after 1 h holding time at 200 %E		partial tear	partial tear	partial tear	partial tear	partial tear	partial tear	tear

11.7.2 *Tensile Load After 1 h Holding Time /Length of Specimen at 200 % Elongation (lbs/in.) Precision*, characterized by repeatability, Sr, r, and reproducibility, SR, R has been determined for the materials to be:

Materials	Average	Sr	SR	r	R
A	5.243	0.518	0.518	1.451	1.451
B	product failed 200 % elongation test, no data available				

11.7.3 *Ultimate Elongation (%) Precision*, characterized by repeatability, Sr, r, and reproducibility, SR, R has been determined for the materials to be:

Materials	Average	Sr	SR	r	R
A	680.889	83.168	103.837	232.871	290.743
B	186.67	product failed 200 % elongation test			

11.7.4 *Peak Tensile Load/Length of Specimen at Break (lbs/in.) Precision*, characterized by repeatability, Sr, r, and reproducibility, SR, R has been determined for the materials to be:

Materials	Average	Sr	SR	r	R
A	16.629	1.042	1.533	2.916	4.293
B	6.84	product failed 200 % elongation test			

11.7.5 This precision statement is provisional. Within five years, additional data will be obtained and processed which does meet the requirements of Practice E691.

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; <http://www.copyright.com/>*