



# Standard Practice for Determining Air Leakage Rates of Aerosol Foam Sealants and Other Construction Joint Fill and Insulation Materials<sup>1</sup>

This standard is issued under the fixed designation C1642; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope\*

1.1 This practice is intended to determine the air leakage rate of aerosol foam sealants as measured in a standardized jig. This practice provides a procedure for preparing the test apparatus and further describes the application of aerosol foam sealant and other joint fillers to the apparatus prior to conducting Test Method E283.

1.2 This practice allows testing laboratories to quantify the air leakage rate of aerosol foam sealants or joint filling products using Test Method E283 and reporting the data in  $L/(s \cdot m^2)$  according to Practice E29.

1.3 This practice is used in conjunction with Test Method E283. Although Test Method E283 is a laboratory test method used with fenestration products, individuals interested in performing field air leakage tests on installed units should reference Test Method E783 and AAMA 502.

1.4 Aerosol foam sealants are used for a variety of end use applications generally intended to reduce air leakage in the building envelope.

1.5 Insulating type materials also will be found suitable for evaluation with this practice.

1.6 There are no other known practices or test methods that specify the preparation of the assemblies used to determine the air leakage rate of gap filling sealants, dry preformed foams or insulations.

1.7 The values given in SI units are the standard. The inch-pound units in parentheses are for information only.

1.8 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

<sup>1</sup> This practice is under the jurisdiction of ASTM Committee C24 on Building Seals and Sealants and is the direct responsibility of Subcommittee C24.61 on Aerosol Foam Sealants.

Current edition approved Sept. 15, 2014. Published November 2014. Originally approved in 2007. Last previous edition approved in 2007 as C1642-07. DOI: 10.1520/C1642-14.

## 2. Referenced Documents

### 2.1 ASTM Standards:<sup>2</sup>

- C717 Terminology of Building Seals and Sealants
- C1330 Specification for Cylindrical Sealant Backing for Use with Cold Liquid-Applied Sealants
- C1536 Test Method for Measuring the Yield for Aerosol Foam Sealants
- C1620 Specification for Aerosol Polyurethane and Aerosol Latex Foam Sealants
- E29 Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications
- E283 Test Method for Determining Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen
- E783 Test Method for Field Measurement of Air Leakage Through Installed Exterior Windows and Doors

### 2.2 Other Standards:

- AAMA 502 Voluntary Specification for Field Testing of Newly Installed Fenestration Products<sup>3</sup>
- ISO/IEC 17025 General requirements for the competence of testing and calibration laboratories<sup>4</sup>

## 3. Terminology

### 3.1 Definitions:

3.1.1 *air barrier*—the assembly of material(s) used in building construction to reduce or retard the uncontrolled passage of air into and out of the building.

3.1.2 *exfiltration*—air flow direction from building interior toward exterior.

3.1.3 *infiltration*—air flow direction from building exterior toward interior.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

<sup>3</sup> Available from American Architectural Manufacturers Association (AAMA), 1827 Walden Office Square, Suite 550, Schaumburg, IL 60173-4268, <http://www.aamanet.org>.

<sup>4</sup> Available from American National Standards Institute (ANSI), 25 W. 43rd St., 4th Floor, New York, NY 10036, <http://www.ansi.org>.

\*A Summary of Changes section appears at the end of this standard

3.1.4 *preformed dry foam material*—any cellular product designed for filling construction joints to resist air leakage.

3.1.5 *preformed pre-compressed tapes*—any cellular tape supplied compressed from its fully expanded shape and designed for filling construction joints to resist air leakage.

3.1.6 *rough opening gap*—the open space between the building frame and the fenestration product.

3.1.7 *test effective area*—is located at and comprised of gaps between aluminum rectangular tubing with each gap having dimensions of 9.5-mm (0.375-in.) by 864-mm (34-in.) long. A single gap area is 0.008 m<sup>2</sup> (12.75 in.<sup>2</sup>). The total effective area of all five gaps is 0.041 m<sup>2</sup> (63.8 in.<sup>2</sup>).

#### 4. Summary of Practice

4.1 This practice establishes specimen preparation and a test protocol for determining the air leakage rates of aerosol foam sealants per Test Method E283. Calibration of the air leakage test equipment shall be performed by ISO 17025 calibration provider than can validate the flow meter accuracy of  $\pm 1\%$  of reading in the range of 0.05 to 0.02 cfm. Application of foam sealant shall be in accordance with all manufacturer's recommendations and in a manner reflecting in use conditions such as the depth and width of the joint or gap. In the event that the manufacturer's instructions are not available, this practice shall be the default application method for the test material (joint width and depth). The depth and density (use Test Method C1536 for aerosol foam sealant) of the applied material shall be reported in all cases.

NOTE 1—Apply according to manufacturer's recommendations which may include a water spray to surfaces or other special surface preparation.

4.2 This practice references the following material types:

4.2.1 Type I Material (Aerosol Foam Sealants)

- A) Polyurethane
- B) Latex

4.2.2 Type II Material (Preformed dry material)

- A) Closed cell foam
- B) Bi-cellular foam

4.2.3 Type III Material (Batt-Insulation)

- A) Faced
- B) Un-Faced

#### 5. Significance and Use

5.1 This practice is intended to measure air flow through materials used to fill joints found in building construction.

5.2 This practice does not purport to establish all required criteria for the selection of an air barrier assembly. Therefore, the results should be used only for comparison purposes and should not be seen as the equivalent to field installed building systems.

#### 6. Sampling

6.1 One test jig shall be required for each material type.

#### 7. Test Apparatus

7.1 The jig required for testing is shown in Fig. 1 and Fig. 2.

NOTE 2—See Annex A1 for the detailed construction and assembly



FIG. 1 An Assembled Test Jig Apparatus Ready for Joint Filling with a Perimeter Seal Applied in the Wood Test Buck

details of the test apparatus.

#### 8. Sample Preparation

8.1 *General Description*—The test sample is a jig containing five air permeability test areas that consist of joint gaps between aluminum rectangular tubing sections with each having the following dimensions: 9.525-mm (0.375-in.) wide by 863.6-mm (34-in.) long by 101.6-mm (4-in.) deep.

NOTE 3—Cavity length is the distance between the 0.375-in. thick spacer at each end. The extrusions are enclosed by a wooden buck frame comprised of 50.8 by 152.4-mm (2 by 6-in.) dimension lumber (See Annex A1 drawings).

8.2 The buck shall be sealed at all extraneous points with silicon and butyl tape or other appropriate material. This seal shall extend across the termination joint between aluminum tube and the wood buck surround. During assembly of the test specimen, silicon sealant should be applied to both planar faces of the 50.8 by 101.6-mm (2 by 4-in.) aluminum spacers between aluminum rectangular tubing. This will prevent air leakage at spacer locations. The areas within the wood buck that include the aluminum spacers are blocked during testing. This can be done by filling the gap between aluminum rectangular tubing with sealant and covering with impermeable material such as weather resistant tape. See drawings.

8.3 *Applying the Test Material in the Jig:*



NOTE 1—All five (5) test area gaps are shown and filled with test sample foam sealant. Blocked areas are not included for air leakage test.

**FIG. 2 Specimen Mounted into Wood Surround (test buck) – View from Interior Side.**

**8.3.1 Foam Sealant Application**—The foam may be applied in multi passes as desired. Approximately one half of the cavity depth should be filled on the first pass and allowed to cure until the surface is tack free (see Specification C1620 for definition). A sharp knife should be used to trim the foam. Do not attempt to trim the foam until it has cured for 24 h. It is not necessary to trim the cured foam on the exterior side of the joint, however the inside face should be trimmed flush with the aluminum if the foam expands beyond the surface.

NOTE 4—Only one pass or more than two passes is required to fully fill the cavities. Enter this information as a note in the test report. Use Standard Laboratory Conditions for sample preparation and cure of the foam sealant.

**8.3.2 Pre-formed Foam Application**—Cut a continuous length of Type II material measuring 12.7 mm (½ in.) longer than the channel length. Align the cut length with the channel gap to be filled. Carefully use a blunt or round device to push the aligned material into the total length of the 9.525-mm (0.375-in.) gap. If material is punctured, cut, or otherwise damaged during insertion, it shall be removed, discarded, and replaced with a new length of material. Since by design, the cut material length is slightly longer, the ends should be compressed on both ends to provide a tight fit against the spacers and channels. The inserted material (1) shall be between the channel with no visible material protruding to either the interior or the exterior sides, (2) shall provide a continuous contact surface between the channels and spacers, and (3) shall

be positioned at the same depth in the channel with a variance of  $\pm 6.35$  mm (0.25 in.). This procedure applies for each additional continuous length that is positioned in the channel. Reported information shall include the depth of the material into the joint, material cross-sectional dimensions prior to insertion, number of pieces if more than one length of foam is used, length of each piece, and type and class of material, (Type shall be bi-cellular or closed cell per Terminology C717. Class would be C, closed cell or B, bi-cellular per Specification C1330 or other).

**8.3.3 Batt Material Installation**—Cut a continuous length of Type III material measuring 88.9 mm (3.5 in.) by 19.05 mm (0.75 in.) by 1177.73 mm (45.38 in.). The batt material length is 25.4 mm (1.0 in.) longer than the aluminum channel. Align the cut length with the channel gap to be filled. Carefully use a blunt or round device to push the aligned material into the total length of the 9.525-mm (0.375-in.) gap. Ensure specimen completely fills the cavity with no visible material protruding to either the interior or the exterior sides.

## 9. Test Procedure

### 9.1 Air Leakage:

9.1.1 The Test Method E283 extraneous leakage measurement is performed with all test areas blocked. Following extraneous leakage, each of the five gaps is tested independently of the other gaps. Gaps which are not included in air leakage are blocked with weather-resistant tape. Following the

individual gap leakage tests, conduct a leakage test with all five gaps exposed simultaneously.

9.1.2 The air leakage testing procedure shall be conducted in accordance with Test Method **E283**. A minimum pressure differential of 75 Pa is required when testing air barrier products and aerosol foam sealants. Higher test pressures may be necessary for air leakage evaluation of aerosol foam sealants when implemented with fenestration products (window, storefront, curtain wall, doors).

9.1.3 *Results*—The rate of air leakage for both exfiltration and infiltration shall be reported as: litres/second/square meter, that is, L/s/m<sup>2</sup> (ft<sup>3</sup>/min/ft<sup>2</sup>) and litres/second/linear metre, that is, L/s/m (ft<sup>3</sup>/min/ft).

NOTE 5—The interior side of test specimen has the 1.5-in. recess between the buck mounting surface and the aluminum rectangular tubing.

## 10. Calculation

10.1 The total air leakage rate ( $Q_s$ ) for the test specimen shall be expressed in terms of airflow at standard conditions using the following equations:

$$Q_s = Q_t/A$$

air leakage in terms of cfm per surface area of one joint. Algebraic sum of all five joint's leakage rate is the total air leakage based on surface area for all test joints.

$$Q_l = Q_t/l$$

air leakage in terms of cfm per one joint length. Algebraic sum of all five joints is the total air leakage in terms of total length of all joints.

where:

- $G_1$  = a single gap surface area is 0.008 m<sup>2</sup> (12.75 in.<sup>2</sup>)
- $G_5$  = the total surface area of all five gaps is 0.041 m<sup>2</sup> (63.8 in.<sup>2</sup>)
- $Q_s$  = air leakage rate for test specimen, L/s/m<sup>2</sup> (ft<sup>3</sup>/min/ft<sup>2</sup>) of gap surface area
- $Q_l$  = air leakage rate for test specimen, L/s/m (ft<sup>3</sup>/min/ft) of gap length
- $Q_t$  = net Test Method **E283** air leakage test result

- $A$  = surface area of one joint gap: 0.00822 m<sup>2</sup> (0.089 ft<sup>2</sup>)
- $l$  = length of one specimen joint: 0.864 m (2.83 ft)

## 11. Report

### 11.1 General Requirements:

- 11.1.1 Complete product name and model number of product tested,
- 11.1.2 Manufacturer's name,
- 11.1.3 Manufactured date or expiration date, or both, when provided,
- 11.1.4 Test initiation date,
- 11.1.5 The number of foam beads or number of strips or pieces used, or both, to fill the jig,
- 11.1.6 Label net weight if provided, and
- 11.1.7 Specify depth and size of preformed foam specimens used to fill the jig apparatus.

11.2 A statement indicating that the test method used was in accordance with ASTM C1642.

11.3 The test pressure and results of the air leakage rate to be reported in units of L/s/m<sup>2</sup> (ft<sup>3</sup>/min/ft<sup>2</sup>) and L/s/m (ft<sup>3</sup>/min/ft)

11.4 Test results to include test specimen joint surface area and joint length for each test joint and total area

11.5 Test results include leakage for each joint and total leakage of all five joints.

11.6 Any modifications or deviations from this practice should be reported.

## 12. Precision and Bias

12.1 The precision and bias of this practice has not been determined.

## 13. Keywords

13.1 aerosol; aerosol foam; air barrier; air barrier foam sealant; air exfiltration; air infiltration; air leakage; air permanence; door; fenestration; insulation materials; latex foam sealant; polyurethane foam sealant; window

# ANNEX

## A1. CONSTRUCTION AND ASSEMBLY

### A1.1 Detailed Construction Drawings for the Test Apparatus (Test Buck):

A1.1.1 See **Figs. A1.1-A1.3**.

### A1.2 Construction of the Test Buck:

#### A1.2.1 Materials List for Building Test Buck:

(1) Two pieces of nominal 2 by 6-in. dimension lumber with dimensions of 38 mm (1.5 in.) by 140 mm (5.5 in.) by 2438 mm (8 ft).

(2) One piece stock pine. Dimensions: 25.4 mm (1.0 in.) by 50.8 mm (2.0 in.) by 2438.4 mm (8 ft).

(3) Sixteen #8 drywall screws 50.80 mm (2 in.).

(4) Eight #8 drywall screws 31.75 mm (1¼ in.).

(5) Extrusion type sealant (silicone caulking) or self-adhering flashing tape adequate to seal the test assembly's non-test areas.

(6) Two 10–24 threaded rods, four 10–24 washers and four 10–24 nuts.

(7) Ten aluminum shims, thickness: 9.525-mm (0.375-in.) thick, by 50.8 mm (2 in.) by 101.6 mm (4 in.).

(8) Six 1152.5-mm (45.4-in.) long sections of T52 6063 aluminum 50.8-mm (2-in.) by 101.6-mm (4-in.) rectangular tubing with 3.175-mm (0.125-in.) wall.

#### A1.2.2 Tools Required:

(1) Industrial drill press.

(2) Portable or plug-in drill.

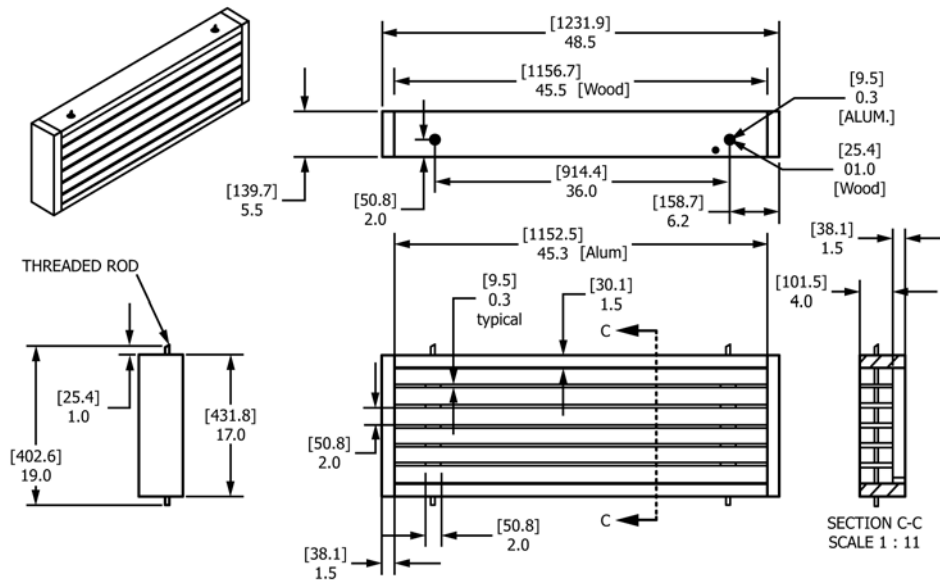


FIG. A1.1 Detailed Construction Drawings for the Test Apparatus (Test Buck)

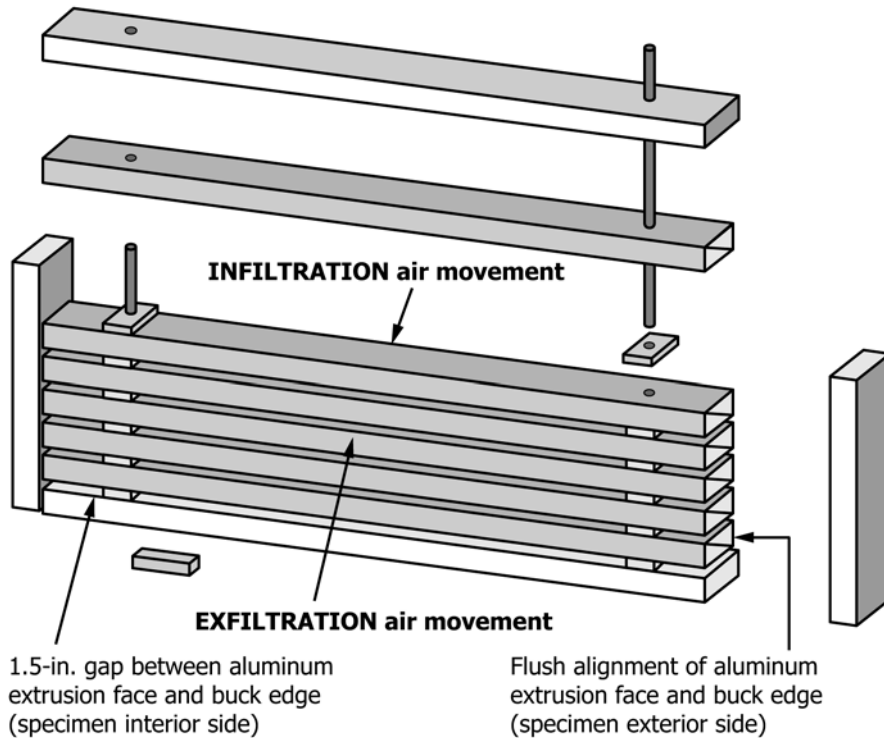


FIG. A1.2 Test Buck – Exploded Assembly

- (3) Table saw.
- (4) Caulk gun.
- (5) 44.45-mm hole saw.
- (6) 3.175-mm drill bit (for pilot holes on buck)
- (7) horizontal band saw.

#### A1.2.3 Special Equipment Required for Testing—

- (1) Test Method E283 Test Apparatus.

#### A1.2.4 Method of Construction for Test Specimen—

##### A1.2.5 Frame Construction:

(a) Cut nominal 50.4 by 151.2-mm (2 by 6-in.) dimension lumber to a length of 1.15 m (45.5 in.).

(b) Cut 2nd framing member to a length of 1.15 m (45.5 in.).

(c) For head and sill pieces cut lengths at 355.6 mm (14.0 in.).

(d) Frame up three sides leaving one 1.15 m (45.4 in.) length unassembled.

(e) Continue to assemble substrate section as indicated below.

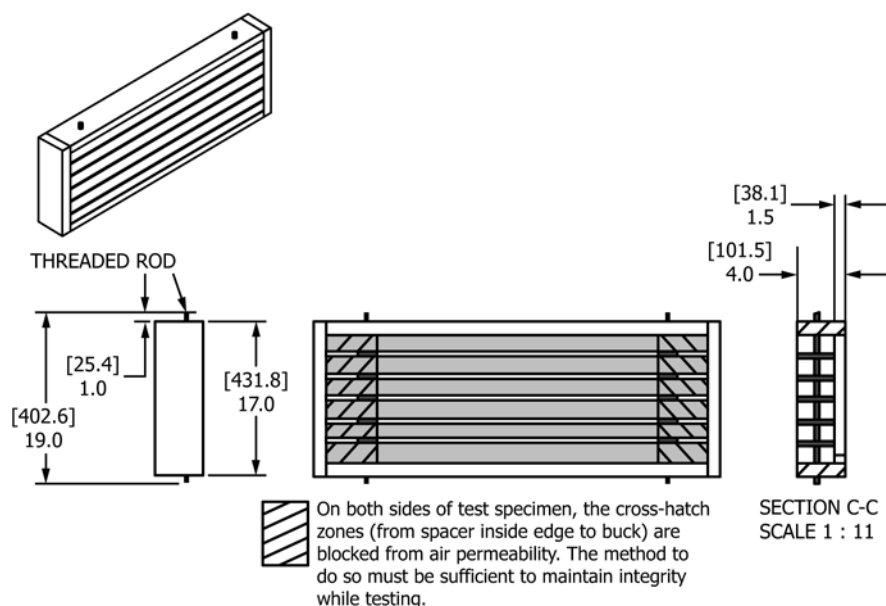


FIG. A1.3 Front View – Assembled Test Buck

#### A1.2.6 Substrate Construction:

(a) On a horizontal band saw, cut six aluminum rectangular tubing substrates to 1152.5-mm (45.4-in.) length.

(b) After the four substrates are cut to 1152.5 mm (45.4 in.) length, it is vital that they fit inside the nominal 2 by 6 dimension lumber frame. Place the assembled wood frame so the nominal 50.8 mm (2 in.) frame side is flat on the table. Do not fasten the last jamb buck section yet, but assemble the wood framing so the six aluminum rectangular tubing sections fit inside the buck.

(c) Cut four 101.6-mm (4-in.) sections from the nominal 2438-mm (8-ft) long 25.4 by 50.8-mm (1 by 2-in.) SPF dimension lumber.

(d) Fasten the 101.6-mm (4-in.) piece of pine in a manner to secure aluminum substrates. (See Fig. A1.2)

(e) Drill and assemble aluminum rectangular tubing sections according to exploded assembly drawing (Fig. A1.2). Seal between each spacer and aluminum substrate.

## SUMMARY OF CHANGES

Committee C24 has identified the location of selected changes to this standard since the last issue (C1642-07) that may impact the use of this standard.

- (1) Updated definitions, calibration and accuracy requirements of air flow meter, surface preparation. Clarified test area, added test with all five gaps measured simultaneously, modified drawings with additional details, added photograph.
- (2) Expanded test pressure range to suitable levels depending on purpose for testing.

- (3) Units of measure expressed as metric and in.-lb equivalent throughout.
- (4) Standard conditions are referenced to Terminology C717.
- (5) Additional detail was added to Annex A1 test specimen construction drawings.

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or [service@astm.org](mailto:service@astm.org) (e-mail); or through the ASTM website ([www.astm.org](http://www.astm.org)). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; <http://www.copyright.com/>*