



## Standard Test Methods for Asbestos-Cement Pipe<sup>1</sup>

This standard is issued under the fixed designation C500/C500M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

<sup>ε1</sup> NOTE—Units information was editorially corrected in January 2012.

### 1. Scope

1.1 These test methods cover the testing of asbestos-cement pipe for hydrostatic strength, flexural strength, crushing strength, straightness, and uncombined calcium hydroxide; they are for use in conjunction with the individual product specifications for asbestos-cement pipe.

1.2 Test methods appear in the following sections:

	Section
Hydrostatic Pressure Test	4
Flexural Test	5
Crushing Test	6
Straightness Test	7
Uncombined Calcium Hydroxide Test	8

1.3 Guidelines for internal and external corrosion included in Section 9 serve as an aid in determining the type of pipe which should be specified to maximize service life for a particular application.

1.4 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.5 **Warning**—Breathing of asbestos dust is hazardous. Asbestos and asbestos products present demonstrated health risks for users and for those with whom they come into contact. In addition to other precautions, when working with asbestos-cement products, minimize the dust that results. For information on the safe use of chrysotile asbestos, refer to “Safe Use of Chrysotile Asbestos: A Manual on Preventive and Control Measures.”<sup>2</sup>

1.6 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appro-*

*priate safety and health practices and determine the applicability of regulatory limitations prior to use. For a specific safety hazard, see 1.5.*

### 2. Referenced Documents

2.1 *ASTM Standards:*<sup>3</sup>

D1067 Test Methods for Acidity or Alkalinity of Water

D1126 Test Method for Hardness in Water

D2946 Terminology for Asbestos and Asbestos-Cement Products

E11 Specification for Woven Wire Test Sieve Cloth and Test Sieves

E200 Practice for Preparation, Standardization, and Storage of Standard and Reagent Solutions for Chemical Analysis

2.2 *BNQ Standard:*

BNQ 3807-098 Vulcanized Rubber: Hardness Determination<sup>4</sup>

2.3 *Other Standard:*

Regulation No. 3, Formula for Completely and Specifically Denatured Alcohol<sup>5</sup>

### 3. Terminology

3.1 *Definitions of Terms Specific to This Standard:*

3.1.1 *crushing strength*—a property of solid material that indicates its ability to withstand collapse from external compressive loads.

3.1.1.1 *Discussion*—Consider failure of the crushing test to have taken place when, as a result of application of the crushing load to the pipe during the test, a break occurs in the pipe before reaching the minimum crushing load designated in the specification.

3.1.2 *flexural strength*—the ability of a standard pipe longitudinal section to withstand external loads that bear on the pipe transversely to its longitudinal axis and induce bending.

<sup>1</sup> These test methods are under the jurisdiction of ASTM Committee C17 on Fiber-Reinforced Cement Products and are the direct responsibility of Subcommittee C17.03 on Asbestos - Cement Sheet Products and Accessories.

Current edition approved Nov. 1, 2011. Published January 2012. Originally approved in 1963. Last previous edition approved in 2007 as C500–07. DOI: 10.1520/C0500\_C0500M-07R11E01.

<sup>2</sup> Available from The Asbestos Institute, [http://www.chrysotile.com/en/sr\\_use/manual.htm](http://www.chrysotile.com/en/sr_use/manual.htm).

<sup>3</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

<sup>4</sup> Bureau de Normalisation du Québec, Department of Industry and Commerce, 50 St. Joseph St. East, Quebec, QC, Canada G1K 3A5.

<sup>5</sup> Published by the US Treasury Department, Bureau of Industrial Alcohol, Washington, DC.

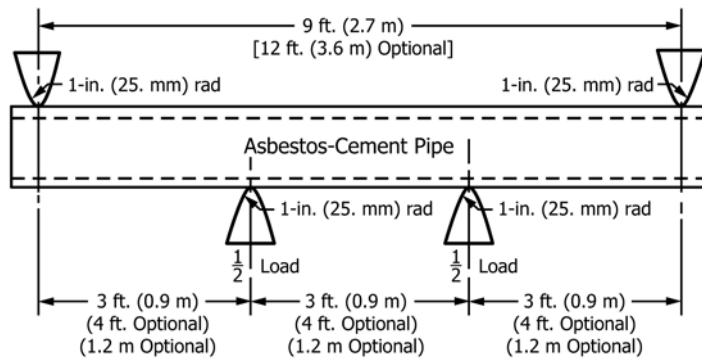


FIG. 1 Assembly for Flexural Strength Test

3.1.3 *hydrostatic strength*—the ability of the pipe and coupling sleeve to withstand the forces resulting from internal pressure.

3.1.4 *uncombined calcium hydroxide*—the content of unreacted calcium hydroxide that remains in the sample of cured product when tested.

NOTE 1—See Terminology D2946 for additional terms.

#### 4. Hydrostatic Pressure Test

4.1 *Significance and Use*—The hydrostatic pressure test establishes the fact that the pipe has sufficient strength to withstand the hydrostatic pressure loads stated in the specifications. The strength level required by the specifications assures, with a reasonable or designed margin of safety, minimum strengths that will satisfactorily withstand the magnitude of internal operating and surge pressures that are normally encountered in field service.

##### 4.2 Procedure:

4.2.1 Place the pipe, coupling, or pipe and coupling with a factory-assembled joint, in a hydrostatic pressure testing machine with gaskets that seal the ends but exert no end pressure. Expel all air, and apply the internal water pressure at a uniform rate of not less than 690 kPa/s [100 psi/s] nor more than 10 MPa/s [1500 psi/s] to the specified pressure; maintain the pressure.

4.2.1.1 Couplings may be tested separately with a rubber bladder inside of the coupling.

4.2.2 Consider failure of the hydrostatic pressure test to have taken place when the pipe or coupling fails to sustain the test pressure for the 5-s period.

#### 5. Flexural Test

5.1 *Significance and Use*—The flexural test establishes the fact that the pipe has sufficient strength to withstand the flexural bending loads stated in the specifications. Provided that proper bedding methods are employed by the installer, the strength level required by the specifications assures minimum strengths that will satisfactorily withstand the magnitude of transverse bending loads normally encountered in field service.

##### 5.2 Procedure:

5.2.1 Support the pipe in a flexural testing machine over a clear span of 2.75 m [9 ft]. Distribute the load equally, and apply the load at the third points of the clear span as indicated

in Fig. 1. Unless otherwise specified, it shall be optional with pipe lengths in excess of 3.8 m [12.5 ft] to test at 75 % of the specified loads on supports 3.65 m [12 ft] apart. Apply the load at a uniform rate between 1.1 and 10 kN/s [250 and 2300 lbf/s] until it equals the proof load specified; maintain this load for at least 5 s.

5.2.2 Consider failure of the flexural proof test to have taken place when, as a result of application of the flexural load to the pipe during the test, a break occurs in the pipe either before reaching the minimum flexural load that is designated in the specification or while holding at that minimum flexural load.

#### 6. Crushing Test

6.1 *Significance and Use*—The crushing test establishes the fact that the pipe has sufficient strength to withstand the crushing loads stated in the specifications. Provided that proper bedding methods are employed by the installer, the strength level required by the specifications ensures minimum strengths that will, with a reasonable margin of safety, satisfactorily withstand the magnitude of external crushing loads normally encountered in field service.

##### 6.2 Procedure:

###### 6.2.1 V-Shaped Three Edge Bearing Method:

6.2.1.1 Test each specimen by the V-shaped bearing method as indicated in Fig. 2.

6.2.1.2 The lower press-block consists of a V-shaped support that has an included angle of 2.6 rad (150°) and is made of metal or hardwood. Interpose strips of rubber of the thickness and width specified in 6.2.1.3 between the press-block and the test piece.

6.2.1.3 The rubber strips shall be  $16 \pm 3$  mm [ $0.625 \pm 0.125$  in.] thick and have a hardness between 50 and 68 DIDC (45 and 65 Shore A durometer)<sup>6</sup> as specified in BNQ 3807-098.

6.2.1.4 The flat upper press-block, made of the same material as the lower press-block, shall have a minimum width of 15 cm [6 in.]. Interpose a strip of rubber of the thickness and hardness specified in 6.2.1.3 between the press-block and the test piece.

<sup>6</sup> DIDC Means Degré International de Dureté des Caoutchoucs (International Degrees for Hardness of Rubbers).

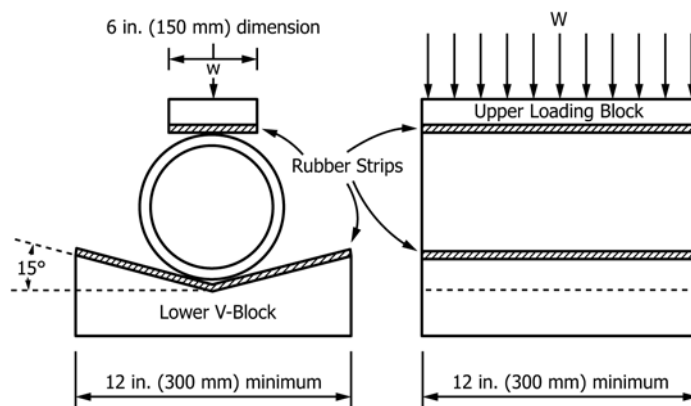


FIG. 2 Assembly for V-Shaped Crushing Strength Test

## 7. Straightness Test

**7.1 Significance and Use**—The straightness test covers the measurement of the maximum deviation from straightness of a standard length of asbestos-cement pipe.

**7.2 Procedure**—Determine the outer diameter of each pipe at both ends and in the middle (the middle diameter is generally greater). Calculate the differences in outer diameter between each end and the middle. Either with a rigid straightedge that exceeds the pipe length and is placed in contact with one end of the pipe, or, on a plane surface upon which the pipe is rolled, measure the maximum ordinate between the exterior surface of the pipe and the reference plane. Correct this measurement for the differences in outer diameter determined between the middle and each end of the pipe to obtain a deviation from straightness. Perform the straightness determination over the entire perimeter of the pipe, and note the maximum deviation from straightness determined.

## 8. Uncombined Calcium Hydroxide Test

**8.1 Significance and Use**—The uncombined calcium hydroxide test method covers the measurement of the amount of uncombined calcium hydroxide in asbestos-cement pipe in order to establish the fact that the pipe has the required chemical resistance. Guidelines for resistance to internal and external corrosion are given in Section 9.

### 8.2 Reagents (Analytical Grade Reagents):

8.2.1 Follow directions in Practice E200.

8.2.2 **Solution No. 1**—For each sample prepare approximately 500 cm<sup>3</sup> of solution containing 150 cm<sup>3</sup> of acetoacetic ester and 350 cm<sup>3</sup> of absolute ethyl alcohol. (See 2.3.)

8.2.3 **Solution No. 2**—For each sample prepare approximately 100 cm<sup>3</sup> of solution containing 1 g of NaOH and 100 cm<sup>3</sup> of absolute ethyl alcohol.

8.2.4 **Solvent for Extraction of Free Lime**—For each sample prepare around 500 cm<sup>3</sup> of solvent containing approximately 500 cm<sup>3</sup> of solution No. 1 and 1 cm<sup>3</sup> of solution No. 2.

8.2.5 **Rinsing Solvent**—Some 250 cm<sup>3</sup> of isobutyl alcohol are required per sample.

### 8.2.6 Titrating Agent:

8.2.6.1 For each sample, prepare approximately 250 cm<sup>3</sup> of titrating agent containing 4.1 cm<sup>3</sup> of 72 % perchloric acid or

6.823 g of solid perchloric acid (HClO<sub>4</sub>·2H<sub>2</sub>O) in 200 cm<sup>3</sup> of isobutyl alcohol, and make up the volume to 250 cm by adding isobutyl alcohol.

8.2.6.2 Standardize the titrating agent by titration against standardized potassium biphthalate such as potassium hydrogen phthalate primary standard (such as Fisher P243) COOKHOCOC<sub>6</sub>H<sub>4</sub> after having lightly ground the latter and dried it at 120°C for 2 h. Refer to Practice E200.

### 8.2.7 Indicator:

8.2.7.1 Use a mixture of equal parts of methylene blue solution C<sub>16</sub>H<sub>18</sub>CIN<sub>3</sub>S·3H<sub>2</sub>O (such as Fisher A-766), with thymol blue or (α)-hydroxy-(α), bis(5hydroxycarvacryl)æptoluenesulfonic acid (such as Fisher T-416), or C<sub>6</sub>H<sub>4</sub>SO<sub>2</sub>OC [C<sub>6</sub>H<sub>2</sub>-2-CH<sub>3</sub>-4-OH-5CH(CH<sub>3</sub>)<sub>2</sub>]<sub>2</sub>.

8.2.7.2 Prepare the methylene blue solution by dissolving 0.05 % of the reagent in the ethanol.

8.2.7.3 Prepare the thymol blue solution by dissolving 0.1 g of the reagent in 10.75 cm<sup>3</sup> of 0.02 NaOH and diluting to 250 cm<sup>3</sup> by adding water.

8.2.7.4 Prepare the indicator by adding 1 cm<sup>3</sup> of the methylene blue solution to 4 cm<sup>3</sup> of the thymol blue solution.

### 8.3 Procedure:

8.3.1 Prepare representative samples of pipe or sleeves, and immediately screen them through a 149-µm (No. 100) sieve as described in Specification E11. The specimen must be ground sufficiently so that all of it will pass through the sieve. However, avoid excessive grinding since this may change the state of carbonation and the rate of reaction of the specimen and lead to erroneous results. Optimum grinding is achieved if at least 5 % of the specimen is retained on a 125-µm (No. 120) sieve described in Specification E11. Immediately place the material passing the sieve into a weighing bottle, and cover with its ground-glass top. (**Warning**—see 1.5.)

8.3.2 Place the bottle, with top removed, in a drying oven at 105°C [220°F] for 2 h, and then cool in a desiccator to room temperature.

8.3.3 Weigh out four specimens of 1 ± 0.010 g of the dried sample from a pipe or sleeve to the nearest 0.001 g.

8.3.4 Place each specimen in an evaporation flask fitted with a condenser and a TFE-fluorocarbon encapsulated stirring bar, add 100 cm<sup>3</sup> of the solvent described in 8.2.4 to each flask and

heat the evaporators for the following time periods: First specimen—30 min; second specimen—60 min; third specimen—90 min; and fourth specimen—120 min. After the extraction of each specimen cool the flask and filter the contents rapidly on a fritted glass funnel.

8.3.5 Wash each filter cake with 50 cm<sup>3</sup> of isobutyl alcohol.

8.3.6 Titrate the filtrate with the titrating agent described in 8.2.6 and the indicator described in 8.2.7.4 until the color changes from light green to dark blue.

8.3.7 Carry out a blank extraction without any specimen, add 50 cm<sup>3</sup> of isobutyl alcohol and titrate as described in 8.3.4 to 8.3.6 to determine the correction applicable to take into account the addition of the NaOH in solution No. 2.

8.3.8 Calculate the number of equivalents of Ca(OH)<sub>2</sub> for each specimen and the percentage of Ca(OH)<sub>2</sub> initially present in each specimen.

#### 8.4 Calculation:

8.4.1 Plot the values of Ca(OH)<sub>2</sub> calculated for each sample as a function of extraction duration (30, 60, 90 or 120 min) and extrapolate the graph to zero time.

8.4.2 Report the content of Ca(OH)<sub>2</sub> indicated by the graph at zero time as the average content of free lime in the sample.

## 9. Guidelines for Internal and External Corrosion

9.1 *Scope*—This test method establishes guidelines for the definition and classification of aggressive water and soil environments. The guidelines are based on exposure within the temperature range of 4 to 27°C [40 to 80°F]. For pipe exposures to temperatures beyond these limits, consult the manufacturer.

9.2 *Summary of Test Method*—The factors that cause aggressive environments, internal and external waters, external soil conditions, and soluble sulfate contents of waters and soils, are considered separately even though they may exist in combination.

9.3 *Significance and Use*—Guidelines for internal and external corrosion of asbestos-cement pipe are included in this specification solely for the purpose of helping users evaluate the useful service life of asbestos-cement pipe under various soil and water conditions. If either water or soil corrosion guidelines are not adhered to, some decrease in useful service life can be expected; when the guidelines are followed, experience has shown that a satisfactory life can be expected for the pipe.

9.4 *Corrosion Guidelines for Water Transported Through Asbestos-Cement Pipe:*

9.4.1 *Aggressivity Index*—A measure of the corrosivity of water towards asbestos-cement, defined as follows:

$$\text{pH} + \log(AH) \quad (1)$$

where:

- pH = negative of the logarithm of the hydronium molarity, (index of acidity of the water), pH units,  
 A = total alkalinity, ppm as CaCO<sub>3</sub> as determined by Test Methods D1067 and  
 H = calcium hardness, ppm as CaCO<sub>3</sub> as determined by Test Method D1126.

NOTE 2—The aggressiveness of water towards asbestos-cement is classified as follows:

Highly aggressive	Aggressivity index < 10.0
Moderately aggressive	Aggressivity index = 10.0 to 11.9
Nonaggressive	Aggressivity index ≥ 12.0

9.4.2 *Type of Asbestos-Cement Pipe for Use with Aggressive Waters*—The following table shows the type of asbestos-cement pipe to be used with aggressive waters as classified in Note 2:

Water	Pipe Recommended
Highly Aggressive	A
Moderately Aggressive	Type II
Nonaggressive	Type I and II

<sup>A</sup> The serviceability of asbestos-cement pipe for such applications should be established by the purchaser in conjunction with the manufacturer.

NOTE 3—Both ASTM Types I and II asbestos-cement pipe may be used where the amount of uncombined calcium hydroxide is unspecified, but is generally considered to exceed 1 %. Only ASTM Type II asbestos-cement pipe should be used where the amount of uncombined calcium hydroxide specified does not exceed 1.0 %.

9.5 *Corrosion Guidelines for Acidic Soils External to Asbestos-Cement Pipe*—The following table establishes guidelines, based upon minimum pH factors alone, for the use of asbestos-cement pipe in acidic soils. Asbestos-cement pipe may or may not perform satisfactorily in acidic soil environments that have pH values below those listed in the table. To determine the suitability of asbestos-cement pipe in soils that have lower pH values, evaluate each situation individually, taking into consideration all aspects of the soil environment that affect its corrosiveness to asbestos-cement pipe:

Water Conditions Within Soil Environment	pH of Acidic Soils When Using Asbestos Cement Pipe, min	
	Type I	Type II
Essentially quiescent	5.0	4.0
Mildly fluctuating	5.5	5.0
Rapidly moving or grossly cyclic	6.3	5.5

9.6 *Corrosion Guidelines for Soluble Sulfate in Water and Soils:*

9.6.1 The following table classifies aggressiveness to asbestos-cement pipe of soluble sulfates found in water and soils.

Sulfate Aggressiveness	SO <sub>4</sub> in Water, ppm	SO <sub>4</sub> in Soil, ppm
Nonaggressive	150 and less	1000 and less
Mildly aggressive	150 to 1500	1000 to 2000
Moderately aggressive	1500 to 10 000	2000 to 20 000
Highly aggressive	10 000 and above	20 000 and above

9.6.2 The chemical resistance of asbestos-cement pipe to soluble sulfates found in water and soils is as follows: Type I pipe will be attacked to various degrees by all but the nonaggressive levels of sulfate concentrations in waters and soils.<sup>7</sup> Type II pipe resistant to all levels of soluble sulfates

## 10. Keywords

10.1 asbestos; asbestos-cement; asbestos-cement pipe; pipe

<sup>7</sup> Guidelines for sulfate resistance of portland cement products were taken from the *Concrete Manual*, Bureau of Reclamation, 8th ed., 1975. Sulfate resistance here applies to all soluble sulfates, regardless of cation.

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or [service@astm.org](mailto:service@astm.org) (e-mail); or through the ASTM website ([www.astm.org](http://www.astm.org)). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; <http://www.copyright.com/>*