



Standard Specification for Building Brick (Solid Masonry Units Made From Clay or Shale)¹

This standard is issued under the fixed designation C62; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the U.S. Department of Defense.

1. Scope*

1.1 This specification covers brick intended for both structural and nonstructural masonry where external appearance is not a requirement. The brick are prismatic units available in a variety of sizes, shapes, textures, and colors. The specification does not cover brick intended for use as facing units or where surface appearance is a requirement. If brick are required to have a particular color, texture, finish, uniformity, or limits on cracks, warpage, or other imperfections detracting from the appearance they are purchased under Specification C216. This specification does not cover brick intended for use as paving brick (see Specification C902).

1.2 The property requirements of this standard apply at the time of purchase. The use of results from testing of brick extracted from masonry structures for determining conformance or nonconformance to the property requirements (Section 4) of this standard is beyond the scope of this standard.

1.3 Brick are manufactured from clay, shale, or similar naturally occurring earthy substances and subjected to a heat treatment at elevated temperatures (firing). The heat treatment must develop sufficient fired bond between the particulate constituents to provide the strength and durability requirements of this specification (see Terminology C1232).

1.4 Brick are shaped during manufacture by molding, pressing, or extrusion, and the shaping method is a way to describe the brick.

1.5 The text of this standard references notes and footnotes which provide explanatory material. These notes and footnotes (excluding those in tables and figures) shall not be considered as requirements of the standard.

1.6 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical

conversions to SI units that are provided for information only and are not considered standard.

2. Referenced Documents

2.1 ASTM Standards:²

C67 Test Methods for Sampling and Testing Brick and Structural Clay Tile

C216 Specification for Facing Brick (Solid Masonry Units Made from Clay or Shale)

C902 Specification for Pedestrian and Light Traffic Paving Brick

C1232 Terminology of Masonry

3. Terminology

3.1 *Definitions*—For definitions relating to building brick, refer to Terminology C1232.

4. Classification

4.1 Grades classify brick according to their resistance to damage by freezing when wet, as defined in Note 1. Three grades are covered and the grade requirements are shown in Table 1.

4.1.1 *Grade SW (Severe Weathering)*—Brick intended for use where high and uniform resistance to damage caused by cyclic freezing is desired and where the brick may be frozen when saturated with water.

4.1.2 *Grade MW (Moderate Weathering)*—Brick intended for use where moderate resistance to cyclic freezing damage is permissible or where the brick may be damp but not saturated with water when freezing occurs.

4.1.3 *Grade NW (Negligible Weathering)*—Brick with little resistance to cyclic freezing damage but which are acceptable for applications protected from water absorption and freezing.

NOTE 1—The word “saturated,” with respect to this standard, refers to the condition of a brick that has absorbed water to an amount equal to that resulting from submersion in room temperature water for 24 h.

¹ This specification is under the jurisdiction of ASTM Committee C15 on Manufactured Masonry Units and is the direct responsibility of Subcommittee C15.02 on Brick and Structural Clay Tile.


Current edition approved Dec. 1, 2013. Published December 2013. Originally approved in 1927. Last previous edition approved in 2013 as C62 – 13. DOI: 10.1520/C0062-13A.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

TABLE 1 Physical Requirements

Designation	Minimum Compressive Strength gross area, psi (MPa)		Maximum Water Absorption by 5-h Boiling, %		Maximum Saturation Coefficient ^A	
	Average of 5 Brick	Individual	Average of 5 Brick	Individual	Average of 5 Brick	Individual
Grade SW	3000 (20.7)	2500 (17.2)	17.0	20.0	0.78	0.80
Grade MW	2500 (17.2)	2200 (15.2)	22.0	25.0	0.88	0.90
Grade NW	1500 (10.3)	1250 (8.6)	no limit	no limit	no limit	no limit

^A The saturation coefficient is the ratio of absorption by 24-h submersion in cold water to that after 5-h submersion in boiling water.

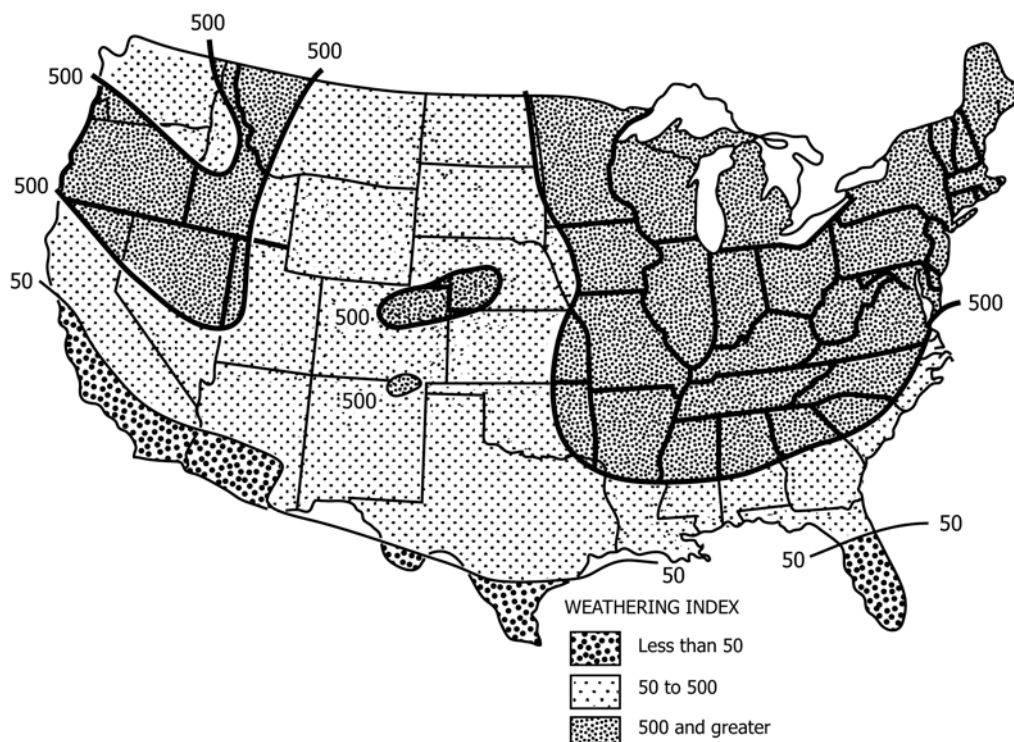

Grade Recommendations for Face Exposures

Exposure	Weathering Index		
	Less than 50	50 to 500	500 and greater
In vertical surfaces:			
In contact with earth	MW or SW	SW	SW
Not in contact with earth	MW or SW	SW	SW
In other than vertical surfaces:			
In contact with earth	SW	SW	SW
Not in contact with earth	MW or SW	SW	SW

FIG. 1 Weathering Indices in the United States

5. Physical Properties

5.1 *Durability*—When Grade is not specified, the requirements for Grade SW shall govern.

5.1.1 *Physical Property Requirements*—The brick shall conform to the physical requirements for the Grade specified as prescribed in Table 1. For the compressive strength requirements in Table 1, test the unit with the compressive force perpendicular to the bed surface of the unit, with the unit in the stretcher position.

5.1.2 *Absorption Alternate*—The saturation coefficient requirement does not apply, provided that the 24-h cold water absorption of each of the five units tested does not exceed 8.0 %.

5.1.3 *Freezing and Thawing Alternative*—The requirements for 5 h boiling water absorption and saturation coefficient do not apply, provided a sample of five brick, meeting the strength requirements of Table 1, passes the freezing and thawing test as

described in the Rating Section of the Freezing and Thawing test procedures of Test Methods C67.

NOTE 2—The 50 cycle freezing and thawing test is used as an alternative only when the brick do not conform to either Table 1 requirements for maximum water absorption and saturation coefficient, or to the requirements of the Absorption Alternate in 5.1.2.

5.1.3.1 *Grade SW: Breakage and Weight Loss Requirement*—No individual unit separates or disintegrates resulting in a weight loss greater than 0.5 % of its original dry weight.

5.1.3.2 *Grade SW: Cracking Requirement*—No individual unit develops a crack that exceeds, in length, the unit's least dimension.

5.1.4 *Low Weathering Index Alternative*—If the brick are intended for use exposed to weather where the weathering index is less than 50 (see Fig. 1), and unless otherwise specified, the requirements given in Table 1 for 5 h boiling water absorption and for saturation coefficient shall not apply but the minimum average compressive strength requirement of 2500 psi (17.2 MPa) shall apply.

NOTE 3—*Weathering Index*: The effect of weathering on brick is related to the weathering index, which for any locality is the product of the average annual number of *freezing cycle days* and the average annual *winter rainfall* in inches defined as follows:³

A *Freezing Cycle Day* is any day during which the air temperature passes either above or below 32°F (0°C). The average number of freezing cycle days in a year may be taken to equal the difference between the mean number of days during which the minimum temperature was 32°F or below and the mean number of days during which the maximum temperature was 32°F or below.

Winter Rainfall is the sum, in inches, of the mean monthly corrected precipitation (rainfall) occurring during the period between and including the normal date of the first killing frost in the fall and the normal date of the last killing frost in the spring. The winter rainfall for any period is equal to the total precipitation less one tenth of the total fall of snow, sleet, and hail. Rainfall for a portion of a month is prorated.

Fig. 1 indicates general areas in the United States which correspond to the weathering index categories listed. The index for geographic locations near the 50 line should be determined by an analysis of weather bureau local climatological summaries, with due regard to the effect of microclimate conditions, especially altitude.

The use of Grade MW brick in a wall area above grade is structurally adequate in the severe weathering region, but Grade SW would provide a higher and more uniform degree of resistance to frost action. The degree of durability called for by Grade SW is not necessary for use in wall areas above grade in the moderate weathering region. Grade MW brick performs satisfactorily in wall areas above grade in the no-weathering region, where the average compressive strength of the units is at least 2500 psi (17.2 MPa). Grade SW brick should be used in any region when the units are in contact with the ground, in horizontal surfaces, or in any position where they are likely to be permeated with water.

The recommended correlation between grade of building brick, weathering index, and exposure is found in Fig. 1. The specifier can use these recommendations or use the grade descriptions and physical requirements along with use exposure and local climatological conditions to select grade.

5.2 *Strength*—When brick are required having strengths greater than prescribed by this specification, the purchaser shall specify minimum strength.

³ Data needed to determine the weathering index for any locality may be found or estimated from the tables of Local Climatological Data—Annual Summary with Comparative Data available from the National Oceanic and Atmospheric Administration.

5.3 *Initial Rate of Absorption (IRA)*—Test results for initial rate of absorption (IRA) shall be determined in accordance with the IRA (Suction) (Laboratory Test) of Test Methods C67 and shall be furnished at the request of the specifier or purchaser. IRA is not a qualifying condition or property of units in this specification. This property is measured in order to assist in mortar selection and material handling in the construction process. See Note 4.

NOTE 4—*Initial Rate of Absorption (Suction)*—Both laboratory and field investigation have shown that strong and watertight joints between mortar and masonry units are not achieved by ordinary construction methods when the units as laid have excessive initial rates of absorption. Mortar that has stiffened somewhat because of loss of excessive mixing water to a unit may not make complete and intimate contact with the second unit, resulting in poor adhesion, incomplete bond, and water-permeable joints of low strength. The IRA of the units is determined by the oven-dried procedure described in the IRA (Suction) (Laboratory Test) of Test Methods C67. IRA in the field depends on the moisture content of the masonry unit and is determined in accordance with the IRA (Suction)—Field Test of Test Methods C67. Units having average field IRA exceeding 30 g/min per 30 in.² (30 g/min 194 cm²) should have their IRA reduced below 30 g/min per 30 in.² prior to laying. They may be wetted immediately before they are laid, but it is preferable to wet them thoroughly 3 to 24 h prior to their use so as to allow time for moisture to become distributed throughout the unit.

6. Dimensions and Permissible Variations

6.1 *Size*—The size of brick shall be as specified by the purchaser. The maximum permissible variation in dimensions of individual units shall not exceed those given in Table 2.

NOTE 5—Brick names denoting sizes may be regional and, therefore, may not be included in all reference books. Purchasers should ascertain the size of brick available in their locality and should specify accordingly, stating the desired dimensions (width by height by length).

7. Finish and Appearance

7.1 The brick, as delivered to the site, shall, by visual inspection, conform to the requirements specified by the purchaser or to the sample or samples approved as the standard of comparison and to the samples passing the tests for physical requirements. Minor indentations or surface cracks incidental to the usual method of manufacture, or the chipping resulting from the customary methods of handling in shipment and delivery, shall not be deemed grounds for rejection.

7.2 The brick shall be free of defects, deficiencies, and surface treatments, including coatings, that would interfere with the proper setting of the brick or significantly impair the strength or performance of the construction.

TABLE 2 Permissible Variations in Dimensions

Specified dimension, in. (mm)	Maximum Permissible Variations from Specified Dimension, plus or minus, in. (mm)
Up to 3 (76), incl	3/32 (2.4)
Over 3 to 4 (76 to 102), incl	1/8 (3.2)
Over 4 to 6 (102 to 152), incl	3/16 (4.8)
Over 6 to 8 (152 to 203), incl	1/4 (6.4)
Over 8 to 12 (203 to 305), incl	5/16 (7.9)
Over 12 to 16 (305 to 406), incl	3/8 (9.5)

7.3 A delivery of brick is permitted to contain not more than 5 % broken brick.

8. Coring and Frogging

8.1 *Coring*—Unless otherwise specified in the invitation for bids, brick shall be either solid or cored at the option of the seller. The net cross-sectional area of cored brick in any plane parallel to the surface containing the cores shall be at least 75 % of the gross cross-sectional area measured in the same plane. No part of any hole shall be less than $\frac{3}{4}$ in. (19.1 mm) from any edge of the brick.

8.2 *Frogging*—Unless otherwise specified in the invitation for bids, one bearing face of each brick may have a recess or panel frog and deep frogs. The recess or panel frog shall not exceed $\frac{3}{8}$ in. (9.5 mm) in depth and no part of the recess or panel frog shall be less than $\frac{3}{4}$ in. (19.1 mm) from any edge of the brick. In brick containing deep frogs, frogs deeper than $\frac{3}{8}$ in. (9.5 mm), any cross-section through the deep frogs

parallel to the surface containing the deep frogs shall conform to the requirements of 8.1.

9. Sampling and Testing

9.1 The brick shall be sampled and tested in accordance with applicable sections in Test Methods C67.

9.2 The manufacturer or the seller shall furnish specimens for tests. The place or places of selection shall be designated when the purchase order is placed.

NOTE 6—Unless otherwise specified in the purchase order, the cost of tests is typically borne as follows: If the results of the test show that the brick do not conform to the requirements of this specification, the cost is typically borne by the seller. If the results of the tests show that the brick do conform to the requirements of this specification, the cost is typically borne by the purchaser.

10. Keywords

10.1 building brick; clay; fired masonry units; masonry; physical properties; shale; solid brick

SUMMARY OF CHANGES

Committee C15 has identified the location of selected changes to this standard since the last issue (C62 – 13) that may impact the use of this standard. (December 1, 2013)

(1) Deleted references to withdrawn standard E835/E835M in Section 2 and Note 5.

Committee C15 has identified the location of selected changes to this standard since the last issue (C62 – 12) that may impact the use of this standard. (June 1, 2013)

(1) A new Section 3, Terminology, was added and subsequent sections renumbered.

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; http://www.copyright.com/