



Standard Test Method for Thermal Endurance of Coating Powders Used for Powder Coating Insulation Systems¹

This standard is issued under the fixed designation D7895/D7895M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This test method provides a procedure for evaluating thermal endurance of coating powders by determining the length of aging time at selected elevated temperatures required to achieve dielectric breakdown at room temperature at a pre-determined proof voltage. Thermal endurance is expressed in terms of a temperature index.

1.2 This test method is applicable to insulating powders used over a substrate material of steel.

1.3 *Units*—The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system are not necessarily exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems is likely to result in non-conformance with the standard.

1.4 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.* Specific precautionary statements are given in Section 7.

2. Referenced Documents

2.1 ASTM Standards:²

D149 Test Method for Dielectric Breakdown Voltage and Dielectric Strength of Solid Electrical Insulating Materials at Commercial Power Frequencies

D1711 Terminology Relating to Electrical Insulation

D5423 Specification for Forced-Convection Laboratory Ovens for Evaluation of Electrical Insulation

¹ This test method is under the jurisdiction of ASTM Committee D09 on Electrical and Electronic Insulating Materials and is the direct responsibility of Subcommittee D09.01 on Electrical Insulating Varnishes, Powders and Encapsulating Compounds.

Current edition approved Nov. 1, 2014. Published November 2014. DOI: 10.1520/D7895_D7895M-14.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

2.2 IEEE Document³

IEEE 101A Simplified Method for Calculation of the Regression Line

3. Terminology

3.1 *Definitions*—For definitions of terms used in this test method refer to Terminology **D1711**.

4. Summary of Test Method

4.1 Specimens are aged in air at a minimum of three temperatures above the expected use temperature of the material. Exposure to ambient stress conditions, followed by dielectric proof voltage tests in an electrically conductive solution, are periodically conducted to determine the time of aging at each elevated temperature required to reduce the breakdown voltage to a preselected percentage of the original breakdown value. These thermal life values are used to construct a thermal endurance graph by means of which it is possible to estimate a temperature index, corresponding to a thermal life as specified in the material specification or as agreed upon between the user and the supplier. It is possible that a material will have multiple indices, each corresponding to a different thermal life as required by a given application.

5. Significance and Use

5.1 A major factor affecting the life of insulating materials is thermal degradation. It is possible that other factors, such as moisture and vibration, will cause failures after the material has been weakened by thermal degradation.

5.2 Electrical insulation is effective in electrical equipment only as long as it retains its physical and electrical integrity. The following are potential indicators of thermal degradation: weight change, porosity, crazing, and generally a reduction in flexibility. Thermal degradation is usually accompanied by an ultimate reduction in dielectric breakdown.

5.3 This test method is useful in determining the thermal endurance of coating powders applied over a steel substrate material.

³ Available from Institute of Electrical and Electronics Engineers, Inc. (IEEE), 445 Hoes Ln., P.O. Box 1331, Piscataway, NJ 08854-1331, <http://www.ieee.org>.

6. Apparatus

6.1 *Dielectric Breakdown Test Set*—The set shall meet the requirements of Test Method **D149**.

6.2 *Ovens*—Ovens shall meet the requirements of Specification **D5423**, Type I.

6.3 *Electrically Conductive Solution:*

6.3.1 An appropriate container shall be selected for the electrically conductive solution.

6.3.2 Prepare a solution having a conductivity of at least 2.5 mS (millisiemens).

NOTE 1—A solution comprised of tap water and a solute such as NaCl or NH_4Cl has been found to be acceptable. Since the water solution is used to detect (not cause) material decomposition/breakdown, the solution is acceptable for use as long as it meets the minimum conductivity requirements. It is recommended to change the solution when it becomes difficult to observe breakdown due to cloudiness or other contamination.

6.3.3 During testing, the conductive solution is at ground potential. The ground connection, using an immersed electrode, is made using Nichrome, stainless steel, or other non-corrosive metal.

6.3.4 Fit the container with a cover to prevent evaporation of the solution when not in use.

7. Hazards

7.1 **Warning**—Lethal voltages are a potential hazard during the performance of this test. It is essential that the test apparatus, and all associated equipment electrically connected to it, be properly designed and installed for safe operation. Solidly ground all electrically conductive parts which are possible for a person to contact during the test. Provide means for use at the completion of any test to ground any parts which were at high voltage during the test, or have the potential for acquiring an induced charge during the test, or retaining a charge even after disconnection of the voltage source. Thoroughly instruct all operators as to the correct procedures for performing tests safely. When making high voltage tests, particularly in compressed gas or in oil, it is possible for the energy released at breakdown to be sufficient to result in fire,

explosion, or rupture of the test chamber. Design test equipment, test chambers, and test specimens so as to minimize the possibility of such occurrences and to eliminate the possibility of personal injury. If the potential for fire exists, have fire suppression equipment available.

8. Test Specimens

8.1 The substrate material to be used for evaluating integral bus-bar insulation systems shall be steel. It is preferred that the configuration of the substrate material be representative of the end application. One configuration that has been found to be useful is shown in **Fig. 1**. Alternative configurations are acceptable if agreed to by all interested parties.

8.2 The substrate shall be coated with the powder and cured using the manufacturer's standard process. One end of the specimens shall be left uncoated for making an electrical connection during the dielectric strength tests.

9. Number of Test Specimens

9.1 A set of specimens for thermal aging shall consist of at least ten specimens. Prepare one set for each aging temperature chosen.

9.2 The initial value (unaged) set shall consist of at least twenty specimens.

9.3 The minimum number of test specimens is 50. It is recommended to prepare extra specimens for situations such as the need to add additional aging temperatures, or to have replacement specimens available for any specimens that are found during the screening test to be unsuitable for use in thermal aging.

10. Calibration and Standardization

10.1 Expose the test material to at least three aging temperatures. The preferred number of aging temperatures is four.

10.2 Minimum thermal life target values for the high and low temperatures shall be selected based on application.

10.3 Aging temperatures shall differ by at least 10°C.

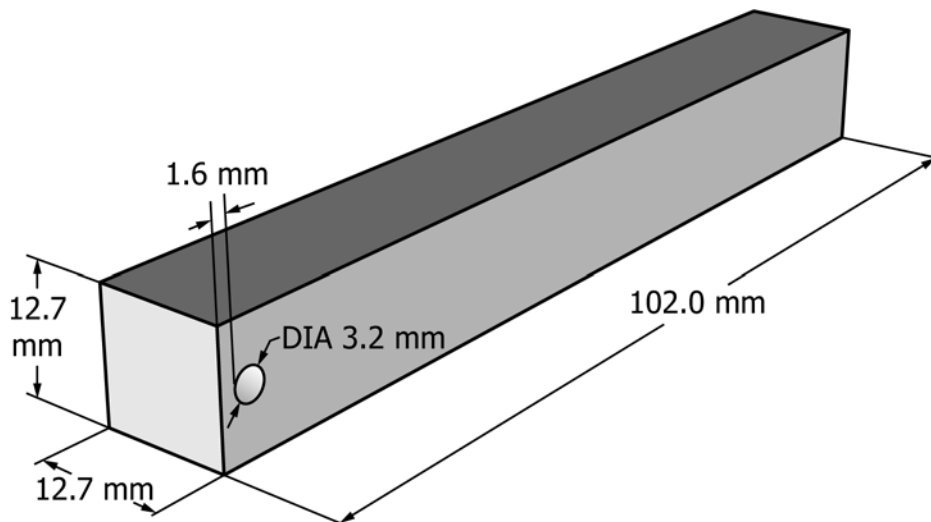


FIG. 1 Example Specimen Dimensions



NOTE 2—Experience has shown that the suggested target thermal life values listed in Table 1 are generally satisfactory.

11. Selection of Aging Cycles

11.1 To provide approximately equal exposures to the other conditionings, and to more accurately determine the property endpoint, the heat aging time per cycle shall be shorter for the higher aging temperatures and longer for the lower aging temperatures.

11.2 Cycle times shall be selected such that each set undergoes an adequate (but not excessive) number of cycles before completion. In order to obtain an appropriate number of cycles, the following adjustments to the cycle time are recommended:

11.2.1 If no specimens in a set fail by the end of the 4th cycle, double the heat aging period of the test cycle.

11.2.2 If three or more specimens in a set fail by the end of the 4th cycle, halve the heat aging period of the test cycle.

11.2.3 Use observations in the highest temperature set to select appropriate adjustments to the other temperature sets.

NOTE 3—Experience has shown that the suggested cycle times in Table 1 are generally satisfactory.

12. Initial Value Test

12.1 To determine an initial dielectric strength level, at least twenty specimens shall be selected at random from the sample and subjected to a voltage breakdown test.

12.2 Connect one electrode of the tester to the uncoated end of the specimen. Suspend the coated end of the specimen in the electrically conductive solution described in 6.3.2 (see Fig. 2). The total surface area to be tested shall be sufficient to be representative of the intended application.

12.3 Apply voltage uniformly to the test electrode in accordance with the guidelines of the Short-Time Test described in 12.2.1 of Test Method D149, unless another rate is specified, until breakdown occurs.

12.4 Make one measurement on each specimen and compute the average dielectric breakdown voltage for the set. Record this as the initial value.

13. Screening Test

13.1 Prior to thermal aging, all specimens shall be subjected to a screening test in order to remove defective units. Any specimen that cannot pass the screening test shall be discarded and a replacement specimen selected for thermal aging.

13.2 Select a screening test voltage level that is a percentage of the average initial value.

13.3 Select a screening test period of time that is expected to cause failure in weak specimens without causing damage to the remaining specimens.

NOTE 4—Experience has shown that a screening test voltage level of 75 % of the initial value for a period of 10 s is generally satisfactory.

13.4 Suspend each specimen in the electrically conductive solution in the same manner as described for the initial value test. Apply voltage uniformly to the test electrode in accordance with the guidelines of the Short-Time Test described in 12.2.1 of Test Method D149, unless another rate is specified, until the screening voltage level is achieved. Maintain the voltage for the screening test period before removing the voltage from the specimen.

13.5 Discard any specimen that breaks down. Specimens that do not break down during the screening test are acceptable for use in the thermal aging.

14. Procedure

14.1 *Thermal Aging of Specimens*—Tag four sets of specimens by any reliably permanent means and expose the sets in the oven at each of the selected temperatures. Position the sets so that free movement of air exists across the entire specimen.

14.2 Stress Cycling:

14.2.1 Following the completion of each thermal exposure, all specimens in the set shall be removed from the oven and allowed to cool to $23 \pm 2^\circ\text{C}$.

14.2.2 All specimens shall then be subjected to a cold exposure and allowed to reach equilibrium with the cold environment.

14.2.2.1 If the coating resin is intended for outdoor applications, the cold exposure temperature shall be $\text{minus } 20.0 \pm 2.0^\circ\text{C}$ [$\text{minus } 4.0 \pm 3.6^\circ\text{F}$].

14.2.2.2 If the coating resin is intended for indoor applications, the cold exposure temperature shall be $0.0 \pm 2.0^\circ\text{C}$ [$32.0 \pm 3.6^\circ\text{F}$].

14.2.3 Following the cold exposure, all specimens shall be allowed to return to $23 \pm 2^\circ\text{C}$.

14.2.4 All specimens shall then be mounted on a shake table and operated for a period of 10 000 cycles with a 60 Hz oscillating motion and an acceleration of 7 G's.

14.2.4.1 The specimens shall be mounted such that the motion occurs at right angles to the largest flat surface of the specimen and parallel to the smallest flat surface of the specimen (see Fig. 3).

14.2.5 Following the vibration exposure, all specimens shall be placed into a humidity exposure for a minimum of 24 h at 25 to 30°C [77 to 86°F], with the relative humidity adjusted to 95 to 100 %.

NOTE 5—The humidity exposure is intended to minimize the occurrence of trapped air in any potential fractures developed in the coating during the previous cycle.

14.2.6 The total time required for each stress exposure will be dependent on the configuration of the specimens used. The minimum time for each exposure environment shall be the time required for the specimens to reach equilibrium with the exposure environment.

NOTE 6—Experience has shown that exposures longer than the time required to reach equilibrium do not influence the test results.

14.3 Testing Specimens:

TABLE 1 Suggested Cycle Times and Target Lives

Temperature Set	Cycle Time	Target Life
High Temperature	48–72 h	400–700 h
Middle High Temperature	168 h	1000–1500 h
Middle Low Temperature	336 h	2000–3000 h
Low Temperature	504 h	5000+ h

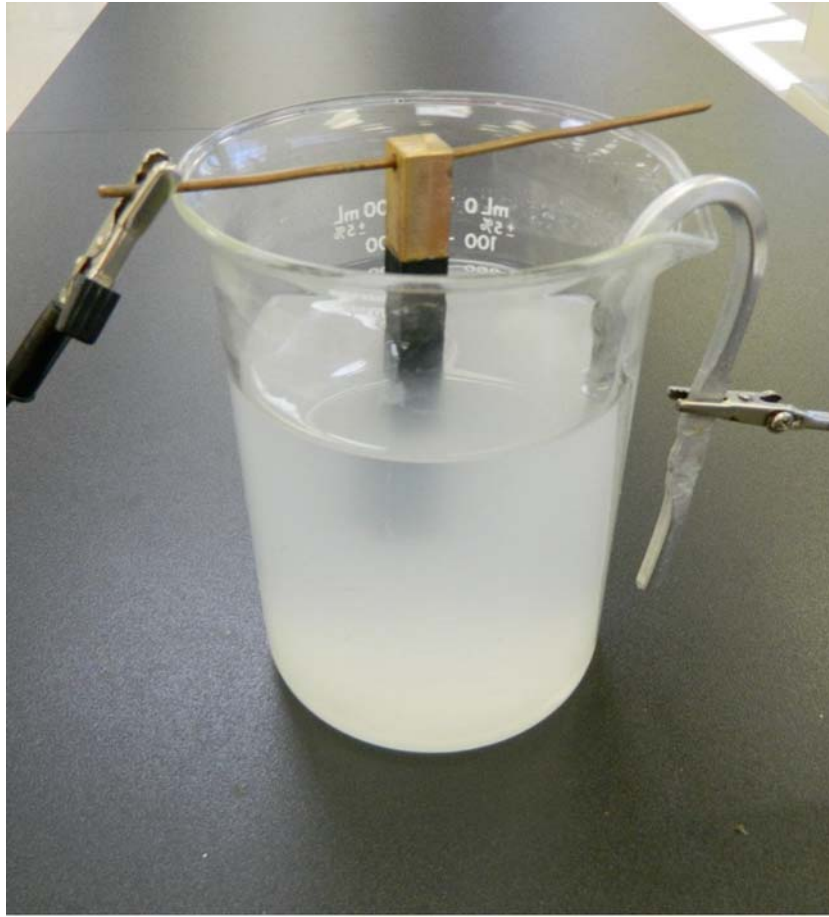


FIG. 2 Typical Test Setup

14.3.1 Select a proof test voltage level that is a percentage of the average initial value. The same proof test voltage level shall be used in all subsequent proof testing.

14.3.2 Select a proof test period of time that is expected to detect the onset of thermal decomposition without causing damage to intact specimens. The same proof test period of time shall be used in all subsequent proof testing.

NOTE 7—Experience has shown that a proof test voltage level of 50% of the initial value for a period of 10 s is generally satisfactory.

14.3.3 Within 1 h of removal from the humidity exposure, subject each specimen to a proof voltage test. Suspend each specimen in the electrically conductive solution in the same manner as described for the initial value test. Apply voltage uniformly to the test electrode in accordance with the guidelines of the Short-Time Test described in 12.2.1 of Test Method D149, unless another rate is specified, until the proof voltage level is achieved. Maintain the voltage for the proof test period before removing the voltage from the specimen.

NOTE 8—Testing is permissible on one or more specimens at a time, and is limited only by the physical capacity of the test container. Failures will be more easily identified if the specimens are tested one-by-one, but the results will not change whether one or multiple specimens are tested at a time.

14.3.4 Specimens that cannot withstand the proof voltage for the selected period of time are removed from the set. The

total accumulated aging hours and average hours to failure for each failed specimen are recorded at the time of failure.

14.3.4.1 Total accumulated aging hours are calculated by multiplying the number of completed cycles by the aging time for each cycle. It includes all time spent in thermal aging.

14.3.4.2 A failed specimen shall be assumed to have reached end-of-life halfway through the aging cycle after which failure occurred. Average hours to failure are calculated by subtracting one-half of the cycle time of the most recent cycle from the total accumulated aging hours.

14.3.5 Specimens that do not break down shall be rinsed of the conductive solution and returned to the oven for another cycle of thermal aging.

NOTE 9—The rinsing process is intended to remove possible residual solute from the specimen surface. One procedure that has been found to be acceptable is to hold the specimen under flowing tap water for 5 to 10 s. Other equivalent procedures are acceptable.

14.3.6 Thermal aging and stress cycling for each set is continued until all specimens in a set have exhibited breakdown.

15. Calculation

15.1 Establish for each temperature set the log average life following the methods described in IEEE 101A.

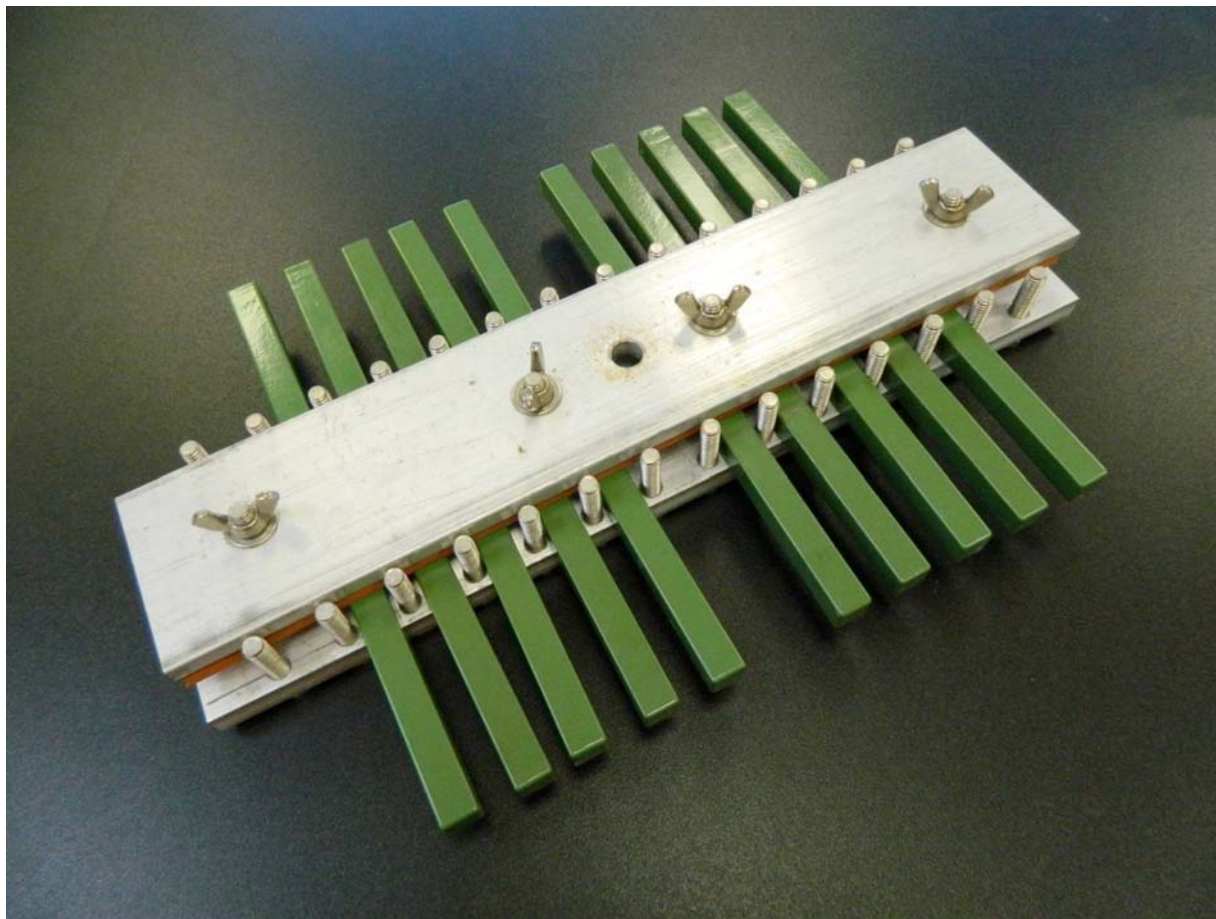


FIG. 3 Specimen Mount for Aging/Cycling Process

15.2 Plot the thermal life at each exposure temperature, having as the ordinate a logarithmic time scale, and as an abscissa a scale arranged according to the reciprocal of the absolute temperature. In the absence of significant curvature of the data, draw a straight line best fitting the plotted data, continuing this line by extrapolation through the abscissa corresponding to a time limit as specified or as agreed upon.

15.3 Determine the temperature index as the temperature in degrees Celsius at which the extrapolated line crosses the time ordinate specified or agreed upon.

16. Report

16.1 Report the following information:

16.1.1 Description of the material, such as designation and average thickness in millimeters or inches,

16.1.2 Substrate material used,

16.1.3 The results of dielectric breakdown voltage tests for the unaged set of specimens, including the average initial value,

16.1.4 The screening test voltage level and duration of test,

16.1.5 The proof test voltage level and duration of test,

16.1.6 The initial cycle times for each temperature set and any adjustments made after the start of thermal aging,

16.1.7 The total accumulated aging hours and average hours to failure for each specimen in a set,

16.1.8 The log average life for each temperature set,

16.1.9 A graph of thermal life on a logarithmic scale as a function of the reciprocal of the absolute temperature (Arrhenius plot), and

16.1.10 The temperature index of the material in degrees Celsius corresponding to the life as specified or as agreed upon.

17. Precision and Bias

17.1 This test method has been used for many years, but no information has been presented to ASTM upon which to base a statement of precision. No activity has been planned to develop such information.

17.2 This test method has no bias because the value for thermal endurance is determined solely in terms of this test method itself.

18. Keywords

18.1 dielectric breakdown voltage; integral bus bar; powder coating; temperature index; thermal endurance; thermal endurance graph; thermal life; thermal life curve



ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; <http://www.copyright.com/>