

INTERNATIONAL STANDARD

IEC
61823

First edition
2002-12

Electrical installations for lighting and beaconing of aerodromes – AGL series transformers

*Installations électriques pour le balisage
et l'éclairage des aérodromes –
Transformateurs séries AGL*



Reference number
IEC 61823:2002(E)

Publication numbering

As from 1 January 1997 all IEC publications are issued with a designation in the 60000 series. For example, IEC 34-1 is now referred to as IEC 60034-1.

Consolidated editions

The IEC is now publishing consolidated versions of its publications. For example, edition numbers 1.0, 1.1 and 1.2 refer, respectively, to the base publication, the base publication incorporating amendment 1 and the base publication incorporating amendments 1 and 2.

Further information on IEC publications

The technical content of IEC publications is kept under constant review by the IEC, thus ensuring that the content reflects current technology. Information relating to this publication, including its validity, is available in the IEC Catalogue of publications (see below) in addition to new editions, amendments and corrigenda. Information on the subjects under consideration and work in progress undertaken by the technical committee which has prepared this publication, as well as the list of publications issued, is also available from the following:

- **IEC Web Site** (www.iec.ch)
- **Catalogue of IEC publications**
The on-line catalogue on the IEC web site (http://www.iec.ch/searchpub/cur_fut.htm) enables you to search by a variety of criteria including text searches, technical committees and date of publication. On-line information is also available on recently issued publications, withdrawn and replaced publications, as well as corrigenda.
- **IEC Just Published**
This summary of recently issued publications (http://www.iec.ch/online_news/justpub/jp_entry.htm) is also available by email. Please contact the Customer Service Centre (see below) for further information.
- **Customer Service Centre**
If you have any questions regarding this publication or need further assistance, please contact the Customer Service Centre:

Email: custserv@iec.ch
Tel: +41 22 919 02 11
Fax: +41 22 919 03 00

INTERNATIONAL STANDARD

IEC 61823

First edition
2002-12

Electrical installations for lighting and beaconing of aerodromes – AGL series transformers

*Installations électriques pour le balisage
et l'éclairage des aérodromes –
Transformateurs séries AGL*

© IEC 2002 — Copyright - all rights reserved

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Electrotechnical Commission, 3, rue de Varembé, PO Box 131, CH-1211 Geneva 20, Switzerland
Telephone: +41 22 919 02 11 Telefax: +41 22 919 03 00 E-mail: inmail@iec.ch Web: www.iec.ch



Commission Electrotechnique Internationale
International Electrotechnical Commission
Международная Электротехническая Комиссия

PRICE CODE

S

For price, see current catalogue

CONTENTS

FOREWORD	4
1 Scope	5
2 Normative references.....	5
3 Definitions and abbreviated terms.....	5
3.1 Definitions	5
3.2 Abbreviated terms	6
4 General requirements	7
4.1 Classification.....	7
4.2 Rated current.....	7
4.3 Earthing.....	7
4.4 AGL construction	7
4.5 Encapsulation.....	8
4.6 Earthing.....	8
4.7 Service conditions	8
4.8 Electrical characteristics	8
4.9 Temperature rise	9
5 Type and routine tests	10
5.1 Type tests.....	10
5.2 Routine tests	11
6 Test requirements.....	11
6.1 Introduction to electrical testing	11
6.2 Tests under load.....	12
6.3 Short circuit current	13
6.4 Open circuit voltage.....	13
6.5 AC leakage current test	13
6.6 DC leakage current cycling test	15
6.7 Shock tests.....	16
6.8 Temperature rise	17
6.9 Gas tightness test.....	18
6.10 Physical size demonstration	18
7 Routine tests	18
7.1 Ratio test.....	18
7.2 Earth continuity test.....	18
7.3 Leakage current test.....	18
8 Marking	19
 Annex A (normative) Connector descriptions and interface dimensions	20
Bibliography	22
 Figure 1 – Tests under load	12
Figure 2 – Primary a.c. leakage current test.....	14
Figure 3 – Secondary a.c. leakage current test	14
Figure 4 – Primary d.c. leakage current.....	16
Figure 5 – Secondary d.c. leakage current	16
Figure 6 – Lead rigidity test.....	17

Figure A.1 – Style 2 primary plug	20
Figure A.2 – Style 9 primary receptacle.....	20
Figure A.3 – Style 8 secondary receptacle	21
Figure A.4 – Style 7 secondary receptacle	21
Table 1 – Transformer characteristics	9
Table 2 – Encapsulation method type tests	10
Table 3 – Electrical characteristic type tests.....	11
Table 4 – Routine tests	11
Table 5 – DC leakage current test limits	15
Table A.1 – Interface dimensions for Figures A.1 and A.2	20
Table A.2 – Interface dimensions for Figures A.3 and A.4	21

INTERNATIONAL ELECTROTECHNICAL COMMISSION

ELECTRICAL INSTALLATIONS FOR LIGHTING AND BEACONING OF AERODROMES – AGL SERIES TRANSFORMERS

FOREWORD

- 1) The IEC (International Electrotechnical Commission) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of the IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, the IEC publishes International Standards. Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. The IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of the IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested National Committees.
- 3) The documents produced have the form of recommendations for international use and are published in the form of standards, technical specifications, technical reports or guides and they are accepted by the National Committees in that sense.
- 4) In order to promote international unification, IEC National Committees undertake to apply IEC International Standards transparently to the maximum extent possible in their national and regional standards. Any divergence between the IEC Standard and the corresponding national or regional standard shall be clearly indicated in the latter.
- 5) The IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with one of its standards.
- 6) Attention is drawn to the possibility that some of the elements of this International Standard may be the subject of patent rights. The IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61823 has been prepared by IEC technical committee 97: Electrical installations for lighting and beaconing of aerodromes.

The text of this standard is based on the following documents:

FDIS	Report on voting
97/94/FDIS	97/95/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

The committee has decided that the contents of this publication will remain unchanged until 2006. At this date, the publication will be

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

ELECTRICAL INSTALLATIONS FOR LIGHTING AND BEACONING OF AERODROMES – AGL SERIES TRANSFORMERS

1 Scope

This standard specifies the characteristics of aeronautical ground lighting series transformers (AGLST) used in aeronautical ground lighting for 6,6 A series circuits, at a service voltage of up to 5 kV, supplied by constant current regulators up to 30 kVA in rating.

AGL series transformers provide power to airport lighting luminaires or other loads (resistive) from their secondary circuits. The AGL series transformers provide continuity of the series circuit in the event of a loss of the load on the transformer, and electrical isolation between the primary circuit supplied by a constant current regulator, and the secondary circuit connected to the load under conditions defined in this standard.

An AGL series transformer is to be able to withstand a permanent short or open-circuit secondary series circuit.

Specifications for similar series transformers intended for any primary or secondary currents other than 6,6 A, or to supply alternative voltages, constant power, reactive loads, etc., are not included in this standard.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60085, *Thermal evaluation and classification of electrical insulation*

IEC 61822, *Electrical installations for lighting and beaconing of aerodromes – Constant current regulators*

ISO 48, *Rubber, vulcanised or thermoplastic – Determination of hardness (hardness between 10 IRHD and 100 IRHD)*

3 Definitions and abbreviated terms

3.1 Definitions

For the purposes of this standard the following definitions apply.

Where the terms voltage and current are used, they shall be r.m.s. values unless otherwise stated.

3.1.1

AGL series transformer

aeronautical ground lighting series transformer, as specified in this standard

3.1.2

ambient temperature

the temperature of the air or other medium surrounding the AGL series transformer; for testing purposes, a temperature of $(20 \pm 5) ^\circ\text{C}$

3.1.3

nominal power

arbitrarily selected values of power used in this standard for convenience to refer to AGL series transformers with different characteristics

3.1.4

rated frequency

the frequency or frequency range for which the AGL series transformer is designed to operate

3.1.5

rated power

the range of powers for which each AGL series transformer is suitable.

NOTE The low and high values of these ranges are given in Table 1.

3.1.6

rated primary current

the current at which the primary of the AGL series transformer is designed to operate

3.1.7

rated secondary current

the current at which the secondary of the AGL series transformer is designed to operate

3.1.8

routine test

test for the purpose of checking manufactured products for compliance with this standard

3.1.9

service voltage

the maximum primary or secondary voltage at which the AGL series transformer is designed to operate

3.1.10

type test

a test to confirm that the product design and production processes are capable of providing products that meet the requirements of this standard

3.1.11

type test sample

a sample consisting of one or more similar samples used for a type test

3.2 Abbreviated terms

AC1	Source of mains power
AC2	High voltage a.c. source
AGLST	AGL series transformer
DC1	Source of d.c. power
CCR	Constant current regulator as specified in IEC 61822
I_1, I_2	Primary and secondary currents respectively, as measured by ammeters or equivalent devices
U_1, U_2	Primary and secondary voltages respectively, as measured by voltmeters or equivalent devices
P_1, P_2	Active power measurements or calculations of respectively the primary and secondary circuits of an AGL series transformer

4 General requirements

4.1 Classification

There are seven types of AGL series transformers specified in this standard, defined by their nominal power, namely 30 W, 45 W, 65 W, 100 W, 150 W, 200 W and 300 W. See Table 1 for the required characteristics.

4.2 Rated current

The rated primary and secondary currents shall be 6,6 A.

4.3 Earthing

AGL series transformers may be provided with or without an earthing connection.

4.4 AGL construction

The AGL series transformers shall have two electrically and physically separate windings, one primary and one secondary, wound on a magnetic core. The polarity of the windings shall be such that the primary plug corresponds to the large socket of the secondary receptacle.

All internal electrical connections shall be permanent, e.g. by compression high-pressure crimping, high-temperature soldering, welding, etc.

The shapes of the transformers are optional provided they meet all the requirements of this standard. Sharp edges shall be avoided.

The AGL series transformer including all connector leads shall be able to be inserted through the open end of a cylinder 20 cm in diameter by 25 cm long, and shall easily and totally fit inside such a cylinder.

The transformers shall be designed so that they may be installed and will perform to the requirements of this standard in any orientation.

The AGL series transformers shall be provided with two single-conductor primary leads and a two-conductor secondary lead.

4.4.1 Primary connection leads

The AGL series transformers shall be connected to the AGL primary series circuit cable by two insulated, multi-stranded, copper conductors, with at least a 6 mm² cross section, and a length measured from the transformer housing to the face of the connector of 60^{+10}_0 cm. The service voltage for the leads shall be 5 kV. One lead shall have a style 2 male plug at its end. The other lead shall have a style 9 female receptacle at its end. Unless otherwise agreed between the manufacturer and supplier, the connectors shall be provided with disposable shipping caps.

4.4.2 Secondary connection lead

The secondary lead shall consist of two insulated, multi-stranded, copper conductors with an overall jacket, each core of minimum cross section 2,5 mm², minimum service voltage 600 V, and a length measured from the transformer housing to the face of the connector of 120^{+10}_0 cm. The lead shall have a type 2, class A, style 7 or style 8 female receptacle at its end. Unless otherwise agreed between the manufacturer and supplier, the connector shall be provided with a disposable shipping cap.

4.5 Encapsulation

The AGL series transformer body, the connectors and the connection lead's sheaths, shall be made of compatible materials. The case shall be composed of material formed directly on the core and coil assembly, or by compound filling a container. The transformer shall be permanently encapsulated without cracks, holes, or internal voids as far as practical. The encapsulation of the transformer must form a watertight casing, and must bond with its connection leads so as to provide a completely waterproof assembly.

The encapsulation material shall have a durometer hardness IRHD (Shore A) of not less than 55 as measured in accordance with the test method of ISO 48.

The minimum thickness of the encapsulation over the internal components shall be 6,5 mm at all points of the surface, for any type of encapsulant.

The encapsulation materials shall be capable of withstanding acid and alkaline soils, as well as limited exposure to chemicals typically present on the aerodrome, including but not limited to oil, gasoline, and de-icing fluids. The encapsulating materials must resist limited UV exposure. These characteristics may be confirmed by testing material samples (only). The characteristics may be confirmed by tests sponsored by the transformer manufacturer, or by test results supplied by the materials manufacturer. These results may be applied to all AGL series transformers using the encapsulation material. If a transformer manufacturer uses more than one material for encapsulation, each such material shall meet these requirements.

4.6 Earthing

The magnetic core shall not be connected to earth or to either of the primary or secondary electrical circuits.

AGL series transformers may be provided with or without an earthing connection. If an earthing connection is provided, it shall be connected to that side of the secondary winding of the transformer which is connected to the larger socket of the secondary connector. The earthing connection must have a water barrier within the transformer body.

4.7 Service conditions

The ambient temperature range shall be $-40\text{ }^{\circ}\text{C}$ to $+55\text{ }^{\circ}\text{C}$.

AGL series transformers shall be suitable for continuous outdoor service when installed within enclosures or by direct earth burial.

AGL series transformers shall be capable of operation when completely submerged in water for the life of the transformer.

4.8 Electrical characteristics

4.8.1 Secondary current

With the primary current I_1 at 6,6 A, the secondary current I_2 shall be within $\pm 1\%$ of the primary current in the range between the low and high load in ohms given in Table 1.

4.8.2 Power factor

With the primary current I_1 at 6,6 A, and the nominal load in ohms (see Table 1) connected to the secondary, the power factor shall be not less than 95 %.

4.8.3 Efficiency

With the primary current I_1 at 6,6 A, and the nominal load in ohms (see Table 1) applied to the secondary, the efficiency shall be not less than 80 % for AGL series transformers whose nominal rating is 30 W, not less than 85 % for AGL series transformers whose nominal rating is 45 W, 65 W or 100 W, and not less than 90 % for AGL series transformers whose nominal rating is above 100 W.

4.8.4 Short circuit secondary current

With the primary current I_1 at 6,6 A, the secondary short circuit current shall not exceed 6,8 A for all AGL series transformers.

4.8.5 Open circuit secondary voltage

With the primary current I_1 at 6,6 A, and with the secondary circuit open, the voltage at the secondary connector terminals shall not exceed the limits given in Table 1.

4.8.6 Characteristics

To allow for lamp power tolerances and losses in the circuit connecting the lamps to the AGL series transformers, the permanent acceptable load on the secondary may vary from the nominal value between the low and high limits given in Table 1.

Table 1 – Transformer characteristics

Nominal power W	Rated power W		Load (resistive) Ω			Maximum open circuit voltage V
	Low	High	Low (maximum)	Nominal	High (minimum)	50 Hz and 60 Hz
30	25	40	0,57	0,69	0,92	20
45	35	60	0,80	1,03	1,38	20
65	50	85	1,15	1,49	1,95	30
100	80	125	1,84	2,30	2,87	40
150	120	178	2,75	3,44	4,13	60
200	160	230	3,67	4,59	5,28	70
300	220	338	5,05	6,89	7,81	110

NOTE Tolerance on loads is ± 1 %.

4.9 Temperature rise

The temperature rise of the transformer shall be determined using the resistance method. The temperature rise shall not exceed the maximum temperature permitted by the insulation class, according to IEC 60085, of the most critical insulation, less 60 °C. The transformer shall be operated in air at ambient temperature, with primary current set at 6,6 A, under each of the following conditions:

- high resistive load, see Table 1;
- short circuit;
- open circuit.

5 Type and routine tests

5.1 Type tests

The type tests are divided into two groups, which apply respectively to the encapsulation method (see 5.1.1), and to the electrical characteristics of each transformer (see 5.1.2).

5.1.1 Encapsulation method type tests

The following tests shall be successfully completed for three samples of one type from each family of AGL series transformers, where a family is defined as AGL series transformers of the same physical size (e.g. made in the same mould), differing only in characteristics which will not effect the physical performance. Such differences would include, but are not necessarily limited to:

- primary and/or secondary connector configurations;
- length of primary and/or secondary leads;
- electrical construction (e.g. number of turns, number of laminations or core size).

Before beginning, each AGL series transformer to be tested shall have its connector dimensions confirmed as being in accordance with the tolerances given in Annex A.

Table 2 – Encapsulation method type tests

Sequence	Test	Reference
1	Physical size demonstration	6.10
2	Initial ratio	6.2.1 and 6.2.1.1
3	Shock tests (impact and lead rigidity)	6.7
4	Gas tightness	6.9
5	Final ratio	^a
6	AC leakage current test	6.5
7	DC leakage current cycling test	6.6

^a The transformer shall first be subjected to the “warm-up” procedure in accordance with 6.2.1. Then the primary current I_1 shall be set between 6,58 A and 6,62 A, and the value recorded. The secondary current I_2 shall be measured. This value shall be adjusted by multiplying by the measured primary current in this sequence divided by the measured primary current in sequence 2. The resulting value shall not be different from the secondary current measured in sequence 2 by more than ± 67 mA.

The encapsulation type tests shown in Table 2 shall be carried out in the sequence given.

If one or more of the three test transformers fails any one of the tests, the full test sequence shall be repeated with three new samples.

The results of these tests shall be recorded and kept for future reference.

5.1.2 Electrical characteristic type tests

These tests shall be run on three samples of each type. Types which are essentially the same electrically, differing only in characteristics that will not materially effect the electrical performance, may be covered by a test on one representative type. Such differences would include, but not necessarily be limited to,

- primary and/or secondary connector configurations;
- lead lengths;
- with and without earth connection.

Table 3 – Electrical characteristic type tests

Sequence	Test	Reference
1	Ratio, power factor and efficiency under load	6.2
2	Short circuit	6.3
3	Open circuit	6.4
4	AC leakage current	6.5
5	Temperature rise	6.8

The electrical type tests shown in Table 3 shall be carried out in the sequence given.

If one or more of the three test transformers fails any one of the above tests, the full test sequence shall be repeated with three replacement transformers.

The results of these tests shall be recorded and kept for future reference.

5.2 Routine tests

All of the AGL series transformers manufactured shall be subjected to the tests shown in Table 4.

Any transformer that fails any of the tests in Table 4 shall be discarded.

The results of these tests shall be recorded and kept for future reference. These results may include pass/fail only.

Table 4 – Routine tests

Test	Reference
Ratio	7.1
Earthing continuity (if earth connection supplied)	7.2
Leakage current test – either d.c. or a.c.	7.3

6 Test requirements

6.1 Introduction to electrical testing

6.1.1 Safety

During these tests, lethal voltages and high energy levels may be developed. It is essential that the operators and witnesses be aware of the appropriate safety provisions.

6.1.2 Power

All testing shall be with a sinusoidal waveform of the rated frequency of the device, (50 Hz \pm 1) Hz or (60 Hz \pm 1) Hz. If a transformer is rated for both 50 Hz and 60 Hz, all electrical tests shall be carried out at both frequencies.

6.1.3 Loads

When resistors are used as loads for a transformer, they shall be of very low inductance, not more than 0,25 μ H per ohm of resistance. They shall also be inherently temperature stabilized, or their temperature shall be stabilized, and the resistance value confirmed, prior to measurements being taken.

6.1.4 Measurement

All measuring instruments shall read r.m.s.

High impedance voltage measurement equipment shall be used (at least 1 MΩ).

When measuring the current ratio, the primary and secondary currents shall be measured simultaneously.

Allowances shall be made for the power consumption of any meters if this is material to the results.

Metering shown in Figures 1, 2, 3, 4, and 5 is only suggestive. Other forms of metering may be used if they accomplish the same objective.

6.2 Tests under load

6.2.1 Warm-up procedure

The transformer shall be connected as shown in Figure 1. The AC1 source shall be set between 6,58 A and 6,62 A, and the load R to the nominal value as given in Table 1. The transformer shall be in ambient temperature air lying on its largest flat surface on a dry solid wooden plate at least 30 mm thick. This warm-up shall continue for a minimum of 6 h, after which the tests of 6.2.1.1 and 6.2.1.2 shall be carried out.

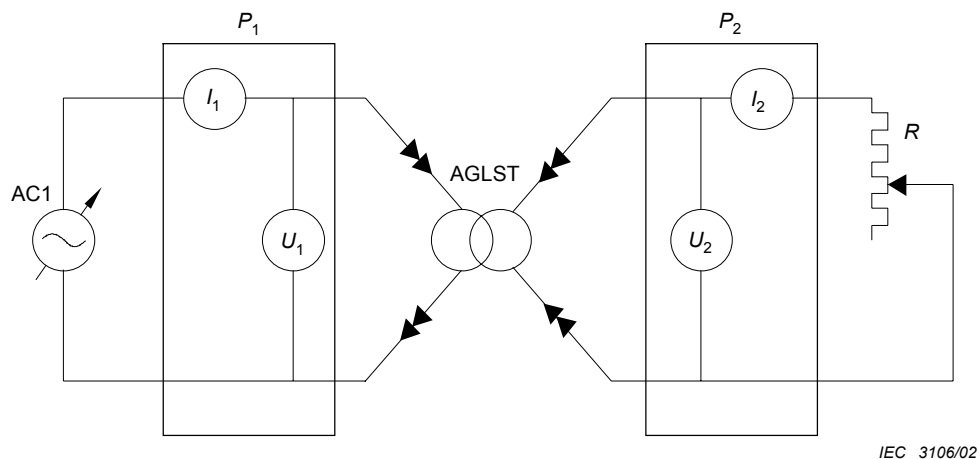


Figure 1 – Tests under load

6.2.1.1 Ratio measurement polarity

The input current I_1 shall be set between 6,58 A and 6,62 A, and the value recorded. The secondary current I_2 shall be within ± 67 mA of the measured primary current for each of the low, nominal, and high values of load given in Table 1.

6.2.1.2 Power factor and efficiency

The load R shall be set at the nominal load ± 1 % given in Table 1, and the voltage, current, and power of both the primary and the secondary circuits shall be measured and recorded.

6.2.1.2.1 Power factor

The power factor shall be measured directly, or calculated as follows:

$$PF = P_1 / I_1 \times U_1$$

where

PF is the power factor;

P_1 is the primary power in watts;

I_1 is the primary current in amperes;

U_1 is the primary voltage in volts.

The value of the power factor shall be not less than 0,95.

6.2.1.2.2 Efficiency

The efficiency shall be measured directly, or calculated as follows:

$$\text{Efficiency} = P_2 \times 100 / P_1$$

where

P_1 is the primary power in watts;

P_2 is the secondary power in watts.

The efficiency shall be not less than 80 % for AGL series transformers whose nominal rating is 30 W, not less than 85 % for AGL series transformers whose nominal rating is 45 W, 65 W, or 100 W and not less than 90 % for AGL series transformers whose nominal rating is above 100 W.

6.3 Short circuit current

The transformer shall be at ambient temperature and be connected as shown in Figure 1.

The primary current I_1 shall be set between 6,58 A and 6,62 A.

The load R shall be a short circuit presenting a voltage drop of less than 0,1 V as measured at the secondary connector of the sample.

The secondary current shall be not more than 6,8/6,6 times the measured primary current.

6.4 Open circuit voltage

The transformer shall be at ambient temperature, and connected as shown in Figure 1.

The load R shall be removed (open circuit).

The primary current shall be set between 6,58 A and 6,62 A.

The voltage U_2 shall be not more than the value given in Table 1.

6.5 AC leakage current test

The transformer's primary and secondary leads shall be connected to the corresponding connectors of primary and secondary leads. No additional protection such as tape or compound shall be used on the connectors. The transformer including all connectors shall be immersed in a tank of tap water at ambient temperature.

6.5.1 Primary

The transformer shall be connected as shown in Figure 2. The AC2 source shall be adjusted to a minimum of 10 kV a.c., and applied for at least 1 min.

The measured value of I_1 shall not exceed 10 mA.

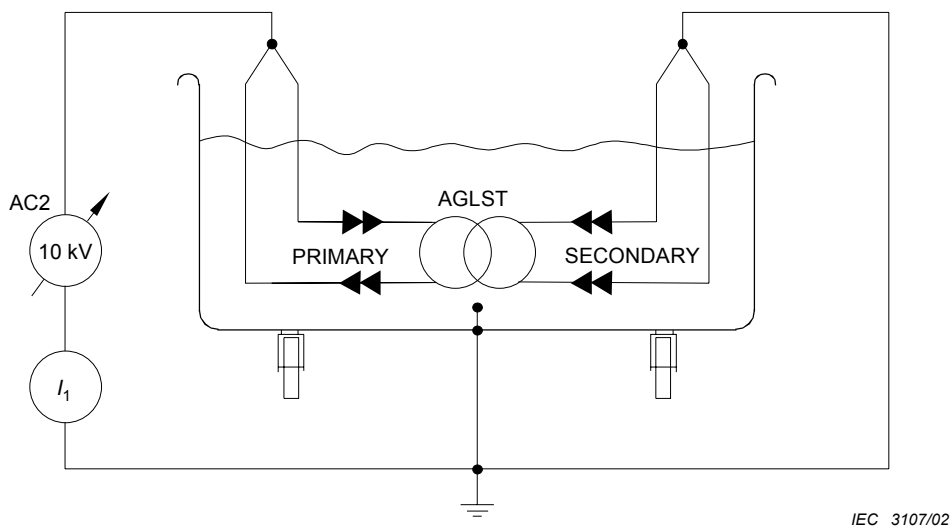


Figure 2 – Primary a.c. leakage current test

6.5.2 Secondary

The transformer shall be connected as shown in Figure 3. The AC2 source shall be adjusted to a minimum of 3,5 kV a.c., and applied for at least 1 min.

The measured value of I_1 shall not exceed 10 mA.

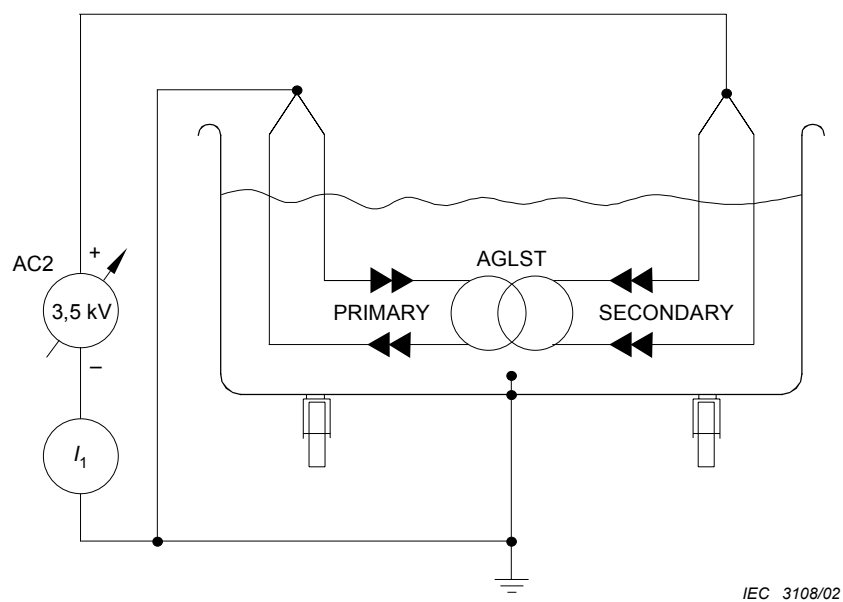


Figure 3 – Secondary a.c. leakage current test

6.6 DC leakage current cycling test

Three sample AGL series transformers shall be prepared as specified in 6.6.1, and then subjected to a sequence of the three operations specified in 6.6.2, 6.6.3 and 6.6.4. Repeat the sequence 20 times.

6.6.1 Initial preparation

Test harnesses complete with corresponding connectors that are compliant to the dimensions in Annex A shall be installed on the three connectors of the AGL series transformers. No additional protection such as tape or compound shall be used on the connectors. The corresponding connectors shall not be removed before completion of the 20 cycle testing. If they are removed for any reason, tests shall be repeated so that the AGL series transformers and their connectors satisfactorily pass 20 continuous cycles.

6.6.2 Warm-up

The AGL series transformers shall be operated, with corresponding connectors installed, for a minimum of 6 h in air at ambient temperature, with the primary current set between 6,58 A and 6,62 A, and the secondary circuit open.

6.6.3 Water immersion test

Immediately following the warm-up procedure of 6.6.2, the AGL series transformers, with leads and connectors, shall be submerged in a tank of tap water at ambient temperature. The water (and tank if metallic) shall be earthed. Care shall be taken to ensure that all connectors (including test harness connectors) and transformer leads remain completely immersed in tap water during this test. Additional water may be added to compensate for any evaporation. The AGL series transformers and their connectors shall continue to be soaked in water at ambient temperature for not less than 12 h.

6.6.4 DC leakage current

The primary and secondary d.c. leakage currents shall be measured within 10 min of immersion of the AGL series transformers in water, and at the end of the soaking period.

Measurement of leakage current shall be made with a d.c. voltage source as shown in Figure 4 (primary) and Figure 5 (secondary). The appropriate test voltage as given in Table 5 shall be applied for 1 min between each circuit and earth. After the instrument needle settles down following current inrush, it shall remain steady without fluctuations, and the leakage current shall be not more than the appropriate value specified in Table 5.

Table 5 – DC leakage current test limits

Winding under test	Voltage applied	Maximum leakage current I_l
	kV d.c.	μA
Primary	15	2
Secondary ^a	5	2

^a Test not required if the transformer is equipped with an earth connection.

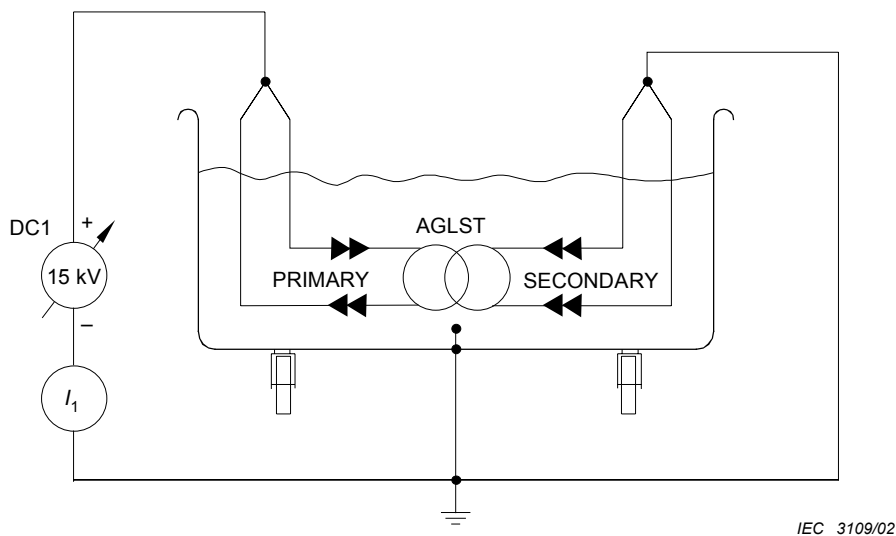


Figure 4 – Primary d.c. leakage current

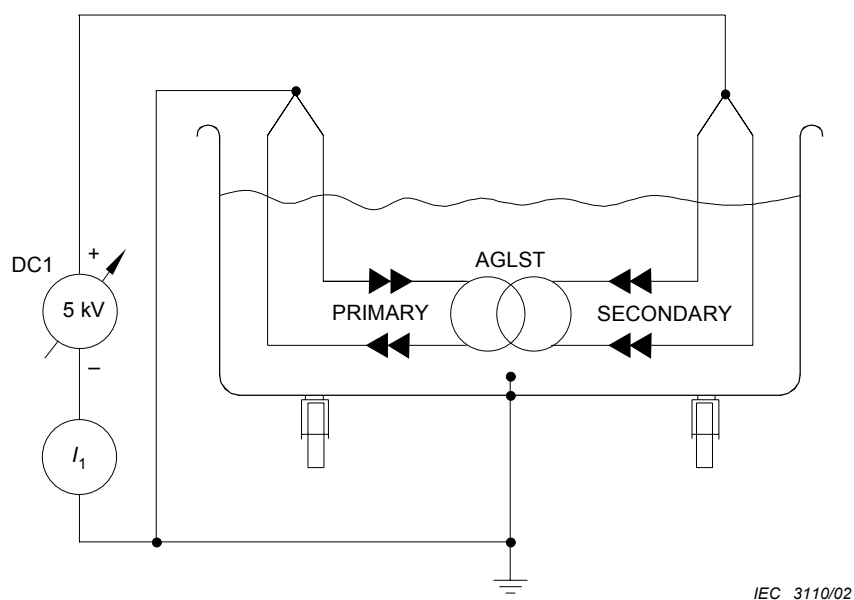


Figure 5 – Secondary d.c. leakage current

6.7 Shock tests

The following tests shall be carried out at ambient temperature.

6.7.1 Impact test

The transformer shall be dropped from a height of not less than 1,8 m, a total of four times, at least once on each of three orthogonal surfaces, and once on a corner, on a flat concrete surface.


6.7.2 Lead rigidity test

After completion of the test in 6.7.1, the transformer leads shall be tested by securing (just below the connector) each lead one at a time, in a clamp fastened to a support, elevated a minimum of 1,5 m above ground. The clamp shall be applied so that it shall not cause damage to the lead at the point of attachment. The connector shall be oriented so the rear of the connector (lead exit) points downward. See Figure 6.

The AGL series transformers shall be lifted above the clamp elevation, and released for a free fall.

6.7.3 Physical confirmation

Any visual evidence of damage to the leads or body which may jeopardize the electrical or watertight properties of the transformer shall be cause for rejection.

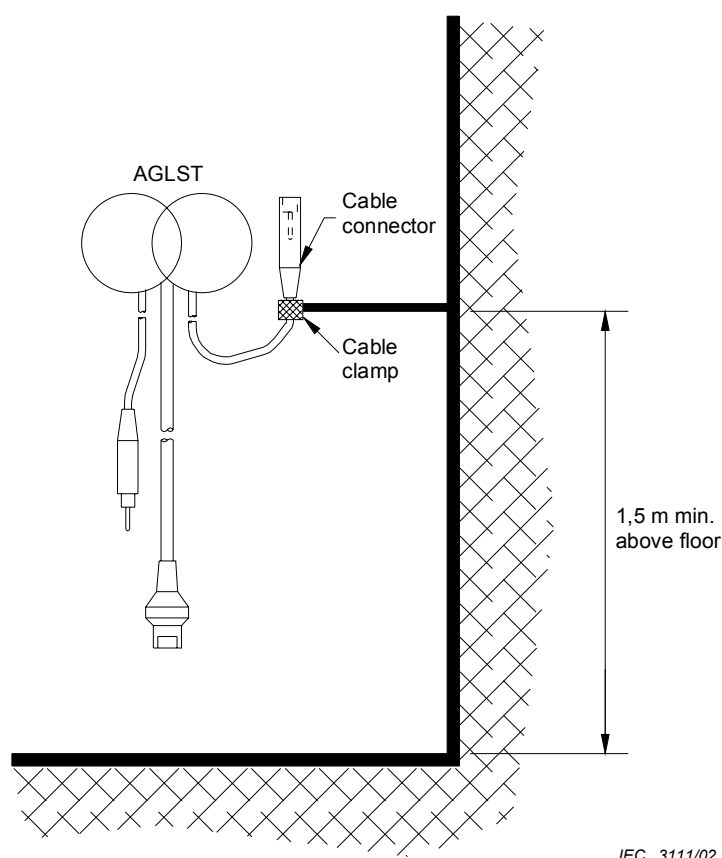

IEC 3111/02

Figure 6 – Lead rigidity test

6.8 Temperature rise

The transformer shall be prepared according to the warm-up procedure of 6.2.1.

The following loads shall then be applied in turn:

- nominal load – see Table 1;
- short circuit
- open circuit

For each load, the transformers shall be operated with the primary current I_1 set between 6,58 A and 6,62 A, and then the temperature rise determined.

The temperature rise of the transformers shall be determined by the resistance method, and shall not be higher than the maximum temperature permitted by the insulation class, according to IEC 60085, of the most critical insulation less 60 °C. All three measurements shall be taken within 15 min of the end of the warm-up procedure.

Temperature rise shall be computed from the following formula:

$$\text{Temperature rise (°C)} = (234,5 + T_0) - (R_1 - R_0) / R_0$$

where

T_0 is the temperature corresponding to cold resistance in degrees Celsius;

R_0 is the cold resistance in ohms;

R_1 is the hot resistance in ohms.

6.9 Gas tightness test

A source of compressed air at 100 kPa above normal atmospheric pressure shall be applied to the transformer's primary female receptacle, and secondary female receptacle, in turn.

The two leads and connectors which are not subjected to the air pressure, and the transformer body, including the earthing connection, shall be fully immersed in tap water at ambient temperature.

For each test the air pressure shall be applied for 15 min, and there shall be no evidence of air bubbles in the water.

6.10 Physical size demonstration

Confirmation of the physical size shall be performed according to the requirements of 4.4.

7 Routine tests

7.1 Ratio test

The transformer shall be set up as in Figure 1.

With the input current I_1 set between 6,58 A and 6,62 A, the secondary current I_2 shall be within ± 67 mA of the measured primary current with the load R set at the low and high values given in Table 1.

7.2 Earth continuity test

If a transformer is equipped with the optional earth connection, an earth continuity tester delivering at least 10 A at less than 6 V shall be used to ensure that there is an electrical connection between the earth stud and the large socket of the secondary connector.

7.3 Leakage current test

Test harnesses complete with corresponding connectors shall be installed on the three connectors of the AGL series transformer. No supplementary protection such as tape or compound shall be used on the connectors. The transformer including its leads and connectors shall be submerged in a tank of ambient temperature tap water.

The transformer shall be tested when its internal temperature is at least 55 °C over ambient, or after it has been soaked for at least 12 h.

The transformer shall be tested with d.c. voltage as specified in 6.6.4, or with a.c. voltage as specified in 6.5.

If the test of 6.5 is used, the primary input voltage shall be set to a minimum of 10 kV a.c. for 1 min, and the leakage current shall not exceed 10 mA a.c. Then the secondary voltage shall be set to a minimum of 3,5 kV a.c. for 1 min, and the leakage current shall again not exceed 10 mA a.c. If the transformer is equipped with the optional earth connection, the secondary test is not required.

If the test of 6.6.4 is used, the primary voltage shall be set to a minimum of 15 kV d.c. for 1 min, and the leakage current shall comply with the limit given in Table 5. Then the secondary voltage shall be set to a minimum of 5 kV d.c., and the leakage current shall comply with the limit given in Table 5. If the transformer is equipped with the optional earth connection, the secondary test is not required.

8 Marking

The following information shall be permanently marked on the body of each AGL series transformer.

Description	AGLST or AGL series transformer
Standard number	IEC 61823
Power rating	Nominal power (as defined in Table 1)
Rated primary and secondary current	6,6/6,6 A
Rated frequency	50 Hz, 60 Hz, or 50/60 Hz
Service voltage	5 000 V
Manufacturer	Name, trademark, or logo of the manufacturer or responsible vendor
Product identification or reference	Catalogue number or other product reference of the manufacturer or responsible vendor.
Date	The year and month of manufacture, or a serial number which can be traced to at least the year and month of manufacture.

Annex A (normative)

Connector descriptions and interface dimensions

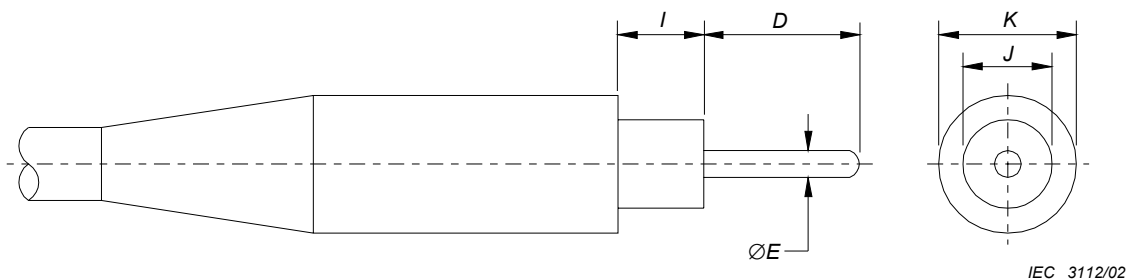


Figure A.1 – Style 2 primary plug

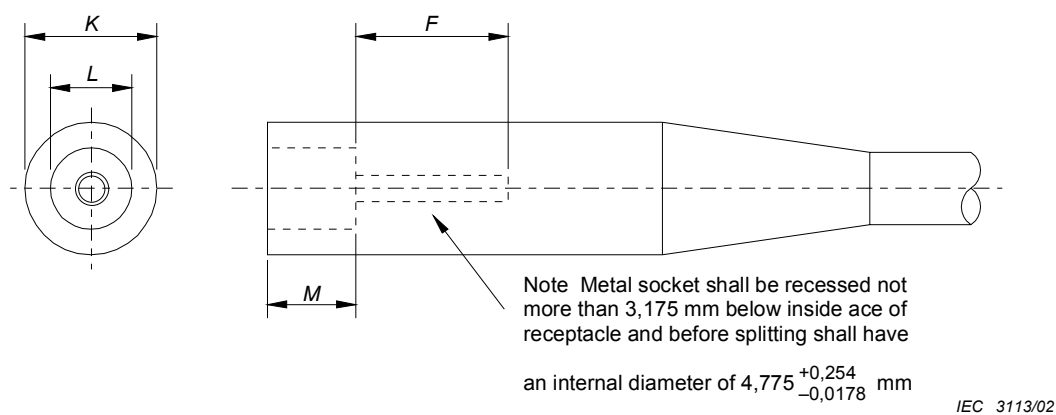


Figure A.2 – Style 9 primary receptacle

Table A.1 – Interface dimensions for Figures A.1 and A.2

Dimension	m
<i>D</i>	26,975 ± 0,381
<i>E</i>	4,7244 ± 0,0254
<i>F</i>	27,432 min.
<i>I</i>	15,062 ^{+0,381} / _{0,000}
<i>J</i>	15,342 ^{+0,254} / _{0,000}
<i>K</i>	23,800 ^{+0,000} / _{-0,787}
<i>L</i>	14,554 ± 0,254
<i>M</i>	15,443 ^{+0,000} / _{-0,381}

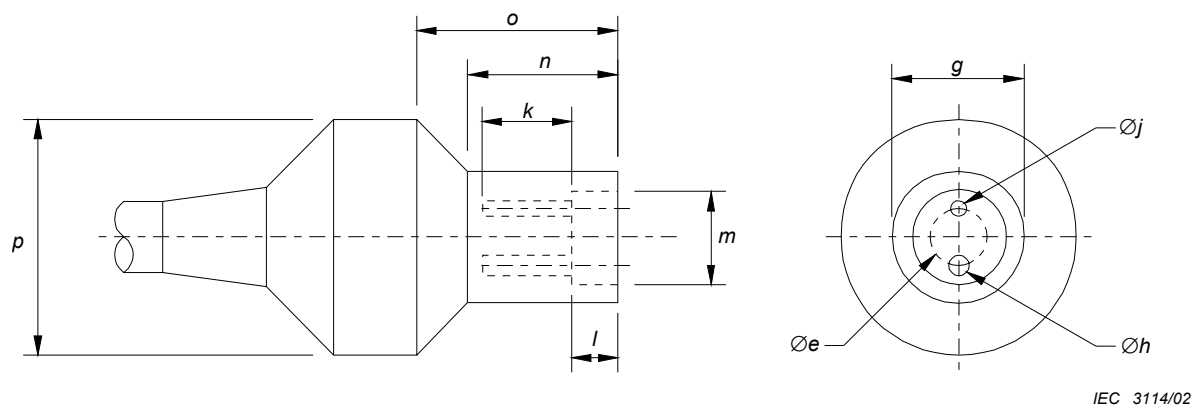


Figure A.3 – Style 8 secondary receptacle

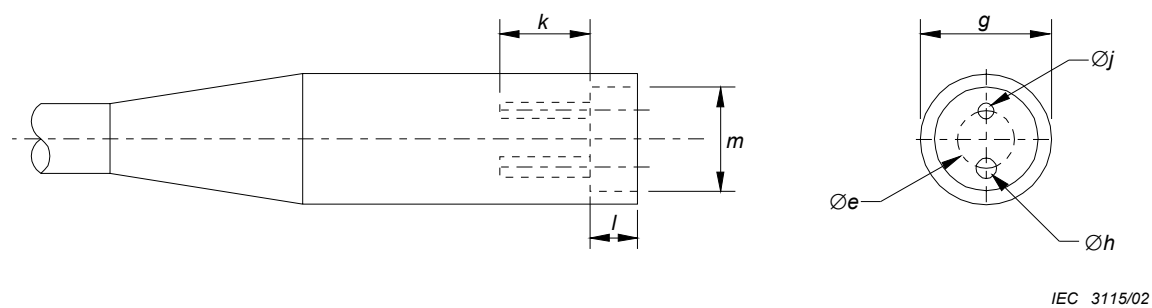


Figure A.4 – Style 7 secondary receptacle

Table A.2 – Interface dimensions for Figures A.3 and A.4

Dimension	m
<i>e</i>	$11,049 \pm 0,254$
<i>g</i>	$25,40^{+0,000}_{-0,787}$
<i>h</i>	$3,988^{+0,0254}_{-0,018}$ Diameter before splitting
<i>j</i>	$3,2004^{+0,0254}_{-0,018}$
<i>k</i>	16,28 min. Includes 3,18 mm recess below inside face
<i>l</i>	$9,093^{+0,000}_{-0,381}$
<i>m</i>	$17,628 \pm 0,254$
<i>n</i>	$28,575 \pm 0,787$
<i>o</i>	$38,10 \pm 0,787$
<i>p</i>	$44,45 \pm 0,787$

Bibliography

The following publications are not specifically cited in the text, but are companion standards concerning aeronautical ground lighting. They are listed here for convenience.

IEC/TS 61820, *Electrical installations for lighting and beaconing of aerodromes – Constant current series circuits for aeronautical ground lighting – System design and installation requirements*¹

IEC 61821:2002, *Electrical installations for lighting and beaconing of aerodromes – Maintenance of aeronautical ground lighting constant current series circuits*

IEC/TS 62143:2002, *Electrical installations for lighting and beaconing of aerodromes – Aeronautical ground lighting systems: Guidelines for the development of a safety lifecycle methodology*

¹ Under consideration.



Standards Survey

The IEC would like to offer you the best quality standards possible. To make sure that we continue to meet your needs, your feedback is essential. Would you please take a minute to answer the questions overleaf and fax them to us at +41 22 919 03 00 or mail them to the address below. Thank you!

Customer Service Centre (CSC)

International Electrotechnical Commission

3, rue de Varembe
1211 Genève 20
Switzerland

or

Fax to: **IEC/CSC** at +41 22 919 03 00

Thank you for your contribution to the standards-making process.

A Prioritaire

Nicht frankieren
Ne pas affranchir



Non affrancare
No stamp required

RÉPONSE PAYÉE

SUISSE

Customer Service Centre (CSC)
International Electrotechnical Commission
3, rue de Varembe
1211 GENEVA 20
Switzerland



Q1 Please report on **ONE STANDARD** and **ONE STANDARD ONLY**. Enter the exact number of the standard: (e.g. 60601-1-1)

.....

Q2 Please tell us in what capacity(ies) you bought the standard (tick all that apply). I am the/a:

- purchasing agent ☐
 librarian ☐
 researcher ☐
 design engineer ☐
 safety engineer ☐
 testing engineer ☐
 marketing specialist ☐
 other.....

Q3 I work for/in/as a:
(tick all that apply)

- manufacturing ☐
 consultant ☐
 government ☐
 test/certification facility ☐
 public utility ☐
 education ☐
 military ☐
 other.....

Q4 This standard will be used for:
(tick all that apply)

- general reference ☐
 product research ☐
 product design/development ☐
 specifications ☐
 tenders ☐
 quality assessment ☐
 certification ☐
 technical documentation ☐
 thesis ☐
 manufacturing ☐
 other.....

Q5 This standard meets my needs:
(tick one)

- not at all ☐
 nearly ☐
 fairly well ☐
 exactly ☐

Q6 If you ticked NOT AT ALL in Question 5 the reason is: (tick all that apply)

- standard is out of date ☐
 standard is incomplete ☐
 standard is too academic ☐
 standard is too superficial ☐
 title is misleading ☐
 I made the wrong choice ☐
 other

Q7 Please assess the standard in the following categories, using the numbers:

- (1) unacceptable,
 (2) below average,
 (3) average,
 (4) above average,
 (5) exceptional,
 (6) not applicable

- timeliness.....
 quality of writing.....
 technical contents.....
 logic of arrangement of contents
 tables, charts, graphs, figures.....
 other

Q8 I read/use the: (tick one)

- French text only ☐
 English text only ☐
 both English and French texts ☐

Q9 Please share any comment on any aspect of the IEC that you would like us to know:

.....



ISBN 2-8318-6781-9



ICS 29.140.50; 93.120
