

TECHNICAL SPECIFICATION

**Application integration at electric utilities – System interfaces for distribution management –
Part 2: Glossary**





THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2011 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de la CEI ou du Comité national de la CEI du pays du demandeur.

Si vous avez des questions sur le copyright de la CEI ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de la CEI de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland
Email: inmail@iec.ch
Web: www.iec.ch

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: www.iec.ch/searchpub

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: www.iec.ch/online_news/justpub

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Electropedia: www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 20 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary online.

- Customer Service Centre: www.iec.ch/webstore/custserv

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: csc@iec.ch
Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00



IEC/TS 61968-2

Edition 2.0 2011-03

TECHNICAL SPECIFICATION

**Application integration at electric utilities – System interfaces for distribution management –
Part 2: Glossary**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

PRICE CODE

XA

ICS 33.200

ISBN 978-2-88912-425-1

CONTENTS

FOREWORD.....	3
INTRODUCTION.....	5
1 Scope.....	6
2 Terms and definitions	6
3 Glossary of abbreviations in the IEC 61968 series.....	48
Bibliography.....	51

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**APPLICATION INTEGRATION AT ELECTRIC UTILITIES –
SYSTEM INTERFACES FOR DISTRIBUTION MANAGEMENT –****Part 2: Glossary****FOREWORD**

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. In exceptional circumstances, a technical committee may propose the publication of a technical specification when

- the required support cannot be obtained for the publication of an International Standard, despite repeated efforts, or
- the subject is still under technical development or where, for any other reason, there is the future but no immediate possibility of an agreement on an International Standard.

Technical specifications are subject to review within three years of publication to decide whether they can be transformed into International Standards.

IEC 61968-2, which is a technical specification, has been prepared by IEC technical committee 57: Power systems management and associated information exchange.

The text of this technical specification is based on the following documents:

TS	Report on voting
57/1054/DTS	57/1088/RVC

Full information on the voting for the approval of this technical specification can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives Part 2.

This second edition cancels and replaces the first edition published in 2003. This second edition constitutes a technical revision. It contains numerous new terms in support of IEC 61968-9, as well as revisions to terms found in the first edition.

The reader will find citations to bibliographic references within square brackets [] below many of the term definitions. Cross references between many related terms have also been added to this edition. These are located among the notes and begin with the words "See also."

A list of all the parts in the IEC 61968 series, published under the general title *Application integration at electric utilities – System interfaces for distribution management* can be found on the IEC website.

A bilingual version may be issued at a later date.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- transformed into an International standard,
- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

INTRODUCTION

The IEC 61968 series is intended to facilitate inter-application integration, as opposed to intra-application integration, of the various distributed software application systems supporting the management of utility electrical distribution networks. Intra-application integration is aimed at programs in the same application system, usually communicating with each other using middleware that is embedded in their underlying runtime environment, and tends to be optimized for close, real-time, synchronous connections and interactive request/reply or conversation communication models. IEC 61968, by contrast, is intended to support the inter-application integration of a utility enterprise that needs to connect disparate applications that are already built or new (legacy or purchased applications), each supported by dissimilar runtime environments. Therefore, IEC 61968 is relevant to loosely coupled applications with more heterogeneity in languages, operating systems, protocols and management tools. IEC 61968 is intended to support applications that need to exchange data on an event driven basis. IEC 61968 is intended to be implemented with middleware services that broker messages among applications, and will complement, but not replace utility data warehouses, database gateways, and operational stores.

The series of standards will be using a lot of definitions, terms and abbreviations from the area of distribution management as well as from the area of Information and Communication Technology. This glossary part defines the terms and abbreviations as they are used in the context of this series of standards.

APPLICATION INTEGRATION AT ELECTRIC UTILITIES – SYSTEM INTERFACES FOR DISTRIBUTION MANAGEMENT –

Part 2: Glossary

1 Scope

This part of IEC 61968 identifies and explains terms and abbreviations used in the remaining parts of IEC 61968.

This glossary, accompanying the IEC 61968 series, is the second part in the series that, taken as a whole, defines interfaces for the major elements of an interface architecture for distribution management systems (DMS).

As used in IEC 61968, a DMS consists of various distributed application components for the utility to manage electrical distribution networks. These capabilities include monitoring and control of equipment for power delivery, management processes to ensure system reliability, voltage management, demand-side management, outage management, work management, automated mapping and facilities management.

2 Terms and definitions

For the purposes of the IEC 61968 series, the following terms and definitions apply.

2.1

abstract component

smallest logical block of software considered in the IEC 61968 interface reference model

NOTE Abstract components have interfaces that will be defined in parts 3 to 10 of the IEC 61968 series. It is expected that different vendors will supply physical application components that support the interfaces for one or more abstract components.

2.2

absolute data

data which is based on a fixed sample at a prescribed moment in time

NOTE 1 The data may have been scaled and may consist of a signed value (as opposed to unsigned).

[Aclara 2008]

NOTE 2 See also: "incremental data".

2.3

account number

unique number issued by a customer information system to identify a specific customer account within a given utility

[Aclara 2008]

2.4

accuracy (of a measurement)

quality of freedom from mistake or error, that is, of conformity to truth or to a rule

NOTE 1 Accuracy is distinguished from precision as in the following example: A six-place table is more precise than a four-place table. However, if there are errors in the six-place table, it may be more or less accurate than the four-place table.

NOTE 2 The accuracy of an indicated or recorded value is expressed by the ratio of the error of the indicated value to the true value. It is usually expressed in percent. Since the true value cannot be determined exactly, the measured or calculated value of highest available accuracy is taken to be the true value or reference value. Comparison of results obtained by different measurement procedures is often useful in establishing the true value.

[IEEE 2000]

NOTE 3 See also: "resolution".

2.5

active energy

real energy

integral of active power with respect to time

NOTE In a distribution network, active energy is normally measured in kiloWatthours (kWh).

[Aclara 2008]

2.6

active power

real power

under periodic conditions, mean value, taken over one period T , of the instantaneous power p :

$$P = \frac{1}{T} \int_0^T p dt$$

NOTE 1 Under sinusoidal conditions, the active power is the real part of the complex power.

NOTE 2 The SI unit for active power is the watt.

[IEC 60050-131:2002, 131-11-42]

NOTE 3 Active power in a distribution network is normally expressed in kW.

2.7

adapter

object adapter

layer of software that connects one component to another component

NOTE 1 An example of a component would be an application.

NOTE 2 An example of an adapter would be an interface implementation or a middleware implementation.

2.8

advanced meter

electric meter, new or appropriately retrofitted, which is 1) capable of measuring and recording usage data in time differentiated registers, including hourly or such interval as is specified by regulatory authorities, 2) allows electric consumers, suppliers and service providers to participate in all types of price-based demand response programs, and 3) which provides other data and functionality that address power quality and other electricity service issues

[DRAM 2008]

2.9

advanced meter management

system capable of two-way communication with meters in a network for the purpose of reading and controlling the meters

NOTE See also: "automated meter reading system" and "advanced metering infrastructure".

2.10

alarm

message which indicates an abnormal condition, or that a measurement has exceeded a preset value

[Aclara 2008]

2.11

apparent energy

integral of apparent power with respect to time

NOTE In a distribution network, apparent energy is ordinarily measured in kiloVoltAmpere hours (kVAh).

[Aclara 2008]

2.12

apparent power

product of the rms voltage U between the terminals of a two-terminal element or two-terminal circuit and the rms electric current I in the element or circuit:

$$S = UI$$

NOTE 1 Under sinusoidal conditions, the apparent power is the modulus of the complex power.

NOTE 2 The SI unit for apparent power is the voltampere.

[IEC 60050-131:2002, 131-11-41]

NOTE 3 Apparent power in the distribution network is normally expressed in kVA.

NOTE 4 See also: "real power" and "reactive power".

2.13

application component

block of software with specific functions and interfaces

NOTE A distribution management system is considered to be a set of one or more applications. Each application consists of one or more application components.

2.14

application programming interface

software specification and interface to a specific software application

NOTE This allows programmers to interface to a software application through a common interface.

[Itron 2008]

2.15

attribute

identifiable association between an object and a value

NOTE An attribute is a property of an object.

2.16

audit trail

information saved in a sequential form so that an event can be traced back to its origin

2.17

automated mapping/geofacilities

geospatial management system utilizing computer graphics technology to enter, store, and update graphic and non-graphic information

NOTE Automated mapping reduces the cost and effort in map creation and maintenance and facility record keeping. An automated mapping/ geospatial system processes geographic depictions and related non-graphic data elements for each entity stored in a digital database. The graphic representations are referenced using a coordinate system that relates to locations on the surface of the earth. Information in the database can be queried and displayed based upon either the graphic or non-graphic attributes of the entities. The system provides the utility a single, continuous electronic map of the service territory.

2.18

automated meter reading (system)

system where aggregated kWh usage, and in some cases demand, is retrieved via automated means such as a drive-by vehicle, (fixed network,) or walk-by hand-held system

[DRAM 2008]

NOTE See also: “advanced meter management” and “advanced metering infrastructure”.

2.19

advanced metering infrastructure

communications hardware and software and associated system and data management software that creates a network between advanced meters and utility business systems which allows collection and distribution of information to customers and other parties such as competitive retail suppliers, in addition to the utility itself

[DRAM 2008]

NOTE See also: “advanced meter management”.

2.20

automatic generation control

control of generation such that average hourly generation control follows a predispach schedule

NOTE Generation levels may be changed based on improving economic operation, emergency conditions, or other improved conditions.

2.21

badge number

utility assigned number to the meter assembly

[Aclara 2008]

2.22

batch communication

communication where the function that owns the data sends information periodically in groups

NOTE In this mode there usually is a delay between the time that new information is available and when it is sent.

[MultiSpeak 2005]

2.23

big endian

ordering scheme for storing or transmitting data in which the most significant part of a multiple-octet data is stored at the lowest octet address, and transmitted first

[IEC 61375-1:2007, 1.3.16]

NOTE See also: “little endian”.

2.24

billing demand

demand upon which billing to a customer is based, as specified in a rate schedule or contract

NOTE Billing demand may be based on the contract year, a contract minimum, or a previous maximum and therefore does not necessarily coincide with the actual measured demand of the billing period.

[EEI 2005]

2.25

billing determinant

processed number, after all multiplications and adjustments are made (such as the normalization of demand for a particular time scale), against which one multiplies the rate, to determine the customer's bill

[Aclara 2008]

2.26

billing system

system to generate customer bills based upon metered data, and to provide information regarding how the bill was created

NOTE A billing system is customarily a component of a customer information system.

2.27

billing window

regulatory timeframe in which meters must be read

NOTE The metering system, meter data management system, customer information system, and possibly other systems must collaborate to read meters and deliver bills within the billing window.

[Aclara 2008]

2.28

breaker control

operator or manual opening or closing of a circuit breaker to isolate a fault or change the network configuration

2.29

busbar

low impedance conductor to which several electric circuits can be separately connected

[IEC 60050-605:1983, 605-02-01]

2.30

busbar voltage control

regulation of voltage on the distribution substation busbar by means of transformer load tap adjustments

NOTE Includes control of either single or paralleled substation transformers.

2.31

business functions

functions that form part of a business process

NOTE The functions may be performed manually and/or by one or more software applications.

2.32

cartographic map

map which displays planimetric and/or topographic information, and which may be used as a base for a thematic layer

NOTE 1 Features, which may be included on a base map, are roads, rivers, major structures (buildings), contours, etc. Feature presentation will, however, be map scale dependent.

NOTE 2 A cartographic feature is a term applied to the natural or cultural objects shown on a map or chart.

NOTE 3 See also: "geographic information system".

2.33**channel**

single flow path for digital data usually in distinction from other parallel paths

[Aclara 2008]

2.34**circuit**

feeder

normal or actual configuration of a specific distribution circuit originating at a substation and extending to either normally open switches of other distribution circuits or simply terminating at different end points

2.35**class**

definition of the attribute and methods for a type of object

NOTE See also: "object".

2.36**clearance**

safety permit

special authority given a person or persons working on de-energized cables, wires or equipment

2.37**client (information technology)**

requester of either or both services or resources

NOTE The client is the code or process that invokes an operation on an object.

2.38**cold load pickup**

<current> loading imposed on a distribution feeder after service restoration in which some loss of load diversity has occurred

[Lawhead, et. al. 2006]

<process> a controlled process used to restore power to such areas

2.39**common facilities**

sets of programs and documents used by applications through a common interface

2.40**communication services**

operation or function that an object and/or object class performs at the behest of another object and/or class to integrate or adapt one or more components

NOTE To connect multiple components, an integration system must reconcile network and protocol differences.

2.41**component**

set of services with a well-defined interface

NOTE A component can be as large as a complete (legacy) application which implements multiple services or as small as a tiny widget which implements only one service. Components are independent software entities, which encapsulate (private) data the component needs to know to perform its business function. For example, it can perform any function that is required for distribution management. Typical categories of functions are showed in the interface reference model.

2.42

component adapter

piece of software that has the role of making non-compliant components compliant with the IEC 61968 series

NOTE 1 The component adapter only goes as far as necessary to make the component conformant to one or more specific IEC interface specifications.

NOTE 2 A component adapter is a type of wrapper.

2.43

configuration data exchange

transfer of a particular group of settings to a device to allow it to operate correctly in the network

NOTE 1 The transfer of information may be due to the commissioning of new equipment in the network, or to enable one piece of equipment to take the place of another.

NOTE 2 In SCADA applications, inter-substation computer communications may occur to transfer control/monitoring of devices to an adjacent substation due to reconfiguration or outage.

2.44

connectivity model

complete description of the electrical connections between lines, cables, switches, isolators and other network components

2.45

consumer

customer

one who consumes the service provided by the utility

NOTE The consumer may be classified as a residential, commercial, industrial, or some other type of customer; and may consume electricity, gas, water, and/or some other service.

[Aclara 2008]

2.46

consumption

metered usage of a given commodity over a specific period of time

NOTE Consumption is usually expressed in terms of a given flow direction and unit of measure.

2.47

contingency analysis

study of the effect of unexpected failure or outage of a system component

NOTE In distribution systems, it generally involves the study of how to restore power to customers when the normal supply path is unavailable.

It is also an operating application which computes the potential effect of contingencies involving the loss of generation and transmission facilities. A specific set of predefined contingencies is analyzed on a cyclic basis. It simulates a contingency and calculates the changes in busbar voltages and power flows resulting from the contingency. The base conditions for this calculation are the busbar voltages or power flows obtained from the load flow program.

2.48

continuous cumulative maximum demand

continuous cumulative demand

the sum of the previous billing period maximum demands and the present period maximum demand

[EEI 2002]

NOTE See also: "cumulative maximum demand".

2.49**crew dispatch schedule**

dynamically created schedule in which the work order for a specific crew is described

NOTE The schedule is based on the planned work or unplanned service interruptions in the infrastructure known at the moment the schedule was created.

2.50**crew management**

tracking of crew details schedules, crewmembers and all general activities related to outage and general operational investigations

2.51**crew scheduling**

dispatch of service people for customer service calls and distribution construction, and the recording and monitoring of time spent on each call

2.52**crew tracking reports**

dynamic information about the location, and progress of field crews in dealing with the work assigned to the current control

2.53**critical peak pricing**

type of dynamic pricing whereby the majority of kWh usage is priced on a TOU basis, but where certain hours on certain days where the system is experiencing high peak demand are subject to higher hourly energy prices that reflect market conditions for peak generation and delivery during peak demand periods

NOTE These critical period prices may be known to electricity customers under conditions such as "day-ahead" or "hour ahead" and are typically employed a limited number of times per year.

[DRAM 2008]

2.54**cumulative maximum demand**

cumulative demand

the sum of the previous billing period maximum demand readings

NOTE 1 At the time of billing period reset, the maximum demand for the most recent billing period is added to the previously accumulated total of all maximum demands.

[EEI 2002]

NOTE 2 See also: "maximum demand", and "continuous cumulative maximum demand".

2.55**current control**

management of circulating current in a parallel transformer configuration at the distribution substation

NOTE Current control reduces substation transformer load losses and minimizes transformer overloads by balancing loading between transformers in the same or adjacent distribution substations.

2.56**current transformer**

instrument transformer designed for use in the measurement or control of current

NOTE The current transformer's primary winding, which may be a single turn or bus bar, is connected in series with the load. It is normally used to reduce primary current by a known ratio to within the range of a connected measuring device.

[EEI 2002]

2.57

current transformer ratio

effective turns ratio of a current transformer

[Aclara 2008]

2.58

customer information system

system that maintains customer information

NOTE The customer information system may consist of a suite of applications, typically provided and integrated by a single vendor, which in addition to maintaining customer information, perform customer billing, finance, accounting functions, and possibly other services.

[MultiSpeak 2005, modified]

2.59

customer outage analysis

up-to-date information on the number of customers affected by a specific network incident

2.60

customer program

classification scheme for the sale of energy to consumers according to a particular tariff

NOTE 1 The program may specify the purpose, conditions on the time of use, the service voltage(s), the volumes consumed, and/or other terms as a condition of the sale.

NOTE 2 Utilities may promote particular programs to their industrial, commercial, agricultural, and residential customers in an effort to encourage a particular behaviour, or to make them aware of their options.

2.61

cycle day

recurring day on the calendar, within each month, upon which a meter reading is to occur

[Aclara 2008]

2.62

data element

generic term for a data item to be read from or written to a meter or other end device

NOTE A data element may be a "measurement" or a "parameter."

[Aclara 2008, modified]

2.63

data logger

system to measure a number of variables and make written tabulations and/or record in a form suitable for computer input

[IEEE 2000]

2.64

data model

collection of descriptions of data structures and their contained fields, together with the operations or functions that manipulate them

2.65

data warehouse

repository of data

2.66**database management/security**

process of maintaining the integrity of database

NOTE 1 Database security management provides the required maintenance of data elements and controls the data requirements of other subsystems.

NOTE 2 Security management encompasses access control authorization facilities and partitioning the network. Security management may also include support for encryption and maintenance of security logs

2.67**deferred synchronous request**

request where the client does not wait for completion of the request, but does intend to accept results later

NOTE This is in contrast to synchronous request and one-way request.

2.68**demand**

average power or a related quantity over a specified interval of time

NOTE 1 Demand (in a distribution network) is expressed in kW, kVA, kVAr, or other suitable units.

NOTE 2 An interval may be 1 min, 5 min, 10 min, 15 min, 30 min, or 60 min.

NOTE 3 "Forward energy" is generally used as the basis for a demand calculation since the primary purpose is to determine the capacity of the infrastructure required to serve the load.

NOTE 4 While meters commonly store demand data measured to the tariff-prescribed demand-interval, scaling must commonly occur before these values can be truly expressed in SI units such as kW or kVAr. It is important for data producers and data consumers to be clear regarding which scalars have been applied and which are pending.

[ANSI 2001, modified, IEEE 2000, modified, and EEI 2002, modified]

NOTE 5 See also: "load".

2.69**demand reset**

the process of zeroing the maximum demand accumulator

NOTE This usually involves shifting the "present maximum demand" to become the new "previous maximum demand," and zeroing the "present maximum demand."

[Aclara 2008]

2.70**demand reset count**

count which represents the number of times a given meter has undergone a demand reset

[Aclara 2008]

2.71**demand response**

reduction of customer energy usage at times of peak usage in order to help address system reliability, reflect market conditions and pricing, and support infrastructure optimization or deferral

NOTE 1 Demand response programs may include dynamic pricing/tariffs, price-responsive demand bidding, contractually obligated and voluntary curtailment, and direct load control/cycling.

[DRAM 2008]

NOTE 2 See also: "direct load control".

2.72

demand subinterval

portion of a demand interval used in rolling block demand calculations

NOTE A demand subinterval will always divide into a demand interval evenly. For example, a 15-minute demand interval can divide into three 5-minute subintervals. A subinterval may be 1 min, 3 min, 5 min, 10 min, 15 min, or 30 min in length, provided that it divides into the corresponding demand interval one or more (integer) times.

[Aclara 2008]

2.73

demand-side management

functions that enable the utility to manage the demand curve in an emergency or planned mode and to determine the customer load curve

NOTE Demand-side management functions include load control and load survey.

2.74

department

business function, for example handling outages, repairs on meters and repairs on the distribution network, or customer care

2.75

derived

<generic> data value calculated from one or more related measurements

NOTE 1 The calculation of the data value may be based on inputs which are of a different reading type than the resultant reading type. For example, a value for “average power” might be computed (derived) from several discrete “instantaneous power” measurements.

NOTE 2 See also: “estimated”.

<inferred> data value deduced from data at related locations

NOTE 3 When a number of meters below a given service transformer are de-energized, it might be possible to infer that the service transformer and other service points below the same transformer all have an energization status of de-energized and a quality of “derived (inferred).”

2.76

detent

mechanism which permits a meter dial to spin in one direction only (i.e. “forward” or “reverse” only)

[Aclara 2008]

2.77

device operation history

data concerning the operation of electrical devices, often used in condition-based maintenance schemes

2.78

diagnostic

process by which hardware malfunctions may be detected

[IEEE 2000]

2.79

dial reading

literally, the value presented by the meter dials to a human meter reader before applying any display scalar indicated on a human readable label

[Aclara 2008]

2.80**direct load control**

system or program that allows utilities, other load serving entities, or demand response service providers to control user load via (1) directly cycling discretionary load of certain end uses, (2) directly turning off such loads or (3) implementing custom load control strategies that reduce peak usage

[DRAM 2008]

NOTE See also: "demand response" and "load control".

2.81**dispatchable generation**

generation under the control of a dispatcher or system operator

2.82**dispatchable load**

load under the control of a load control system

NOTE Usually, such loads are selected in advance to be "deferrable" and to have negligible adverse impact on the consumer. Examples include certain pumping, heating, and cooling applications.

2.83**dispatcher**

person responsible for the controls at the master station

2.84**display multiplier**

value the meter display must be multiplied by in order to obtain the metered usage

NOTE 1 The display multiplier is also known by its symbol "Kr".

NOTE 2 The vast majority of meters have a value of $K_r=1$. Some meters have a value of $K_r=10$, or some other value.

[Aclara 2008, modified]

2.85**distributed generation**

small amounts of generation or pieces of generation equipment applied to a utility's distribution system for the purpose of meeting local peak loads and/or displacing the need to build additional (or upgrade) local distribution lines and infrastructure

NOTE Distributed generation may be in the form of gas or propane generators, fuel cells, etc.

[Itron 2008]

2.86**distributed load control**

load controlled with utility commands from a remote location as well as from a local controller that responds to local conditions

NOTE The customer may retain the option to override or modify the utility command.

2.87**distribution automation**

actions to carry out automation of the distribution networks to enable automatic or remote operation

NOTE 1 May include retrofitting switchgear with actuators/motors and the installation of RTU's.

NOTE 2 The action to restore supply post-fault may be initiated manually via a SCADA system, or automatically by IED's, RTU's, FPI's or EFI's.

2.88

distribution management system

integration of business processes, hardware, software, and telecommunications equipment that provide effective tools to manage the operational business processes related to network management, outage management, power quality and other supporting operational practices

2.89

distribution network

distribution-voltage side of a substation including all of the lines, switches, transformers, and protective devices

[Aclara 2008]

2.90

domain

scope

<distribution management> business functions, software systems, physical equipment and staff concerned with the distribution of electrical power to consumers

<utility> software systems, equipment, staff and consumers of a single utility organization, which could be a company or a department.

NOTE It is expected that within each utility domain, the systems, equipment, staff and consumers can be uniquely identified. When information is exchanged between two utility domains, then identifiers may need extending with the identity of the utility organization in order to guarantee global uniqueness.

2.91

dynamic pricing

retail prices for energy consumed that offer different prices during different time periods and reflect the fact that power generation costs and wholesale power purchase costs vary during different time periods

NOTE Types include time-of-use pricing, critical peak pricing and real-time pricing.

[DRAM 2008]

2.92

economic dispatch (function)

<real-time mode> adjustment of generation output among committed units in order to minimize total operating cost

<study mode> scheduling of generation allocation among units in order to minimize total operating cost

NOTE 1 The economic dispatch function is closely coupled with the automatic generation control function.

NOTE 2 The study mode will examine generation allocation over a longer period of time than the real-time mode. (For example the study mode may examine a week-long schedule while real-time mode would examine only the next hour.)

2.93

edited

value modified by a human

NOTE 1 In the context of VEE, “edited” means that the value has been modified by a human.

NOTE 2 See also: “derived”, and “estimated”.

2.94

electricity meter

device that measures and registers the integral of an electrical quantity with respect to time

[IEEE 2000]

2.95**electronic billing**

<process> utility back-office application which uses computers and data communications, as opposed to manual methods, to compute the customer's bill and request payment

<interface> a service provided by the utility in which there is a transmission of an electronic customer usage bill on a periodic basis (typically monthly) to customers

2.96**emergency demand response programs**

programs which are dispatched by system operators when system operating reserves drop to levels such that load reductions are needed to maintain short-term system reliability

[DRAM 2008]

2.97**emergency response**

off-site facility that has direct dial lines into regulatory agencies and the press for use in a nuclear emergency

2.98**end device**

equipment located at the end of a communication network

NOTE This equipment is usually on the customer premises. It may perform functions such as metrology, remote connect/disconnect, load control, demand response, or other functions, and may have power relay and/or secondary communications capability.

2.99**energization (status)**

state of equipment describing if it is powered ("energized," or "live") or not powered ("de-energized," or "dead")

NOTE See also: "verify meter power".

2.100**energy accounting**

accounting of energy sales and purchases to and from other utilities

NOTE 1 The data collection function of energy accounting tracks the actual amount of power exchanged with other utilities.

NOTE 2 The account reconciliation function of energy accounting reports inadvertent data by comparing data from the interchange planning function (planned power exchange) with the data from the data collection function of energy accounting (actual power exchanged).

NOTE 3 The energy accounting function also includes billing co-generators and other utilities for power sold.

2.101**energy management system**

computer system comprising a software platform providing basic support services and a set of applications providing the functionality needed for the effective operation of electrical generation and transmission facilities so as to assure adequate security of energy supply at minimum cost

[IEC 61970-2:2004, 3.24]

2.102**estimated**

data value determined from one or more measurements of the same kind taken from the same or a similar source

NOTE 1 Estimated values are generally supplied because the original value was considered bad or was missing. For example, a missing “60-minute Incremental IntervalData Net Energy (kWh)” reading might be computed (estimated) from a number of readings of the same kind, taken from the same meter a few hours prior and a few hours after.

NOTE 2 In the context of VEE, “estimated” means that the value has been determined by an algorithm that may involve interpolation, extrapolation, substitution, or other prescribed logic.

NOTE 3 See also: “derived”.

2.103

equipment characteristics

data concerning the nature and operational parameters of physical devices designed to perform particular functions

NOTE Characteristics can be viewed as a relationship between two or more variable quantities which describes the performance of a device under a given condition.

2.104

equipment operation statistics

data such as the duration of time, the number of times, or other parameters that indicate how a physical device has performed its function over a period of time

2.105

false alarm

an indicated fault where no fault exists

[IEC 62243:2005, 3.1.8]

2.106

fault

unplanned power interruption

2.107

fault analysis

review of fault records, sequence of events records, and other documentation produced upon a fault to determine the cause of the fault, its total impact, steps taken by the system to recover from the fault, and the possible avoidance of a future occurrence

NOTE The data analyzed includes pre-fault information as well as post fault information for a specified period.

2.108

fault isolation

process of isolating the segment of faulted transmission or distribution network

2.109

fault locations estimates

estimate based on the obtained information about the fault, for example Ohms from a distance relay, which is used to calculate the estimated location of the fault

2.110

fault restoration

outage restoration

process of restoring the faulted segment of transmission or distribution network

2.111

feeder

circuit

normal or actual configuration of a specific distribution circuit originating at a substation and extending to either normally open switches of other distribution circuits or simply terminating at different end points

2.112**firmware**

combination of software and data that reside on ROM, EEROM, or some similar permanent or semi-permanent storage medium

[IEEE 2000, modified]

2.113**fixed interval demand calculation**

fixed block demand calculation

monitoring of demand by using a method that measures the average power over a fixed period of time

NOTE 1 Demand intervals are typically 15 min or 30 min in length.

[Aclara 2008]

NOTE 2 See also: "rolling interval demand calculation", and "demand".

2.114**flow direction**

accounting of the way energy flows through the meter

NOTE 1 There are 4 basic flow directions for active energy: "forward", "reverse", "net", and "total".

NOTE 2 See also: "forward energy", "reverse energy", "net energy", "total energy", and "four-quadrant metering".

2.115**forward energy US SA**

positive energy US

delivered energy US

imported energy GB

exported energy AU

quantity of energy delivered by the distribution network to the electrical service

NOTE 1 "Forward energy" may refer to "active", "apparent", or "reactive" energies.



NOTE 2 The value may roll-over to zero at some point depending on the capability of the meter register.

[Aclara 2008, modified]

NOTE 3 See also: "reverse energy", "net energy", "total energy", "flow direction", and "four-quadrant metering".

2.116**four-quadrant metering**

process of measuring reactive and real energy while accounting for both forward and reverse flows

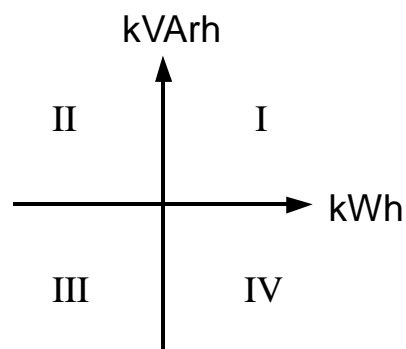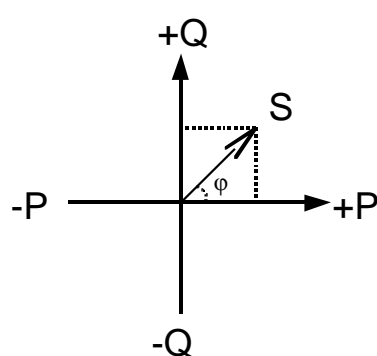

IEC 667/11

NOTE 1 Power is often computed as the vector $S = P + jQ$, where reactive power (Q , in VAR units) is plotted on the ordinate axis, and real power (P , in Watts) is plotted on the abscissa. Four-quadrant metering is the extension of

this power-flow concept to energy. The flow of power will result in the registration of energy in quadrants that correspond to the power vector location.

NOTE 2 Quadrant I is defined as an area where both energies flow positively (both are delivered to the service). In quadrant II, reactive energy is positive and real energy flows negatively. In quadrant III, reactive and real energies flow negatively (both energies are received from the service). In quadrant IV, reactive energy flows negatively, and real energy flows positively.

NOTE 3 See also: “flow direction”.

2.117

frequency relay

device that functions on a predetermined value of frequency - either under or over normal system frequency or rate of change of frequency

NOTE When it is used to function on a predetermined value below nominal frequency, it is generally called an “under-frequency relay”, and when it functions on a predetermined value above nominal, it is called an “over-frequency relay”.

[IEEE 1986]

2.118

geographic information system

data system which provides a visualization of spatially (geographic) related data

[Kurland and Gorr 2007]

2.119

home area network

electronic network situated within the general environment of a residential dwelling and that connects enabled nodes within that dwelling

[ISO/IEC 15045-1:2004, 3.1.4, modified]

2.120

implementation

portion of a code composition that is executed, i.e. a definition that provides the information needed to create an object and allow the object to participate in providing an appropriate set of services

NOTE An implementation typically includes a description of the data structure used to represent the core state associated with an object, as well as definitions of the methods that access that data structure. It will also typically include information about the intended interface of the object.

2.121

inbound transaction

communication that is travelling (inward) from the field to the central control or main office

[Aclara 2008]

2.122

incident simulation

recreating an incident on the network for analysis and also for training

2.123

incremental data

data which is based on the difference between two data samples at two prescribed moments in time

NOTE 1 The data may have been scaled and may consist of a signed or unsigned value.

[Aclara 2008]

NOTE 2 See also: “absolute data”.

2.124**instance**

<of an interface> object that provides the operations, signatures and semantics specified by that interface

<of an implementation> object whose behaviour is provided by that implementation

2.125**instantaneous (value)**

value computed in a way so as to describe the measurement at the current moment

NOTE 1 Instantaneous values are usually measured over a short period of time – usually a few cycles – at most a few seconds.

NOTE 2 See also: “present value”, and “last completed value”.

2.126**inter application**

between two or more applications

2.127**interactive voice response**

system to process customer telephone inquiries without the need for human intervention through the use of automated query/response scripts

NOTE Human intervention can often be requested if needed. These systems are often used for trouble reporting.

2.128**interface**

complete protocol used by a class for all of its messaging

NOTE 1 The interface is a listing of the operations and attributes that an object provides. This includes the signatures of the operations, and the types of the attributes.

NOTE 2 An interface definition ideally includes the semantics as well. An object satisfies an interface if it can be specified as the target object in each potential request described by the interface.

2.129**interface adapters**

standards software interface that facilitates a software module to communicate and share of information with other software modules

2.130**interface profile**

description of the set of interfaces for an abstract component using a specified type of middleware

2.131**interface reference model**

architecture model of business functions, abstract components and middleware

2.132**ITI curve**

curve which describes an AC input voltage (defined by the ITI/CBEMA application note) which typically can be tolerated (with no interruption in function) by most information technology equipment

NOTE Seven types of events are described by the composite envelope: steady-state tolerances, line voltage swell, low frequency decaying ringwave, high-frequency impulse and ringwave, voltage sags to 80 % of nominal, voltage sags to 70 % of nominal, and dropout; plus a no-damage-region and a prohibited-region are depicted in accordance with the ITI (CBEMA) application note.

[ITI 2000]

2.133

interoperable

able to exchange information needed to properly perform their respective functions

NOTE This is normally achieved by using only published standard application program interface (API) definitions that specify compatible data definitions and exchange methods.

2.134

intra-application

within the same application

2.135

interruptible power

power made available under agreements that permit curtailment or cessation of delivery by the supplier

[EEI 2005]

2.136

interruption

loss of service to one or more customers connected to the distribution network

[IEEE 2000, modified]

2.137

interruption threshold

voltage magnitude specified for the purpose of detecting the start and the end of a voltage interruption

[IEC 61000-4-30:2008, 3.17]

2.138

interval data

interval data readings

data captured at regular intervals of time

NOTE Interval data could be captured as incremental data, absolute data, or relative data. The source for the data is usually a tariff quantity or an engineering quantity. Data is typically captured in time-tagged, uniform, fixed-length intervals of 5 min, 10 min, 15 min, 30 min, or 60 min.

[Aclara 2008]

2.139

interval data recorder

system which records metrology data in the form of a series of time-stamped readings

NOTE Some interval data recording systems are capable of simultaneously recording multiple channels of interval data.

[Aclara 2008, modified]

2.140

interval meter

meter that measures and records data on either predetermined or remotely configurable time intervals, where the intervals are in increments such as minutes or hours

NOTE The data collected is typically usage in kWh expressed as a specific flow direction (such as Net, Forward, or Reverse). Some interval meters are capable of recording multiple channels of interval data. The collection of kVAh intervals is also quite common. Usage is usually recorded as a series of incremental values, while other quantities such as voltage and current are typically recorded as absolute values.

[DRAM 2008]

2.141**inventory**

list of articles, typically giving the code number, quantity, and value of each

2.142**issue (of an item)**

physical movement of an item from a stocking location

NOTE An issue can result from the fulfilment of a sales order, or from a manufacturing production order, or from a work order.

2.143**lagging current**

alternating current which, in each half-cycle, reaches its maximum value a fraction of a cycle later than the maximum value of the voltage which produces it

[EEI 2002]

2.144**last completed (value)**

last completed calculation in a time-based series of derived quantities

NOTE See also: "present value".

2.145**leading current**

alternating current which, in each half-cycle, reaches its maximum value a fraction of a cycle sooner than the maximum value of the voltage which produces it

[EEI 2002]

2.146**little endian**

ordering scheme for storing or transmitting data in which the least significant part of a multiple-octet data is stored at the lowest octet address, and transmitted first

[IEC 61375-1:2007, 1.3.85]

NOTE See also: "big endian".

2.147**load (electric)**

electric power used by devices connected to an electrical generating system

[IEEE 2000]

2.148**load analysis**

modelling and prediction of loads on the distribution network

NOTE Models will frequently be based on historical usage patterns as a function of time of day, circuit topology, load flow, transmission constraints, customer demographics, and weather. Prediction may typically support analysis where scenarios show the loss of a critical asset, changes to the circuit topology, new construction, and weather forecasts. The load analysis might occur as part of an engineering analysis program, or a load analysis program running in the network operations centre.

[Aclara 2008]

2.149**load control**

explicit action taken to reduce the load at a given point in time

NOTE 1 The action taken may involve: voltage reduction, switching off selected customer devices or totally interrupting supply to some customers, etc.

NOTE 2 See also: “direct load control” and “demand response”.

2.150

load control device

type of “end device” which can receive signals causing it to shed load for the purposes of maintaining network reliability and/or commercial agreements

2.151

load forecast

forecast of the expected load at a specific time and day-of-week for each feeder in the network

2.152

load forecasting

function which predicts the hourly system load

NOTE The load forecasting function typically maintains a real-time forecast and a study forecast. The real-time forecast is typically based on actual historical load and weather data and generates a load forecast for the current hour. The study forecast typically uses a completely independent set of historical and predicted data that the operator may use to set up and evaluate hypothetical situations up to seven days in the future.

2.153

load management

term used to refer to interruptible rates, curtailment programs and direct load control programs

[DRAM 2008]

2.154

load management system

system that encompasses the complete load management needs of the utility

NOTE The system will support one or more of the following functions: load control, load analysis, or demand response.

[Aclara 2008]

2.155

load profile

time series representation of the variation of load with time, usually on an hourly basis, for a particular day

[IEEE 2000, modified]

2.156

load shedding

emergency disconnection of customer loads to preserve the power network operation

NOTE Load shedding removes overloads and arrests consequent frequency decline without disrupting the utility transmission grid.

2.157

log

record of events and the time of their occurrence

[Aclara 2008]

2.158

low voltage

portion of the electrical distribution network which is below a specified voltage

**2.159
maintenance**

work involving inspection, cleaning, adjustment, or other service of equipment to enable it to perform better or to extend its service life

NOTE Generally, although not always, equipment must be taken out of service while it is undergoing maintenance.

**2.160
maintenance scheduling**

planning the specific times when a set of maintenance activities should be performed

NOTE Maintenance scheduling requires the consideration of a variety of constraining factors such as the impact of removing the equipment from service, availability and workload of maintenance crews, etc.

**2.161
manually accepted**

value which is perhaps questionable, but approved by a human without modification

NOTE 1 In the context of VEE, a “manually accepted” value is one which has been approved for use even though it may have failed validation checks.

NOTE 2 See also: “edited”, and “questionable”.

**2.162
master resource identifier**

provides a unique ID number for a named item

**2.163
maximum demand**

peak demand

highest demand over a selected period of time

[ANSI 2008]

**2.164
message (in distribution management)**

specification of the conveyance of information from one instance to another, with the expectation that activity will ensue

NOTE A message may specify the raising of a signal or the call of an operation.

**2.165
message brokers**

message brokers enable objects to transparently make and receive requests and responses in a distributed environment

**2.166
message queue middleware**

middleware which employs a message queuing mechanism to provide reliable, asynchronous and loosely coupled communication services

**2.167
metadata**

data that describes data

NOTE Data dictionaries and repositories are examples of metadata. The term may also refer to any file or database that holds information about another database's structure, attributes, processing or changes.

2.168

meter

type of “end device” which performs metrology and supports the tariffing of the distribution and/or transmission network

NOTE A meter could be defined as a 61850 device with logical nodes.

2.169

meter badge

utility defined area of a meter nameplate

NOTE The meter badge may contain a barcode, an AEP code, required CT and VT ratios, etc.

[Aclara 2008]

2.170

meter changeout

meter replacement

process of replacing an existing meter with a new meter

NOTE The installer will customarily follow a work order which specifies a given location, and usually requires that he or she capture readings from the old and new meters, and record the time and day in which the work was performed.

2.171

meter class (watthour meter)

identifies the maximum of the load range in amperes

[ANSI 2001, IEEE 2000]

2.172

meter communication module

component of a meter which enables participation in a communication network

[Aclara 2008]

2.173

meter data management

application component that solicits and/or aggregates meter reading data from one or more metering systems and supplies meter data to other systems

NOTE 1 The meter data management application component may perform validating, editing, and estimating (VEE) on the data.

NOTE 2 Meter readings may be warehoused for use by other applications such as billing and historical analysis.

NOTE 3 The meter data management application may manage configuration information for meters and maintain measurement histories. It may also issue configuration commands to the metering system.

NOTE 4 The meter data management application may broker control commands and issue suitable commands to the appropriate metering system.

NOTE 5 A meter data management system may include a meter data management application and other related applications.

2.174

meter data recorder

interval data recording system which records metrology data in the form of a series of incremental, absolute, or relative readings, and attributes a capture time and status to the recorded value

[Aclara 2008]

2.175**meter divergence**

form of cumulative error where the AMR supplied value differs from the dial-face reading, and over time, the error grows

[Aclara 2008]

2.176**meter form**

alphanumeric designation denoting the circuit arrangement for which the meter is applicable and its specific terminal arrangement

NOTE The same designation is applicable to equivalent ANSI meters of all manufacturers.

[ANSI 2001, IEEE 2000, definition of watthour meter form]

2.177**meter nameplate**

nameplate placed on the meter by the manufacturer

NOTE The nameplate will contain information required by national standards such as form, volts, class, etc.; and may also have a utility defined area.

[Aclara 2008]

2.178**meter number**

number assigned to the meter by the system of record in the utility

[Aclara 2008]

2.179**meter records**

history of the meter usage readings on a periodic basis

NOTE Meter records will also include customers who used the power at the meter location.

2.180**meter seal**

device which mechanically seals the meter and provides an indication of tampering when the seal is broken

NOTE Early seal designs simply used pressed lead to join two wires. Many modern seal designs are lead-free and have unique ID numbers, or display a company logo.

[Aclara 2008]

2.181**meter serial number**

number assigned to the metrology portion of the meter by the meter manufacturer

[Aclara 2008, modified]

2.182**metershop**

place where meters are inspected, repaired, tested, and adjusted

[ANSI 2001]

2.183**method**

operation

single request or message made available by a server, i.e. an implementation of an operation

NOTE Methods are often implemented as code which is executed to perform a requested service. Methods associated with an object may be structured into one or more programs.

2.184**middleware adapter**

software that has the role to make non-IEC compliant middleware services compliant with the IEC 61968 interface specifications

2.185**middleware services**

services to allow the previous layers in the IEC 61968 service profile to interact transparently across the network with other applications or services

NOTE Middleware services can provide an application independence from communication profile services, reliable delivery, and other benefits.

2.186**net energy**

flow direction that is accounted for as forward energy minus reverse energy

$$\text{Net energy} = |\text{forward energy}| - |\text{reverse energy}|$$

[Aclara 2008]

NOTE 1 "Net energy" may refer to "active", "apparent", or "reactive" energies.

NOTE 2 See also: "forward energy", "reverse energy", "total energy" and "flow direction".

2.187**net metering**

utility metering practice in which utilities measure and bill for the net electricity consumption or generation of their customers with small generators

NOTE Net metering can be accomplished through two means: (1) A single, bi-directional electric meter that turns backward when the customer's generator is producing energy in excess of his demand and forward when the customer's demand exceeds the energy generated or (2) By separately metering the flows of electricity into and out of the customer's facility. Net metering provisions vary by state and utility, but usually apply only to very small generators that typically use solar or wind energy.

[EEI 2005]

2.188**network**

system for delivering services

NOTE An electrical distribution network would consist of all of the interconnected electrical elements starting at the end of the transmission network, and ending at the start of the premises wiring. A communication network would consist of all interconnected or inter-related communication nodes. Some AMI systems leverage portions of the distribution network hardware in order to form a communication network, other AMI technologies establish an infrastructure to carry information which is completely separate from the electrical distribution network.

[Aclara 2008]

2.189**network calculation**

suite of applications software used to analyze the capacity, efficiency and reliability of the power network

2.190**network state supervision**

monitoring and supervision of feeder networks

2.191**notification**

message which reports a change in the operational state of a piece of equipment

[Aclara 2008]

2.192**object**

instance of a class, supporting encapsulation, inheritance and polymorphism

NOTE An object is a combination of a state and a set of methods that explicitly embodies an abstraction characterized by the behaviour of relevant requests. An object is an instance of an implementation and an interface. An object models a real-world entity, and it is implemented as a computational entity that encapsulates state and operations (internally implemented as data and methods) and responds to request or services.

2.193**one-way (communication)**

system that communicates in one direction only – from the sender to the receiver

NOTE 1 The system might be architected to move data from the central office to the communication endpoint(s) in the field (outbound-only), or it might be built to move data from the endpoint(s) in the field to the central office (inbound-only). Some systems which are capable of one-way communication are also capable of two-way communication. Some systems support two-way communication at certain levels in their architecture, and one-way communication at other levels.

[Aclara 2008, modified]

NOTE 2 See also: "two-way", "inbound", and "outbound".

2.194**on-request read**

on-demand read

request by a data consumer to create a fresh reading by a data provider

NOTE The request carries with it an expectation of a near real time response.

[Aclara 2008]

2.195**optimal power flow**

optimal solution of power flow calculations in a transmission or a distribution network

2.196**outage**

loss of service to a consumer's electrical service due to the failure of a component

[IEEE 2000]

2.197**outage analysis**

process of analyzing information from distribution automation, an energy management system, and/or a customer information system regarding trouble calls, blackouts, and circuit outages to determine service outages and assist in the power restoration process

2.198**outage management system**

all related business processes and supporting technologies related to interruption of electric power supply to customers

NOTE These generally include trouble call handling, customer notification, probable device prediction, dispatching workflows for outages and general electric service problems, network management, crew management and reliability reporting.

2.199

outage mapping

process of discovering the scope of an outage as it relates to the affected service territory

[Aclara 2008]

2.200

outage report

progress report on restoration of supplies following a fault

NOTE Outage reports indicate whether each outage is a chargeable outage to the utility and must be reported in reliability statistics.

2.201

outage schedules

data which defines the time, duration, and extent of planned outages

2.202

outbound transaction

communication that is travelling (outward) away from the central control or main office

[Aclara 2008]

2.203

overflow

condition that arises when the result of an arithmetic operation exceeds the capacity of the number representation system used in a digital computer

[IEEE 2000]

2.204

overvoltage event

voltage swell

increase in the measured voltage of the power system above a predefined (critical) voltage and duration threshold

[Aclara 2008]

2.205

payment meter

electricity meter with additional functionality that can be operated and controlled to allow the flow of energy according to agreed payment modes

[IEC 62055-31:2005, 3.1.6]

2.206

peer (inter-process communication)

another process with similar capabilities of making and servicing requests

2.207

performance based rates

method of determining compensation for an electric utility based upon its performance

NOTE Reliability is often one of the measures used to compute performance.

[Aclara 2008]

2.208**performance based regulation**

rate-setting mechanism which attempts to link rewards (generally profits) to desired results or targets

NOTE Performance based regulation sets rates, or components of rates, for a period of time based on external indices rather than a utility's cost-of-service. A form of rate regulation which provides utilities with better incentives to reduce their costs than does cost-of-service regulation.

[EnergyBuyer 2006]

2.209**performance monitoring**

monitoring procedure implementing data acquisition processes to obtain performance data by using specialized performance testing equipment and documenting performance-monitoring results

2.210**permanent location number**

number assigned to an area of land independent of any improvements upon it

[Aclara 2008]

2.211**phase imbalance**

condition in which the vector sum of the electrical phases has moved significantly away from zero

[Aclara 2008]

2.212**ping**, verb (in metering networks)

verify successful two-way communication using a brief message

NOTE The result of a ping determines the reachability and/or energization status of the endpoint.

2.213**planning**

determines the regulating and support conditions of voltage control devices and the necessary magnitude, sign, and location of reactive power injection into an electric network to maintain desired system voltage profile; minimize system loss; maintain system stability while maximizing power transfer; reduce generation production costs; and unload transmission system equipment through reduction of reactive flows

2.214**point of common coupling**

point at which the electric utility and the interface to the premises wiring occurs

NOTE 1 Typically, this point is at the utility revenue meter.

NOTE 2 See also: "service point".

2.215**power factor**

ratio of real power to apparent power in an a.c. circuit

[IEC/TS 62257-7-3:2008, 3.14]

2.216**power flow**

function to study control actions upon the power system

NOTE The power flow function operates in two modes. Dispatcher power flow allows the operator to determine the effects of control actions (breaker switching, tap changing, and interchange adjustments) on the system. In optimal power flow, the control actions are automatically predetermined within the limitations of the power system.

2.217

power line carrier

communication system where the utility power line is used as the primary element in the communication link

[EEI 2005]

2.218

power quality

characteristics of electricity that determine its usefulness

[EEI 2005]

2.219

precision

degree of exactness or discrimination with which a quantity is stated

NOTE 1 For example, a precision of 2 decimal places versus a precision of 5 decimal places.

[IEEE 2000]

NOTE 2 See also: "resolution".

2.220

premises

building(s), grounds and appurtenances (belongings) under the control of the customer

[ISO/IEC 18010:2002, 3.1.10]

2.221

premises wiring

interior and exterior wiring, including power, lighting, control, and signal circuit wiring together with all their associated hardware, fittings, and wiring devices, both permanently and temporarily installed

This includes (a) wiring from the service point or power source to the outlets or (b) wiring from and including the power source to the outlets where there is no service point.

NOTE Such wiring does not include wiring internal to appliances, luminaries, motors, controllers, motor control centres, and similar equipment.

[NFPA 2008]

2.222

prepaid metering

method of billing in which payment is received by the utility in advance of the sale of electricity

[Aclara 2008]

2.223

prepayment mode

payment mode in which automatic interruption occurs when available credit is exhausted

[IEC 62055-31:2005, 3.1.8]

2.224**present (value)**

most recently available sampled reading

NOTE 1 While energy and power values are usually continuously available from a meter, other quantities such as demand are usually derived values. If a derived value such as "present demand" is retrieved, it should be noted that its calculation will not be complete until the end of the demand interval is reached. In such a case, it may be useful to also retrieve the "time remaining" until the end of the interval so that an estimate can be computed, or to retrieve another metric which is better suited for one's purposes.

NOTE 2 See also: "instantaneous value", and "last completed value".

2.225**present energy**

most recently available energy reading, as presented in the meter registers

NOTE The "present" value should represent the dial-reading of the meter, with allowances for update frequencies and communications latencies.

[Aclara 2008]

2.226**present maximum demand**

largest observed demand, using the configured demand calculation method, since the last demand reset

NOTE See also: "maximum demand", and "previous maximum demand".

2.227**previous energy**

value of the "present energy" register which was "shifted" or "frozen" at a particular moment in time

NOTE Registers are typically shifted at midnight.

[Aclara 2008]

2.228**previous maximum demand**

maximum demand captured as a result of a demand reset

NOTE 1 The "present maximum demand" on record just prior to the demand reset becomes the "previous maximum demand" as the result of a demand reset.

NOTE 2 See also: "maximum demand", and "present maximum demand".

2.229**primary metering**

refers to metering the load on the high voltage (primary) side of the service transformer

NOTE See also: "secondary metering".

2.230**primary voltage**

voltage of the circuit supplying power to a transformer

NOTE In contrast, the output voltage, or load-supply voltage, is called the secondary voltage. In power supply practice the primary is almost always the high-voltage side and the secondary the low-voltage side of a transformer, except at generating stations.

[EEI 2005, modified]

2.231

process

individually controllable computation entity, which may go through a series of discrete process states

2.232

public utility commission

governmental agency holding regulatory power over energy pricing, and issues related thereto

[EnergyBuyer 2006]

2.233

publish / subscribe communication

communication where the server (data provider) makes available (or publishes) data stored in its system to one or more clients, which subscribe to such data

[MultiSpeak 2005]

2.234

pulse (in distribution management)

impulse

unit of consumption that operates in proportion to the flow of the substance being metered

NOTE Pulses typically are generated by devices that have mechanical motion, and may correspond to one rotation of a disk in the metering device. Many solid-state meters also maintain the tradition of generating pulses. In this case, a pulse may correspond to a Wh or some other arbitrary reference. Pulses must (usually) be scaled (by Kh and possibly other scalars) to convert the measurement into a value that has an official (SI) unit of measure.

[Aclara 2008]

2.235

pulse device

functional unit for emitting, transmitting, retransmitting, or receiving electric pulses, representing finite quantities, such as energy, normally transmitted from some form of electricity meter to a receiver unit

[IEC 62052-11:2003, 3.2.2.4]

2.236

purchase order

document authorizing the purchase of goods or services from a specific vendor

NOTE The purchase order includes the terms of the purchase, delivery requirements, identification of goods or services ordered, as well as their quantities and prices.

2.237

q-hour

quantity obtained by effectively lagging the applied voltage to a watthour meter by 60 degrees

NOTE 1 This quantity is one of the quantities used in calculating quadergy.

NOTE 2 In a distribution network, Q-hour is usually expressed in kQh.

[IEEE 2000, modified]

2.238

quadergy

reactive energy

the integral of reactive power with respect to time

NOTE In a distribution network, quadergy is usually expressed in kVArh.

[ANSI 2001, modified, IEEE 2000, modified]

2.239**quality index analysis**

report on the overall performance of the utility in the supply of power to its customers

2.240**questionable**

value whose quality is unknown for reasons that may include, but are not limited to, failure to pass a reasonability check

2.241**rate class**

group of customers identified as a class and subject to a rate different from the rates of other groups

[EEI 2005]

2.242**rate component**

tariff component

any measurable quantity which may be used to compute a consumer's bill

NOTE 1 Typical energy rate components (in a distribution network) include forward, reverse, net and/or total quantities of: real energy (kWh), apparent energy (kVAh), and/or reactive energy (kVArh).

NOTE 2 Typical power rate components (in a distribution network) include real power (kW), apparent power (kVA), and/or reactive power (kVAh).

NOTE 3 Some tariffs may also invoke a penalty calculation based on maximum demand and/or power factor (PF).

[Aclara 2008]

2.243**rate schedule**

design and organization of billing charges to customers

NOTE A rate structure can comprise one or more of the rate schedules defined herein.

[EEI 2005]

2.244**reactive power**

non-active power for a linear two-terminal element or two-terminal circuit

NOTE 1 Under sinusoidal conditions, the reactive power is the product of the apparent power S and the sine of the displacement angle φ : $Q = S \sin \varphi$.

NOTE 2 The SI unit for reactive power is the voltampere. The special name "var" and symbol "var" are given in IEC 60027-1.

[IEC 60050-131:2002, 131-11-44]

NOTE 3 Reactive power in the distribution network is normally expressed in kVAh.

2.245**receivable**

transaction representing an invoice, credit memo or debit memo to a customer

NOTE A receivable is an open (unpaid) item in the accounts receivable ledger.

2.246

register

<electromechanical meter> a means of recording revolutions of the rotor

NOTE 1 The register is usually a mechanical assembly which is separable from other parts of the meter.

NOTE 2 The register also usually displays the recorded value.

NOTE 3 The recording is accomplished through gearings to the disk shaft. Either a clock (pointer type) or cyclometer type register may be used.

<solid-state meter> storage location for a specific data element

2.247

register constant

the factor by which the register reading must be multiplied in order to provide proper consideration of the register, or gear ratio, and of the instrument transformer ratios to obtain the registration in the desired unit

NOTE The register constant is commonly denoted by the symbol "Kr."

[IEEE 2000]

2.248

register reading

numerical value indicated by the register

NOTE Neither the register constant nor the test dial (or dials), if any exist, is considered.

[IEEE 2000]

2.249

regulator

government agency responsible for controlling or directing economic entities through the process of rule-making and adjudication

[Aclara 2008]

2.250

release/clearance remote switch command scheduling

preparation and execution of switching plans for remote switch operations and management of necessary safety documentation

2.251

remote connect / disconnect

action to perform "connect", "disconnect", or "arm" a service remotely by means of a communication network and on-site switching hardware

[Aclara 2008]

NOTE See also: "virtual disconnect".

2.252

request

communication where the client issues a request to cause a service to be performed

NOTE A request consists of an operation (i.e. the name of a method) and zero or more parameters.

2.253**request-response transaction**

request / response communication

request / reply transaction

interaction between a pair of distributed, cooperating objects, consisting of a request for service submitted to an object followed by a response conveying the result

[ISO/IEC 14776-411:1999, 3.1.67]

2.254**resolution**

least value of the measured quantity that can be distinguished

NOTE When data is exchanged between systems, resolution is often expressed as the number of digits to the right of the decimal point.

[Aclara 2008]

2.255**response**

reply

transaction conveying the result of a request

[ISO/IEC 14776-412:2006, 3.1.82]

2.256**restoration monitoring**

process of monitoring the progress of a restoration, especially as it relates to ensuring that all affected consumers have had their service restored

[Aclara 2008]

2.257**results**

information returned to the client, which may include values as well as status information indicating that exceptional conditions were raised in attempting to perform the requested service

2.258**retry**

mechanism whereby a transaction that (for whatever reason) could not complete in the current operation is attempted again at a later time

[IEEE 2000]

2.259**reverse energy** US SA

negative energy US

received energy US

imported energy AU

exported energy GB

quantity of energy received by the distribution network from the electrical service

NOTE 1 Reverse energy is customarily presented as a positive (unsigned, non-negative) value.

NOTE 2 Reverse energy may consist of any tariff energy quantity (active, apparent, and/or reactive energy), but active energy is the most common.

[Aclara 2008, modified]

NOTE 3 See also: "forward energy", "flow direction", and "four-quadrant metering".

2.260

rolling interval demand calculation

rolling block demand calculation

sliding block demand calculation

monitoring of demand by using a method that measures the average power over a sliding period of time

NOTE 1 Demand intervals are typically 15 min or 30 min in length and divided into “subintervals” which are typically 5 min in length. The process then sums adjacent subintervals together to form a value for a complete demand interval.

[Aclara 2008]

NOTE 2 See also: “fixed interval demand calculation”, and “demand”.

2.261

roll-over

process that occurs when a display or a stored unsigned integer value goes from its maximum allowed value to zero as a result of adding one

NOTE For example, when forward energy flows through a 5-dial electricity meter, its dials will go from 99999 to 00000 when it rolls-over.

[Aclara 2008]

2.262

roll-under

process that occurs when a display or a stored unsigned integer value goes from zero to its maximum allowed value as a result of subtracting one

NOTE For example, when reverse energy flows through a 5-dial electricity meter, its dials will (usually) go from 00000 to 99999 when it rolls-under.

[Aclara 2008]

2.263

sampling rate

frequency with which the event recorder regularly monitors an input channel to determine its value

[IEEE 2000]

2.264

scale, verb

to multiply the representation of a number by a factor in order to bring its range within prescribed limits

NOTE When scalars are applied there may also be a corresponding change in the unit of measure. For example, a meter reading might be converted from “pulses” to “kWh” by application of the appropriate scalar.

[IEEE 2000]

2.265

scram (in load control applications)

an action in response to an emergency in which all dispatchable load is shed as quickly as possible

NOTE The word “scram” originates from the early days of nuclear reactors and is commonly attributed to role of halting the nuclear reaction in an emergency situation. Many believe the term to be an acronym which stands for “safety control rod axe man.” The word has since found use in certain areas to identify something which requires both quick action and a full response to a critical problem.

2.266**season**

calendar-specified period used for activation of rate schedules

[IEEE 2000]

2.267**secondary watthour constant**

number of watthours per disk revolution

NOTE Commonly referred to as the meter “Kh.”

2.268**secondary metering (in distribution networks)**

metering on the low-voltage (secondary) side of a service transformer

NOTE 1 AMI systems generally publish values which reflect the dial reading of a meter, and therefore generally publish “secondary metering” values.

NOTE 2 See also: “primary metering”.

2.269**security**

information security

protection of information against unauthorized disclosure, transfer, modification, or destruction, whether accidental or intentional

[IEC 60050-721:1991, 721-08-57]

2.270**self read**

process by which a meter or meter communication module can automatically capture a reading according to a schedule or other trigger mechanism

[Aclara 2008]

2.271**server**

entity providing a service or resources

NOTE A server is a process implementing one or more operations on one or more objects.

2.272**server object**

object providing response to a request for a service

NOTE A given object may be a client for some requests and a server for other requests.

2.273**service**

<electrical> conductors and equipment for delivering electric energy from the serving utility to the wiring system of the premises served

[NFPA 2008]

<information technology> operation or function that an object and/or object class performs upon request from another object and/or object class

[IEC 61158-4-12:2010, 3.4.28]

2.274

service drop

overhead service conductors from the last pole or other aerial support to and including the splices, if any, connecting to the service-entrance conductors at the building or other structure

[NFPA 2008]

2.275

service lateral

underground service conductors between the street main, including any risers at a pole or other structure or from transformers, and the first point of connection to the service-entrance conductors in a terminal box or meter or other enclosure, inside or outside the building wall

NOTE Where there is no terminal box, meter, or other enclosure, the point of connection shall be considered to be the point of entrance of the service conductors into the building.

[NFPA 2008]

2.276

service level agreement

formal written agreement made between a service provider and the service recipient which defines the basis of understanding between the two parties for delivery of the service itself

NOTE A service level agreement will generally contain clauses that define a specified level of service, support options, incentive awards for when service levels are exceeded, and/or penalty provisions when services are not provided.

[Aclara 2008]

2.277

service location

physical location served by a given electrical service

NOTE 1 A given service location may contain multiple premises, services, or meters.

NOTE 2 The data attributes normally include a description of the street address, city, state, zip, and possibly some type of map coordinate or location.

[Aclara 2008]

2.278

service delivery point

service point

point of connection between the facilities of the serving utility and the premises wiring

[NFPA 2008, NFPA 1999]

NOTE 1 The service delivery point is the point on the wiring system where the serving utility's distribution network wiring ends and where the customer's wiring begins.

NOTE 2 See also: "point of common coupling", and "transmission delivery point".

2.279

service territory

area in which a utility system is required or has the right to supply service to customers

NOTE Adapted from EEI 2005.

2.280

short circuit analysis

application program used for analysis of transmission or distribution network

2.281**solid-state meter**

meter in which the metrology is performed by solid-state components (as opposed to the mechanism used in more traditional electro-mechanical meters)

[Aclara 2008]

2.282**spinning reserve**

unloaded generation that is synchronized and ready to serve additional demand

[IEEE 2000]

2.283**standard meter**

electromechanical or solid state meter that cumulatively measures, records and stores aggregated kWh that is periodically retrieved for use in customer billing

[DRAM 2008]

2.284**state**

time-varying properties of an object that affect that object's behaviour

2.285**substation**

area or group of equipment containing switches, circuit breakers, busses, and transformers for switching power circuits and to transform power from one voltage to another or from one system to another

[IEEE 2000]

2.286**substation state supervision**

monitoring and control of primary substations, including the status of circuit-breakers and isolators

2.287**supply restoration assessment**

analysis of switching options after a network fault to re-connect supply to as many customers as possible

2.288**switching simulation**

simulating the switching operations to isolate a network section and subsequently reconnect it

2.289**switchgear**

general term covering switching devices and their combination with associated control measuring, protective and regulating equipment, also assemblies, devices and equipment intended in principle for use in connection with generation, transmission, distribution and conversion of energy

2.290**system of record**

system which is the authoritative data source for a given data element or piece of information

NOTE A "modelling authority" is closely related to a "system of record" in that a modelling authority organizes a set of data by CIM objects regardless of their deployment across systems, while a system of record is the authoritative source for a given category of data within the utility.

2.291

tariff

document, approved by the responsible regulatory agency, listing the terms and conditions, including a schedule of prices, under which utility services will be provided

[EnergyBuyer 2006]

2.292

telecontrol

system in which the monitored information is obtained upon request from the master station to outstations

2.293

thermal ratings

temperature operating limits of a device

2.294

time-of-use pricing

energy prices that are set for specific time periods

NOTE 1 Prices paid for energy consumed during these periods are pre-established and known to consumers in advance of such consumption, allowing them to vary their demand and usage in response to such prices and manage their energy costs by shifting usage to a lower cost period, or reducing consumption overall."

NOTE 2 Prices are pre-established and typically do not change more "than twice a year (summer and winter season). The time periods are pre-established, typically include from two to no more than four periods per day, and do not vary in start or stop times."

[DRAM 2008, modified]

2.295

total energy

secured energy

added energy

forward energy plus reverse energy

$$Total\ energy = |forward\ energy| + |reverse\ energy|$$

NOTE 1 Total energy is sometimes as a deterrent to energy theft. It is used in metering applications where the service location (and corresponding customer program and tariff) are known to not support any distributed generation.

NOTE 2 "Total energy" may refer to "active", "apparent", or "reactive" energies.

[Aclara 2008, modified]

NOTE 3 See also: "forward energy", "net energy", "reverse energy", and "flow direction".

2.296

transaction

unit of interaction between systems

[Aclara 2008]

2.297

transceiver

device that both transmits and receives data

[IEEE 2000]

2.298**transformer**

electric energy converter without moving parts that changes voltages and currents associated with electric energy without change of frequency

[IEC 60050-151:2001,151-13-42]

2.299**transmission delivery point**

point of connection between the transmission network and the distribution network

NOTE 1 The transmission delivery point is the point on the wiring system where the transmission network ends and where the serving utility's distribution network begins.

NOTE 2 See also: "service delivery point".

2.300**transponder**

device that responds to a physical or electrical stimulus and emits an electrical signal in response to the stimulus

[IEEE 2000]

2.301**two-way communication**

bidirectional communication

system that enables communication between the originator of a transaction and the recipient, and back again

NOTE 1 A two-way system can be half-duplex or full-duplex. A two-way system can in many cases also operate as a one-way system.

[Aclara 2008]

NOTE 2 See also: "one-way", "inbound", and "outbound".

2.302**type**

abstraction used for composition that describes the underlying properties of an entity, and as a protection mechanism used to verify the expected consistency of such entities at compile time

2.303**underflow**

condition that arises when a mathematical operation is performed to produce a result that is near zero, and the system represents it as zero

[Aclara 2008]

2.304**under-frequency event**

slowing of the power system frequency below a predefined (critical) frequency and duration threshold

[Aclara 2008]

2.305**under-frequency load shed**

automatic shedding of load in response to an under-frequency event

[Aclara 2008]

2.306

under-voltage event

voltage sag

decrease in the measured voltage of the power system below a predefined (critical) voltage and duration threshold

[Aclara 2008]

2.307

use case (class)

specification of a sequence of actions, including variants, that a system (or other entity) can perform, interacting with actors of the system

NOTE See also: "use case instances".

2.308

user access control

regulation authorization and empowerment of utility staff to perform operations on the power network

2.309

validated

data which has been examined using various business rules which serve as a reasonability test to substantiate the data's legitimacy

NOTE In the context of VEE, "validated" or "validation" means that the value has passed reasonability checks to substantiate its legitimacy.

2.310

verify meter power

power status check

process of communicating with a meter in an effort to determine its energization status

NOTE See also: "energization status", and "ping".

2.311

virtual disconnect

action to simulate the disconnection of an electrical service by monitoring the metered usage and throwing an alarm when a consumption threshold is exceeded

[Aclara 2008]

NOTE See also: "remote connect/disconnect".

2.312

voltage threshold alarm

alarm caused by an under-voltage or over-voltage event

[Aclara 2008]

2.313

voltage tolerance curve

curve that characterizes the AC input voltage envelope that can be tolerated, with no interruption in function, by an electronic product

[Aclara 2008]

2.314**voltage transformer**

potential transformer

instrument transformer in which the secondary voltage, in normal conditions of use, is substantially proportional to the primary voltage and differs in phase from it by an angle which is approximately zero for an appropriate direction of the connections

[IEC 60050-321:1986, 321-03-01]

2.315**voltage transformer ratio**

effective turns ratio of a voltage transformer

[Aclara 2008]

2.316**volt-ampere reactive rms**

reactive power as measured using a root-mean-square method

NOTE In a distribution network, reactive power is usually measured in kVAr.

2.317**volt-ampere reactive td**

reactive power as measured using a time-delay method

NOTE In a distribution network, reactive power is usually measured in kVAr.

[Aclara 2008, modified]

2.318**volt-ampere rms**

apparent power as measured using a root-mean-square averaging formula

NOTE In a distribution network, apparent power is usually measured in kVA.

[Aclara 2008, modified]

2.319**volt-ampere td**

apparent power as measured using a time-delay method

NOTE In a distribution network, apparent power is usually measured in kVA.

[Aclara 2008, modified]

2.320**watt-hour meter**

active energy meter

instrument intended to measure active energy by integrating active power with respect to time

[IEC 60050-313:2001, 313-06-01]

2.321**work management**

work order scheduling and tracking, manpower assignment, preparation of bills of material, cost estimating and monitoring

3 Glossary of abbreviations in the IEC 61968 series

Abbreviation	Meaning
EP	American electric power inc.
AGC	automatic generation control
AM	asset management
AMI	advanced metering infrastructure
AMM	advanced meter management
AMR	automated meter reading
API	application programming interface
CAD	computer aided design
CIM	common information model
CIS	customer information system
COSEM	companion specification for energy metering
CPP	critical peak pricing
CSP	communication service provider
CT	current transformer
CTR	current transformer ratio
DAS	distribution automation system
DG	distributed generation
DLMS UA	device language message specification user association
DMS	distribution management system
DR	demand response
DSM	demand-side management
EMS	energy management system
GIS	geographical information system
HAN	home area network
HTTP	hypertext transfer protocol
I/T	information technology
ICT	integration communication technology
ID	identifier

Abbreviation	Meaning
IDR	interval data readings interval data recorder
IEC	international electrotechnical commission
IED	intelligent electronic device
IEM	information exchange model
IRM	interface reference model
ISO	international organization for standardization
ITIC	information technology industry council
IVR	interactive voice response
LA	load analysis
LAN	local area network
LC	load control
LM	load management
LMS	load management system
LV	low voltage
MAM	meter asset management
MDM	meter data management
MDMS	meter data management system
MM	meter maintenance
MOM	message oriented middleware
MR	meter reading
mRID	master resource identifier
MS	metering system
MQM	message queue middleware
MS	meter system
NMS	network management system
NO	network operations
OA	outage analysis
OD	outage detection

Abbreviation	Meaning
OMS	outage management system
OOS	out-of-service
OPF	optimal power flow
PF	power factor
POC	point of common coupling
POS	point of sale
PT	potential transformer
PV	photovoltaic
RF	radio frequency
RMR	remote meter reading
RTP	real time pricing
RTU	remote terminal unit
SCADA	supervisory control and data acquisition
SDP	service delivery point
SIM	substation integration module
SLA	service level agreement
TOU	time-of-use (pricing)
UC	unit commitment
UCA	utility communications architecture
UFLS	under frequency load shed
UML	unified modelling language
VAR	voltampere reactive
VEE	validating, editing, and estimating
VT	voltage transformer
VTR	voltage transformer ratio
WAN	wide area network
WM	work management
XML	extensible markup language

Bibliography

The following sources were used, either in whole or in part, in the development of this glossary of terms.

IEC 60027-1:1992, *Letter symbols to be used in electrical technology – Part 1: General*

IEC 60050-131:2002, *International Electrotechnical Vocabulary – Part 131: Circuit theory*

IEC 60050-151:2001, *International Electrotechnical Vocabulary – Part 151: Electrical and magnetic devices*

IEC 60050-313:2001, *International Electrotechnical Vocabulary – Electrical and electronic measurements and measuring instruments – Part 313: Types of electrical measuring instruments*

IEC 60050-321:1986, *International Electrotechnical Vocabulary – Chapter 321: Instrument transformers*

IEC 60050-605:1983, *International Electrotechnical Vocabulary – Chapter 605: Generation, transmission and distribution of electricity – Substations*

IEC 60050-721:1991, *International Electrotechnical Vocabulary – Chapter 721: Telegraphy, facsimile and data communication*

IEC 61000-4-30:2008, *Electromagnetic compatibility (EMC) – Part 4-30: Testing and measurement techniques – Power quality measurement methods*

IEC 61158-4-12:2010, *Industrial communication networks – Fieldbus specifications – Part 4-12: Data-link layer protocol specification – Type 12 elements*

IEC 61375-1:2007, *Electric railway equipment – Train bus – Part 1: Train communication network*

IEC 61970-2:2004, *Energy management system application program interface (EMS-API) – Part 2: Glossary*

IEC 62052-11:2003, *Electricity metering equipment (AC) – General requirements, tests and test conditions – Part 11: Metering equipment*

IEC 62055-31:2005, *Electricity metering – Payment systems – Part 31: Particular requirements – Static payment meters for active energy (classes 1 and 2)*

IEC 62243:2005, *Artificial intelligence exchange and service tie to all test environments (AI-ESTATE)*

IEC/TS 62257-7-3:2008, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 7-3: Generator set – Selection of generator sets for rural electrification systems*

ISO/IEC 14776-411:1999, *Information technology – Small Computer System Interface-3 (SCSI-3) – Part 411: SCSI-3 Architecture Model (SCSI-3 SAM)*

ISO/IEC 14776-412:2006, *Information technology – Small computer system interface (SCSI) – Part 412: Architecture model-2 (SAM-2)*

ISO/IEC 15045-1:2004, *Information technology – Home electronic system (HES) gateway – Part 1: A residential gateway model for HES*

ISO/IEC 18010:2002, *Information technology Pathways and spaces for customer premises cabling*

Aclara, *AMI Industry Glossary*, Y32000-REF Rev A, Aclara, St. Louis, Missouri, USA, © 2008.

ANSI, *ANSI C12.1-2001, American National Standard for Electric Meters, Code for Electricity Metering*, Published by the National Electric Manufacturers Association, Rosslyn, Virginia, USA, © 2001.

ANSI 2008, *ANSI C12.19-2008, American National Standard for Utility Industry End Device Data Tables*

DRAM, *Definitions*, Demand Response and Advanced Metering Coalition, Washington DC, USA; Retrieved 24 January 2008 from <http://www.dramcoalition.org/id19.htm>.

EEL, *Handbook for Electricity Metering*, 10th Edition, Edison Electric Institute Washington DC, USA, © 2002.

EEL. 2005, *Glossary of Electric Industry Terms*.

Energybuyer, *Glossary*, Energywiz, Inc., New York, Updated 3 September 2006; Retrieved December 2007 from <http://www.energybuyer.org/glossaryCD.htm> and related web pages.

IEC, *Glossary*, © 2003, Retrieved 21 January 2008 from <http://std.iec.ch/glossary>.

IEEE, *IEEE Recommended Practice for Protection and Coordination of Industrial and Commercial Power Systems*, IEEE Buff book, IEEE Std. 242, The Institute of Electrical and Electronics Engineers, Inc., Piscataway, New Jersey, USA, © 1986.

IEEE 2000, *The Authoritative Dictionary of IEEE Standards Terms*, 7th Edition, Std. 100, Standards Information Network, IEEE Press, © 2000.

ISO/IEC, *Directives, Part 2 – Rules for the structure and drafting of International Standards*, 5th Edition, International Electrotechnical Commission, Geneva, Switzerland; © 2004

ISO/IEC *Directives, Supplement – Procedures specific to IEC*, 5th Edition, International Electrotechnical Commission, Geneva, Switzerland; © 2010

ITI 2000, *ITI (CBMEA) Curve Application Note*, Information Technology Industry Council (ITI), Washington DC; Retrieved 23 January 2008 from <http://www.itic.org/archives/iticurv.pdf>.

ITRON 2008, *Glossary*, Liberty Lake Washington, USA, Retrieved 13 October 2008 from http://www.itron.com/pages/resources_glossary.asp

Kurland and Gorr, *GIS tutorial for health*, 2nd ed., ESRI Press, Kristen Kurland, and Wilpen Gorr, Redlands California, USA, © 2007, Retrieved June 2006 from http://gis.esri.com/esripress/shared/images/127/ch01_GISTH.pdf

Lawhead et. al., *Cold Load Pickup – Theory and Industry Practices*, 60th Annual Georgia Tech Protective Relay Conference, 3-5 May 2006; Larry Lawhead and John Horak (Basler Electric); Vahid Madani and Mohammad Vaziri (Pacific Gas and Electric); Atlanta.; Retrieved 23 January 2008 from <http://www.baslerelectric.com/downloads/ColdLoad.pdf>.

MultiSpeak, *MultiSpeak™ Version 3 Specification Document*, 16 November 2005, National Rural Electric Cooperative Association, Arlington, Virginia, USA, © 2005, Retrieved January 2008 from <http://www.multispeak.org/download.htm>

NFPA, *National Electric Code*, (NFPA 70), National Fire Protection Association Inc., Quincy, Massachusetts, USA, © 2008.

NFPA, *National Electric Code Handbook*, 8th edition, © 1999.

OAGIS – *A Canonical Business Language, Version 1.0*, by Michael Rowell, Open Applications Group, available at < <http://www.openapplications.org> >

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

3, rue de Varembé
PO Box 131
CH-1211 Geneva 20
Switzerland

Tel: + 41 22 919 02 11
Fax: + 41 22 919 03 00
info@iec.ch
www.iec.ch