INTERNATIONAL STANDARD

ISO 7671

Second edition 2003-11-15

Plastics piping systems for soil and waste discharge (low and high temperature) inside buildings — Polypropylene (PP)

Systèmes de canalisations en plastique pour l'évacuation des eauxvannes et des eaux usées (à basse et à haute température) à l'intérieur des bâtiments — Polypropylène (PP)



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

© ISO 2003

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office Case postale 56 • CH-1211 Geneva 20 Tel. + 41 22 749 01 11 Fax + 41 22 749 09 47 E-mail copyright@iso.org Web www.iso.org

Published in Switzerland

Contents Page Forewordiv Introductionv 1 Scope......1 2 3 4 Material 3 5 General characteristics4 6 Geometrical characteristics5 7 Mechanical characteristics of pipes17 8 9 10 Sealing rings 20 11 12

ISO 7671:2003(E)

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 7671 was prepared by Technical Committee ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Subcommittee SC 1, *Plastics pipes and fittings for soil, waste and drainage (including land drainage)*.

This second edition cancels and replaces the first edition (ISO 7671:1991), which has been technically revised.

Introduction

Pipes and fittings conforming to this International Standard also meet the requirements of EN 1451-1 which are applicable to those pipes and fittings which, according to EN 1451-1, are intended to be used inside buildings (application area code "B", see EN 1451-1) only.

--,,-,----,,-,,-,-,-

Plastics piping systems for soil and waste discharge (low and high temperature) inside buildings — Polypropylene (PP)

1 Scope

This International Standard specifies the requirements for solid-wall polypropylene (PP) pipes and fittings for soil and waste discharge (low and high temperature) inside buildings, as well as the system itself. It does not include buried pipework.

It also specifies the test parameters for the test methods referred to in this International Standard.

This International Standard is applicable to PP pipes and fittings, as well as assemblies of such pipes and fittings, intended to be used for the following purposes:

- a) soil and waste discharge pipework for the conveyance of domestic waste waters (low and high temperature);
- b) ventilation pipework associated with a);
- c) rainwater pipework inside the building.

It is applicable to pipes and fittings for jointing by means of elastomeric sealing rings or by butt fusion.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 265-1, Pipes and fittings of plastics materials — Fittings for domestic and industrial waste pipes — Basic dimensions: Metric series — Part 1: Unplasticized poly(vinyl chloride) (PVC-U)

ISO 1133:1997, Plastics — Determination of the melt mass-flow rate (MFR) and the melt volume-flow rate (MVR) of thermoplastics

ISO 3126:—1), Plastics piping systems — Plastics components — Determination of dimensions

EN 681-1, Elastomeric seals — Materials requirements for pipe joint seals used in water and drainage applications — Part 1: Vulcanized rubber

EN 681-2, Elastomeric seals — Materials requirements for pipe joint seals used in water and drainage applications — Part 2: Thermoplastic elastomers

EN 728, Plastics piping and ducting systems — Polyolefin pipes and fittings — Determination of oxidation induction time

_

¹⁾ To be published. (Revision of ISO 3126:1974)

ISO 7671:2003(E)

EN 743:1994, Plastics piping and ducting systems — Thermoplastics pipes — Determination of the longitudinal reversion

EN 744, Plastics piping and ducting systems — Thermoplastics pipes — Test method for resistance to external blows by the round-the-clock method

EN 763:1994, Plastics piping and ducting systems — Injection-moulded thermoplastics fittings — Test method for visually assessing effects of heating

EN 1053, Plastics piping systems — Thermoplastics piping systems for non-pressure applications — Test method for watertightness

EN 1054, Plastics piping systems — Thermoplastics piping systems for soil and waste discharge — Test method for airtightness of joints

EN 1055:1996, Plastics piping systems — Thermoplastics piping systems for soil and waste discharge inside buildings — Test method for resistance to elevated temperature cycling

EN 1411, Plastics piping and ducting systems — Thermoplastics pipes — Determination of resistance to external blows by the staircase method

3 Symbols and abbreviations

Symbols 3.1

| 1 | lonath a | of angage | omont |
|---|----------|-----------|-------|
| A | rengin (| of engage | emeni |

В length of lead-in

Cdepth of sealing zone

outside diameter (at any point) d_{e}

mean outside diameter d_{em}

 d_{n} nominal outside diameter

 d_{s} inside diameter of the socket

mean inside diameter of the socket d_{sm}

DN nominal size

DN/OD nominal size (outside-diameter related)

wall thickness (at any point)

mean wall thickness e_{m}

wall thickness of the socket e_2

wall thickness at the groove e_3

length of spigot L_1

- l effective length of a pipe
- R radius of swept fittings
- z design length (z-length) of a fitting
- α nominal angle of a fitting

3.2 Abbreviations

MFR melt mass-flow rate

OIT oxidation induction time

PP polypropylene

PP-H polypropylene homopolymer

TIR true impact rate

4 Material

4.1 PP compound

The compound for pipes and fittings shall be PP-based material (homopolymer and/or copolymer) to which may be added those additives that are needed to facilitate the manufacture of components conforming to the requirements of this International Standard.

In order to conform to national requirements on fire regulations, other additives may be used.

Fabricated fittings or parts of fabricated fittings shall be made from pipes and/or mouldings conforming to this International Standard, except for the requirements for the wall thickness of fabricated fittings and/or mouldings from PP which conform to material, mechanical and physical characteristics as required in this International Standard.

4.2 Reprocessable and recyclable material

In addition to virgin material, the use of reprocessable material obtained during the production and testing of products conforming to this International Standard is permitted. External reprocessable or recyclable material shall not be used.

NOTE Definitions concerning materials are given in EN 1451-1.

4.3 Melt mass-flow rate

The MFR of the PP-based material shall determined in accordance with ISO 1133:1999, set of conditions M (test temperature 230 °C, load 2,16 kg).

Pipes and fittings intended to be used for mechanical joints shall be made from materials with an MFR as follows:

MFR $(230/2,16) \le 3.0 \text{ g/}10 \text{ min}$

ISO 7671:2003(E)

Materials for pipes and fittings for butt fusion joints shall be designated by the following classes with regard to the MFR:

Class A MFR \leq 0,3 g/10 min;

Class B $0.3 \text{ g/10 min} < \text{MFR} \le 0.6 \text{ g/10 min};$

Class C $0.6 \text{ g/10 min} < \text{MFR} \leqslant 0.9 \text{ g/10 min};$

Class D $0.9 \text{ g/10 min} < \text{MFR} \leqslant 1.5 \text{ g/10 min}.$

Only pipes and fittings made from materials of the same or adjacent MFR classes may be fused together.

4.4 Thermal stability

When determined in accordance with EN 728, using a test temperature of 200 °C, the oxidation induction time (OIT) of the material shall be not less than 8 min.

NOTE Requirements for thermal stability are only applicable to materials for pipes and fittings intended for butt fusion.

4.5 Sealing ring retaining means

Sealing rings may be retained, using means made from plastics other than PP, provided the joints conform to the requirements given in Clause 9.

4.6 Fire behaviour

No specific requirements are set by this International Standard for fire behaviour. Attention is drawn to the need to comply with any relevant national regulations in this respect.

5 General characteristics

5.1 Appearance

When viewed without magnification, the following requirements shall be met:

- the internal and external surfaces of pipes and fittings shall be smooth, clean and free from grooving, blistering, impurities, pores or any other surface irregularity likely to prevent conformity of pipes and fittings to this International Standard;
- each end of a pipe or fitting shall be cleanly cut, if applicable, and shall be square to its axis.

5.2 Colour

Pipes and fittings shall be uniformly coloured through the whole wall.

The recommended colour for pipes and fittings is grey, black or white.

6 Geometrical characteristics

6.1 General

All dimensions shall be measured in accordance with ISO 3126.

The figures given in this International Standard are schematic sketches only, to indicate the relevant dimensions. They do not necessarily represent manufactured components. The dimensions given shall be conformed to.

6.2 Dimensions of pipes

6.2.1 Outside diameters

The mean outside diameter, d_{em} , shall conform to Table 1 or Table 2, as applicable.

Table 1 — Mean outside diameters (metric series)

Dimensions in millimetres

| Nominal size | Nominal outside diameter | Mean outsic | le diameter |
|--------------|--------------------------|-------------|-------------|
| DN/OD | d_{n} | d_{e} | m |
| | | min. | max. |
| 32 | 32 | 32,0 | 32,3 |
| 40 | 40 | 40,0 | 40,3 |
| 50 | 50 | 50,0 | 50,3 |
| 63 | 63 | 63,0 | 63,3 |
| 75 | 75 | 75,0 | 75,4 |
| 80 | 80 | 80,0 | 80,4 |
| 90 | 90 | 90,0 | 90,4 |
| 100 | 100 | 100,0 | 100,4 |
| 110 | 110 | 110,0 | 110,4 |
| 125 | 125 | 125,0 | 125,4 |
| 160 | 160 | 160,0 | 160,5 |
| 200 | 200 | 200,0 | 200,6 |

Table 2 — Mean outside diameters


(series based on inch dimensions)

Dimensions in millimetres

| Nominal size | Nominal outside diameter | Mean outside diameter | | |
|--------------|-----------------------------|-----------------------|------|--|
| DN/OD | d_{n} | d_{em} | | |
| | | min. | max. | |
| 34 | 34 | 34,4 | 34,8 | |
| 41 | 41 | 40,8 | 41,2 | |
| 54 | 54 | 53,9 | 54,3 | |

6.2.2 Effective length of pipes

The effective length, *l*, of a pipe shall not be less than that declared by the manufacturer and shall be measured as shown in Figure 1. For pipes with sockets, the effective length is considered to be the distance between the pipe ends minus the socket length. For practical reasons, this length is measured to the outside of the socket.

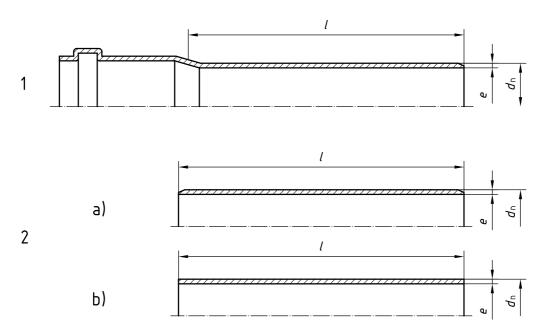

Key

- single-socket pipe
- plain-ended pipes
 - a) with chamfer
 - b) without chamfer

Figure 1 — Effective lengths of pipes

6.2.3 Chamfering

If a chamfer is applied, the angle of chamfering shall be between 15° and 45° to the axis of the pipe (see Figure 3). When pipes without a chamfer are used, the pipe ends shall be deburred.

The remaining wall thickness of the end of the pipe shall be at least 1/3 of e_{min} .

6.2.4 Wall thickness

The wall thickness, e, shall conform to Table 3 or Table 4, as applicable, but for the metric series a maximum wall thickness at any point of up to $1,25e_{\min}$ is permitted, provided that the mean wall thickness, e_{\min} , is less than or equal to the specified e_{\min} .

Table 3 — Wall thicknesses (metric series)

Dimensions in millimetres

| Nominal size | Nominal outside diameter | Wall thickness | | | |
|--------------|--------------------------|----------------|---------|--------|---------|
| | | | Pipe | series | |
| | | S | 20 | S | 16 |
| DN/OD | d_{n} | е | e_{m} | e | e_{m} |
| | | min. | max. | min. | max. |
| 32 | 32 | 1,8 | 2,2 | 1,8 | 2,2 |
| 40 | 40 | 1,8 | 2,2 | 1,8 | 2,2 |
| 50 | 50 | 1,8 | 2,2 | 1,8 | 2,2 |
| 63 | 63 | 1,8 | 2,2 | 2,0 | 2,4 |
| | | | | | |
| 75 | 75 | 1,9 | 2,3 | 2,3 | 2,8 |
| 80 | 80 | 2,0 | 2,4 | 2,5 | 3,0 |
| 90 | 90 | 2,2 | 2,7 | 2,8 | 3,3 |
| 100 | 100 | 2,5 | 3,0 | 3,2 | 3,8 |
| | | | | | |
| 110 | 110 | 2,7 | 3,2 | 3,4 | 4,0 |
| 125 | 125 | 3,1 | 3,7 | 3,9 | 4,5 |
| 160 | 160 | 3,9 | 4,5 | 4,9 | 5,6 |
| 200 | 200 | 4,9 | 5,6 | 6,2 | 7,1 |

Table 4 — Wall thicknesses (series based on inch dimensions)

Dimensions in millimetres

| Nominal size | Nominal outside diameter | Wall thickness | | |
|--------------|--------------------------|----------------|---------|--|
| DN/OD | d_{n} | e | e_{m} | |
| | | min. | max. | |
| 34 | 34 | 1,8 | 2,2 | |
| 41 | 41 | 1,9 | 2,3 | |
| 54 | 54 | 2 | 2,4 | |

6.3 Dimensions of fittings

6.3.1 Outside diameters

The mean outside diameter, d_{em} , of the spigot end shall conform to Table 1 or Table 2, as applicable.

6.3.2 z-lengths

The design length(s) [z-length(s)] of fittings (see Figure 6 to Figure 19) shall be as given by the manufacturer.

NOTE The *z*-length(s) of a fitting are intended to assist in the design of moulds and are not intended to be used for quality control purposes. ISO 265-1 may be used as a guideline.

6.3.3 Wall thickness

The minimum wall thickness, e_{\min} , of the body or the spigot end of a fitting shall conform to Table 3 or Table 4, as applicable, except that a reduction of 5 % resulting from core shifting is permitted. In such cases, the average of two opposite wall thicknesses shall be equal to or greater than the values given in Table 3 or Table 4, as applicable.

Where a fitting or adaptor provides a transition between two nominal sizes, the wall thickness of each connecting part shall conform to the requirements for the applicable nominal size. In such cases, the wall thickness of the fitting body is permitted to change gradually from the one wall thickness to the other.

Where a sealing ring is located by means of a retaining cap or ring (see Figure 2), the wall thickness in this area shall be calculated by addition of the wall thickness of the socket and the wall thickness of the retaining cap or ring at the corresponding places in the same cross-sectional plane.

The wall thicknesses of fabricated fittings, except for spigot ends and sockets, may be changed locally to suit the fabrication process, provided that the minimum wall thickness of the body conforms to the minimum value of e_3 as given in Table 7 or Table 8, as applicable.




Figure 2 — Example of calculation of wall thickness of socket with retaining cap

6.4 Dimensions of sockets and pipe ends

6.4.1 Dimensions of ring seal sockets and spigot ends

6.4.1.1 Diameters and lengths

The diameters and lengths of ring seal sockets and spigot ends (see Figure 3, Figure 4 or Figure 5) shall conform to Table 5 or Table 6, as applicable, and shall be in accordance with the following conditions:

 a) where sealing rings are firmly retained, the minimum value of A and the maximum value of C shall be measured to the effective sealing point (see Figure 5 for an example) and this point shall give a full sealing action; b) where sealing rings are firmly retained, the required values given for dimension B (see Figure 4) do not apply.

Different designs of ring seal socket (see Figure 4) may be used, provided the joints conform to the requirements given in Clause 9.

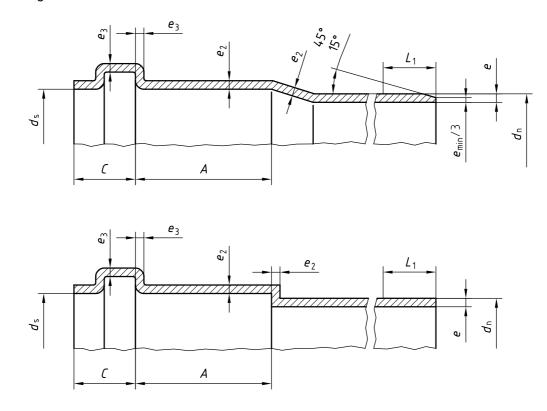


Figure 3 — Dimensions of sockets and spigot ends for ring seal joints

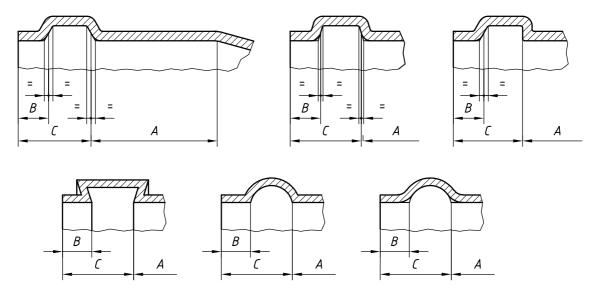


Figure 4 — Typical groove designs for ring seal sockets

Figure 5 — Example of measurement of effective sealing point

Table 5 — Diameters and lengths of ring seal sockets and spigot ends (metric series)

Dimensions in millimetres

| Nominal size | Nominal outside diameter | Socket | | | Spigot end | |
|--------------|--------------------------|----------|------|------|------------|---------|
| DN/OD | d_{n} | d_{sm} | A | В | С | L_{1} |
| | | min. | min. | min. | max. | min. |
| 32 | 32 | 32,3 | 24 | 5 | 18 | 42 |
| 40 | 40 | 40,3 | 26 | 5 | 18 | 44 |
| 50 | 50 | 50,3 | 28 | 5 | 18 | 46 |
| 63 | 63 | 63,3 | 31 | 5 | 18 | 49 |
| | | | | | | |
| 75 | 75 | 75,4 | 33 | 5 | 18 | 51 |
| 80 | 80 | 80,4 | 34 | 5 | 19 | 53 |
| 90 | 90 | 90,4 | 34 | 5 | 20 | 54 |
| 100 | 100 | 100,4 | 35 | 5 | 21 | 56 |
| | | | | | | |
| 110 | 110 | 110,4 | 36 | 6 | 22 | 58 |
| 125 | 125 | 125,4 | 38 | 7 | 26 | 64 |
| 160 | 160 | 160,5 | 41 | 9 | 32 | 73 |
| 200 | 200 | 200,6 | 45 | 12 | 40 | 85 |

Table 6 — Diameters and lengths of ring seal sockets and spigot ends

(series based on inch dimensions)

Dimensions in millimetres

| Nominal size | Nominal outside diameter | Socket | | | Spigot end | |
|--------------|--------------------------|--------------|------|------|------------|---------|
| DN/OD | d_{n} | $d_{\sf sm}$ | A | В | C | L_{1} |
| | | min. | min. | min. | max. | min. |
| 34 | 34 | 34,8 | 25 | 3,8 | 12 | 37 |
| 41 | 41 | 41,2 | 25 | 3,8 | 15 | 40 |
| 54 | 54 | 54,3 | 25 | 3,8 | 18 | 43 |

6.4.1.2 Wall thicknesses

The wall thickness of the socket, e_2 , and the wall thickness in the groove area, e_3 , shall conform to Table 7 or Table 8, as applicable.

Table 7 — Wall thicknesses of sockets (metric series)

Dimensions in millimetres

| Nominal size | Nominal outside diameter | Wall thic | knesses |
|--------------|--------------------------|-----------|---------|
| DN/OD | d_{n} | e_2 | e_3 |
| | | min. | min. |
| 32 | 32 | 1,6 | 1 |
| 40 | 40 | 1,6 | 1 |
| 50 | 50 | 1,6 | 1 |
| 63 | 63 | 1,6 | 1 |
| 75 | 75 | 1,7 | 1,1 |
| 80 | 80 | 1,7 | 1,1 |
| 90 | 90 | 2 | 1,3 |
| 100 | 100 | 2,3 | 1,4 |
| 110 | 110 | 2,4 | 1,5 |
| 125 | 125 | 2,8 | 1,8 |
| 160 | 160 | 3,5 | 2,2 |
| 200 | 200 | 4,4 | 2,7 |

Table 8 — Wall thicknesses of sockets

(series based on inch dimensions)

Dimensions in millimetres

| Nominal size | Nominal outside diameter | Wall thicknesses | |
|--------------|--------------------------|------------------|-------|
| DN/OD | d_{n} | e_2 | e_3 |
| | | min. | min. |
| 34 | 34 | 1,7 | 1 |
| 41 | 41 | 1,8 | 1,1 |
| 54 | 54 | 1,8 | 1,1 |

6.4.2 Dimensions of pipe ends for butt fusion joints

The mean outside diameter, $d_{\rm em}$, of pipes with plain ends intended to be used for butt fusion joints shall conform to Table 1 or Table 2, as applicable. The wall thickness, e, shall conform to Table 3 or Table 4, as applicable.

6.5 Types of fitting

This International Standard is applicable to the following types of fitting. Other designs of fittings are permitted.

- a) Bends (see Figure 6, 7, 8, 9, 10 or 11):
 - unswept or swept angle (see ISO 265-1);
 - spigot/socket or socket/socket;
 - butt-fused from segments.

The nominal angle, α , may be selected from the following: 15°, 22°30′, 30°, 45°, 67°30′, 80°, 87°30′ to 90°.

- b) Branches and reducing branches (branching single or multiple) (see Figure 12, 13, 14, 15, 16 or 17):
 - unswept or swept angle (see ISO 265-1);
 - spigot/socket or socket/socket.


The nominal angle, α , may be selected from the following: 45°, 67°30′, 87°30′ to 90°.

If other angles are required, they shall be agreed between the manufacturer and purchaser and be identified accordingly.

- c) Reducers (see Figure 18).
- d) Access fittings (see Figure 19).

The inside diameter of the cleaning hole shall be as specified by the manufacturer.


- e) Couplers:
 - double-socket (see Figure 20);
 - repair collar (see Figure 21).
- f) Push-fit socket for butt fusion for pipe ends (see Figure 22).
- g) Plugs (see Figure 23).

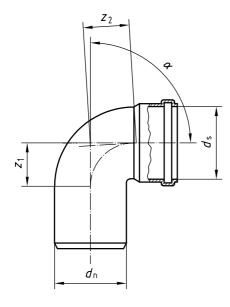


Z₂

Figure 6 — Bend with single socket (unswept)

Figure 7 — Bend with single socket (swept)








Figure 9 — Bend with only sockets (swept)




Figure 10 — Bend, butt-fused from segments




Figure 11 — Bend with single socket, butt-fused from segments

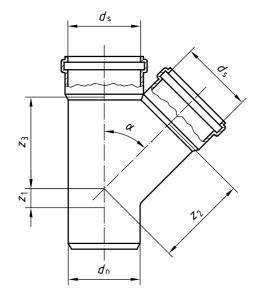


Figure 12 — Branch (unswept)

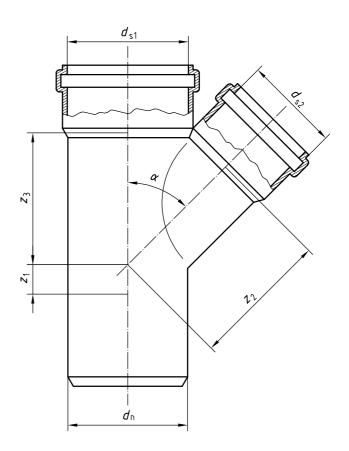



Figure 13 — Reducing branch (unswept)






Figure 14 — Reducing branch (swept)

Figure 15 — Reducing branch with only sockets (swept)

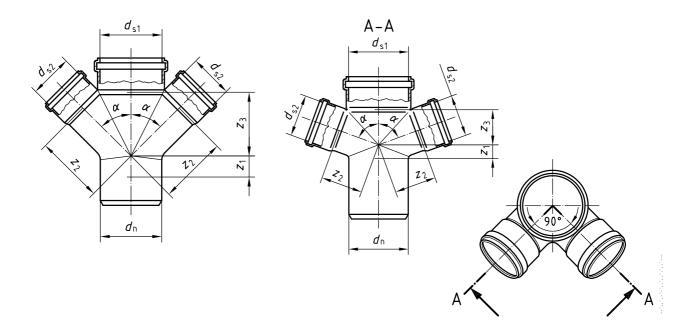


Figure 16 — Double branch

Figure 17 — Angular double branch

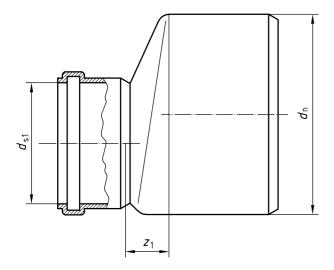


Figure 18 — Reducer

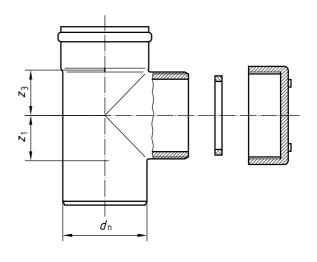


Figure 19 — Access fitting with round cleaning hole




Figure 20 — Double-socket (coupler)




Figure 21 — Repair collar




Figure 22 — Push-fit socket for butt fusion of pipe ends




Figure 23 — Plug

7 Mechanical characteristics of pipes

7.1 General characteristics

When determined in accordance with the method specified in Table 9, using the parameters indicated, the general mechanical characteristics of pipes shall conform to the requirements given in Table 9.

The mass and drop height of the striker used in determining the impact resistance (round-the-clock method) as specified in Table 9 are given in Table 10 or Table 11, as applicable.

Table 9 — General mechanical characteristics of pipes

| Characteristic | Requirements | Test parameters | | Test method |
|--|--------------|-----------------------------------|-------------------------------------|-------------|
| PP-copolymer | | | | • |
| Impact resistance | TIR ≤ 10 % | Type of striker for: | | EN 744 |
| (round-the-clock method) | | d _n < 110 mm | Type d25 | |
| | | $d_{n} \geqslant$ 110 mm | Type d90 | |
| | | Mass of striker | Table 10 or Table 11, as applicable | |
| | | Drop height of striker | Table 10 or Table 11, as applicable | |
| | | Conditioning medium | Water or air | |
| | | Conditioning and test temperature | (0 ± 1) °C ^a | J |
| | | Conditioning period | 60 min | |
| PP-H | | | | |
| Impact resistance (round-the-clock method) | TIR ≤ 10 % | Type of striker for: | | EN 744 |
| | | d _n < 110 mm | Type d25 | |
| | | $d_{n} \geqslant$ 110 mm | Type d90 | |
| | | Mass of striker | Table 10 or Table 11, as applicable | |
| | | Drop height of striker | Table 10 or Table 11, as applicable | |
| | | Conditioning medium | Air | |
| | | Conditioning and test temperature | $(23\pm2)~^{\circ}\text{C}$ | |
| | | Conditioning period | 60 min | |

Table 10 — Mass and drop height of striker for impact resistance (round-the-clock method) (metric series)

Dimensions in millimetres

| Nominal size | Nominal outside diameter | Mass of striker | Drop height of striker |
|--------------|--------------------------|-----------------|------------------------|
| DN/OD | d_{n} | kg | |
| | | + 0,01 0 | + 20 0 |
| 32 | 32 | 0,5 | 600 |
| 40 | 40 | 0,5 | 800 |
| 50 | 50 | 0,5 | 1 000 |
| 63 | 63 | 0,8 | 1 000 |
| | | | |
| 75 | 75 | 0,8 | 1 000 |
| 80 | 80 | 0,8 | 1 000 |
| 90 | 90 | 0,8 | 1 200 |
| 100 | 100 | 0,8 | 1 200 |
| | | | |
| 110 | 110 | 0,8 | 2 000 |
| 125 | 125 | 1,25 | 2 000 |
| 160 | 160 | 1,6 | 2 000 |
| 200 | 200 | 2,0 | 2 000 |

Table 11 — Mass and drop height of striker for impact resistance (round-the-clock method) (series based on inch dimensions)

Dimensions in millimetres

| Nominal size | Nominal outside diameter | Mass of striker | Drop height of striker |
|--------------|--------------------------|-----------------|------------------------|
| DN/OD | d_{n} | kg | |
| | | + 0,01 0 | + 20 0 |
| 34 | 34 | 0,5 | 600 |
| 41 | 41 | 0,5 | 800 |
| 54 | 54 | 0,5 | 1 000 |

7.2 Additional characteristics

Pipes made from PP copolymers intended to be used in areas where installation is usually carried out at temperatures below $-10\,^{\circ}$ C shall additionally conform to the requirements of an impact test (staircase method) as specified in Table 12.

The pipes shall be marked in accordance with Table 17.

Table 12 — Additional mechanical characteristics of pipes

| Characteristic | Requirements | Test parameters | | Test method |
|---|------------------------------|---|------------|-------------|
| Impact resistance ^a (staircase method) | <i>H</i> ₅₀ ≥ 1 m | Conditioning and test temperature | (0 ± 1) °C | EN 1411 |
| | Max.: 1 break | Type of striker | Type d90 | |
| | below 0,5 m | Mass of striker for: | | |
| | | $32 \text{ mm} \leqslant d_{n} \leqslant 43 \text{ mm}$ | 1,25 kg | |
| | | $50 \text{ mm} \leqslant d_{n} \leqslant 63 \text{ mm}$ | 2 kg | |
| | | 75 mm $\leq d_{n} \leq$ 80 mm | 2,5 kg | |
| | | 90 mm $\leq d_{n} \leq$ 100 mm | 3,2 kg | |
| | | $d_{\rm n}$ = 110 mm | 4 kg | |
| | | $d_{\rm n}$ = 125 mm | 5 kg | |
| | | $d_{\rm n}$ = 160 mm | 8 kg | |
| | | d _n = 200 mm | 10 kg | |
| a For PP copolymers only. | | | | _ |

8 Physical characteristics

8.1 Physical characteristics of pipes

When determined in accordance with the methods specified in Table 13, using the parameters indicated, the physical characteristics of pipes shall conform to the requirements given in Table 13.

Table 13 — Physical characteristics of pipes

| Characteristic | Requirements | Test parameters | | Test method |
|--|--|------------------|--------------|---------------------|
| Longitudinal reversion ^a | ≤ 2 % | Test temperature | (150 ± 2) °C | EN 743:1994 |
| | The pipe shall exhibit no bubbles or cracks | Immersion time | 30 min | Method A: Liquid |
| | | | or | |
| | | Test temperature | (150 ± 2) °C | EN 743:1994 |
| | | Immersion time | 60 min | Method B: Air |
| Melt mass-flow rate (MFR) Permitted max. deviation | | Test temperature | 230 °C | ISO 1133:1999 |
| | when processing the compound into pipe: 0,2 g/10 min | Load | 2,16 kg | Set of conditions M |
| ^a The choice of method A or method B is the responsibility of the manufacturer. | | | | • |

8.2 Physical characteristics of fittings

When determined in accordance with the methods specified in Table 14 and Table 15, using the parameters indicated, the physical characteristics of fittings shall conform to the requirements given in Table 14 or Table 15, as applicable.

Table 14 — Physical characteristics of fittings

| Characteristic | Requirements | Test paramete | ers | Test method |
|--------------------|--------------|------------------|--------------|-----------------------|
| Effects of heating | а | Test temperature | (150 ± 2) °C | EN 763:1994 |
| | | Heating time | 30 min | Method A: Air oven |

The depth of any cracks, delaminations or blisters shall not exceed 20 % of the wall thickness around the injection point(s). No part 1) of the weld line shall be open to a depth of more than 20 % of the wall thickness.

Table 15 — Physical characteristics of fabricated fittings

| Characteristic | Requirement | Test parameters | | Test method |
|---|-------------|-----------------|--------------------|-------------|
| Watertightness ^a | No leakage | Water pressure | 0,05 MPa (0,5 bar) | EN 1053 |
| | | Duration | 1 min | |
| ^a Only for fabricated fittings made from more than one piece. A sealing ring retaining element is not considered as a piece. | | | | |

Performance requirements

When determined in accordance with the methods specified in Table 16, using the parameters indicated, the fitness-for-purpose characteristics of the joints and the system shall conform to the requirements given in Table 16.

Table 16 — Fitness-for-purpose characteristics of the system

| Characteristic | Requirement | Test parameters | Test method |
|--------------------------------------|-------------------------------------|--------------------------|--------------------------------------|
| Watertightness ^a | No leakage | Shall conform to EN 1053 | EN 1053 |
| Airtightness ^a | No leakage | Shall conform to EN 1054 | EN 1054 |
| Elevated-temperature cycling | No leakage before or after test | Shall conform to EN 1055 | Test assembly a) (Figure 1 and/or 3) |
| | Sagging for DN ≤ 50: ≤ 3 mm | | of EN 1055:1996 |
| | Sagging for DN > 50: $\leq 0.05d_n$ | | |
| Not required for butt fusion joints. | | | |

10 Sealing rings

- **10.1** Sealing rings shall not have any detrimental effects on the properties of the pipe or fitting.
- 10.2 Various designs of sealing ring for ring seal sockets are permitted provided that the joints produced using them conform to the requirements specified in Clause 9.

Materials for sealing rings shall conform to EN 681-1 or EN 681-2, as applicable.

When fittings are manufactured from pipes, the pipes shall conform to the requirements given in Table 9 and Table 13. 2)

³⁾ Mouldings that are used for fabricated fittings may be tested separately.

11 Marking

11.1 General

11.1.1 Marking elements shall be labelled or printed or formed directly on the component in such a way that legibility is maintained during storage, weathering, handling and installation, as well as during the subsequent use of the component.

NOTE The manufacturer is not responsible for marking being illegible due to actions caused during installation and use such as painting, scratching or covering of the components or by use of detergents, etc., on the components unless agreed or specified by the manufacturer.

11.1.2 Marking on a pipe or fitting shall not initiate cracks or other defects likely to prevent conformity to the requirements of this International Standard.

11.2 Minimum required marking of pipes

The minimum marking required for pipes is specified in Table 17.

Pipes shall be marked at intervals of, at the maximum, 1 m, and at least once per pipe. Pipes with a length less than 1 m may be marked with a label at least once per pipe.

Table 17 — Minimum required marking of pipes

| Item | Marking or symbol |
|---------------------------------------|-------------------|
| Number of this International Standard | ISO 7671 |
| Manufacturer's name and/or trade mark | xxx |
| Nominal size | e.g. DN 110 |
| Minimum wall thickness | e.g. 3,4 |
| Material ^a | PP or PP-H |
| MFR class ^b | e.g. MFR-A |
| Manufacturer's information | С |
| Cold-climate performance ^d | |

Pipes made from PP copolymer shall be marked "PP". Pipes made from PP homopolymer shall be marked "PP-H".

- the production period (year and month), in figures or in code;
- a name or code for the production site if the manufacturer is producing at different sites.

11.3 Minimum required marking of fittings

The minimum marking required for fittings is specified in Table 18, whereby the manufacturer's information may be either on the fitting or on the packaging. If the manufacturer's information is on the packaging, it shall be determined by national requirements.

b For pipes intended for butt fusion.

^c To ensure traceability, the following details shall be given:

This marking is only applicable to pipes which have been proved, by testing, to conform to 7.2.

Table 18 — Minimum required marking of fittings

| Item | Marking or symbol |
|---------------------------------------|-------------------|
| Number of this International Standard | ISO 7671 |
| Manufacturer's name and/or trade mark | xxx |
| Nominal size | e.g. DN 110 |
| Minimum wall thickness | e.g. 2,7 |
| Nominal angle | e.g. 67°30′ |
| Material ^a | PP or PP-H |
| MFR class ^b | e.g. MFR-A |
| Manufacturer's information | С |

^a Pipes made from PP copolymer shall be marked "PP". Pipes made from PP homopolymer shall be marked "PP-H".

- the production period (year and month), in figures or in code;
- a name or code for the production site if the manufacturer is producing at different sites.

12 Installation of piping systems

For the installation of pipes and fittings conforming to this International Standard, national and/or local requirements and relevant codes of practice shall apply.

In addition, the pipe manufacturer may give a recommended practice for installation which covers the transport, storage and handling of the pipes and fittings as well as to the installation in accordance with the applicable national and/or local instructions.

For external above-ground applications, additional requirements depending on the climate shall be agreed between the manufacturer and the purchaser.

Due to their limited impact strength at low temperatures, pipes and fittings made from PP homopolymer should not be installed at temperatures below + 5 °C.

Guidance on installation may be found in ISO/TR 7024.

b For pipes intended for butt fusion.

^c To ensure traceability, the following details shall be given:

Annex A

(informative)

Additional characteristics of PP pipes and fittings

A.1 General

EN 476 specifies the general requirements for components used in discharge pipes, drains and sewers for gravity systems. Pipes and fittings conforming to this International Standard fully meet these requirements. Additional information is given in this annex.

A.2 Characteristics relating to the material

Pipes and fittings conforming to this International Standard generally have the following characteristics:

— Modulus of elasticity $E_{1 \text{ min}} \geqslant 1 200 \text{ MPa};$

— Average density $\approx 0.9 \text{ g/cm}^3$;

Average coefficient of linear expansion ≈ 0,14 mm/m·K;

— Thermal conductivity ≈ 0,2 W/m⋅K;

— Surface resistance $> 10^{13} \Omega$.

A.3 Chemical resistance

PP piping systems conforming to this International Standard are resistant to corrosion by water with a wide range of pH-values such as soil and waste water, rain water, surface water and ground water.

If piping systems conforming to this International Standard are to be used for waste water contaminated with chemicals, such as industrial discharges, their chemical and temperature resistance will also have to be taken into account.

Guidance is given on the chemical resistance of PP in ISO/TR 10358 and for rubber materials in ISO/TR 7620.

Bibliography

- [1] ISO 161-1, Thermoplastics pipes for the conveyance of fluids — Nominal outside diameters and nominal pressures — Part 1: Metric series
- ISO 161-2, Thermoplastics pipes for the conveyance of fluids Nominal outside diameters and [2] nominal pressures — Part 2: Inch-based series
- [3] ISO 3633, Plastics piping systems for soil and waste discharge (low and high temperature) inside buildings — Unplasticized poly(vinyl chloride) (PVC-U)
- [4] ISO 4065, Thermoplastics pipes — Universal wall thickness table
- [5] ISO/TR 7024, Above-ground drainage — Recommended practice and techniques for the installation of unplasticized polyvinyl chloride (PVC-U) sanitary pipework for above-ground systems inside buildings
- ISO/TR 7620, Rubber materials Chemical resistance [6]
- ISO 7675, Plastics piping systems for soil and waste discharge (low and high temperature) inside [7] buildings — Chlorinated poly(vinyl chloride) (PVC-C)
- [8] ISO 7682, Plastics piping systems for soil and waste discharge (low and high temperature) inside buildings — Acrylonitrile-butadiene-styrene (ABS)
- ISO 8770, Plastics piping systems for soil and waste discharge (low and high temperature) inside [9] buildings — Polyethylene (PE)
- [10] ISO/TR 10358, Plastics pipes and fittings — Combined chemical-resistance classification table
- [11] ISO 19220, Plastics piping systems for soil and waste discharge (low and high temperature) inside buildings — Styrene copolymer blends (SAN + PVC)
- [12] EN 476, General requirements for components used in discharge pipes, drains and sewers for gravity systems
- [13] EN 1329-1, Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure — Unplasticized poly(vinyl chloride) (PVC-U) — Part 1: Specifications for pipes, fittings and the system
- EN 1451-1, Plastics piping systems for soil and waste discharge (low and high temperature) within the [14] building structure — Polypropylene (PP) — Part 1: Specifications for pipes, fittings and the system
- [15] EN 1453-1, Plastics piping systems with structured-wall pipes for soil and waste discharge (low and high temperature) inside buildings — Unplasticized poly(vinyl chloride) (PVC-U) — Part 1: Specifications for pipes and the system
- EN 1455-1, Plastics piping systems for soil and waste discharge (low and high temperature) within the [16] building structure — Acrylonitrile-butadiene-styrene (ABS) — Part 1: Requirements for pipes, fittings and the system
- [17] EN 1519-1, Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure — Polyethylene (PE) — Part 1: Specifications for pipes, fittings and the system
- [18] EN 1565-1, Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure — Styrene copolymer blends (SAN + PVC) — Part 1: Specifications for pipes, fittings and the system

- [19] EN 1566-1, Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure — Chlorinated poly(vinyl chloride) (PVC-C) — Part 1: Specifications for pipes, fittings and the system
- [20] EN 12056-1, Gravity drainage systems inside buildings — Part 1: General and performance requirements
- ENV 13801, Plastics piping systems for soil and waste discharge (low and high temperature) within the [21] building structure — Thermoplastics — Recommended practice for installation
- RAL 840-HR²⁾, Colour register [22]

²⁾ Obtainable from national standards institutes.

ISO 7671:2003(E)

ICS 83.140.30; 91.140.80

Price based on 25 pages